



Standard Test Method for Sampling and Testing Grout¹

This standard is issued under the fixed designation C 1019; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reappraisal. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reappraisal.

This standard has been approved for use by agencies of the Department of Defense.

1. Scope *

1.1 This test method covers procedures for both field and laboratory sampling and compression testing of grout used in masonry construction.

NOTE 1—The testing agency performing this test method should be evaluated in accordance with Practice C 1093.

1.2 The values stated in inch-pound units are to be regarded as the standard.

1.3 *This standard does not purport to address all of the safety problems, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:

C 39 Test Method for Compressive Strength of Cylindrical Concrete Specimens²

C 143 Test Method for Slump of Hydraulic Cement Concrete²

C 511 Specification for Moist Cabinets, Moist Rooms, and Water Storage Tanks Used in the Testing of Hydraulic Cements and Concretes³

C 617 Practice for Capping Cylindrical Concrete Specimens²

C 1064 Test Method for Temperature of Freshly Mixed Portland Cement Concrete²

C 1093 Practice for Accreditation of Testing Agencies for Unit Masonry⁴

3. Significance and Use

3.1 Grout used in masonry is a fluid mixture of cementitious materials and aggregate with a high water content for ease of placement.

3.1.1 During construction, grout is placed within or between absorptive masonry units. Excess water must be removed from

grout specimens in order to provide compressive strength test results more nearly indicative of the grout strength in the wall. In this test method, molds are made from masonry units having the same absorption and moisture content characteristics as those being used in the construction.

3.2 This test method is used to either help select grout proportions by comparing test values or as a quality control test for uniformity of grout preparation during construction.

3.3 The physical exposure condition and curing of the grout are not exactly reproduced, but this test method does subject the grout specimens to absorption conditions similar to those experienced by grout in the wall.

NOTE 2—Test results of grout specimens taken from a wall should not be compared to test results obtained with this test method.

4. Apparatus

4.1 *Maximum-Minimum Thermometer.*

4.2 *Straightedge*, a steel straightedge not less than 6 in. (152.4 mm) long and not less than 1/16 in. (1.6 mm) in thickness.

4.3 *Tamping Rod*, a nonabsorbent rod, either round or square in cross section nominally 5/8 in. (15.9 mm) in dimension with ends rounded to hemispherical tips of the same diameter. The rod shall be a minimum length of 12 in. (304.8 mm).

4.4 *Nonabsorbent Blocks*, nonabsorbent, rigid squares with side dimensions equal to one half the desired grout specimen height, within a tolerance of 5 %, and of sufficient quantity or thickness to yield the desired grout specimen height, as shown in Fig. 1 and Fig. 2.

NOTE 3—Nonabsorbent blocks may be of plastic, wood, or other nonabsorbent material. Certain species of wood contain sugars which cause retardation of cement. In order to prevent this from occurring, new wooden blocks shall be soaked in limewater for 24 h, sealed with varnish or wax, or covered with an impermeable material prior to use.

PROCEDURES

5. Test Specimens

5.1 Each grout specimen shall have a square cross-section, 3 in. (76 mm) or larger on the sides and twice as high as its width. Dimensional tolerances shall be within 5 % of the width selected.

5.2 Test at least three specimens at each age specified.

¹ This test method is under the jurisdiction of ASTM Committee C12 on Mortars and Grouts for Unit Masonry and is the direct responsibility of Subcommittee C12.02 on Research and Methods of Test.


Current edition approved Nov. 10, 2000. Published December 2000. Originally published as C 1019–84. Last previous edition C 1019–00a.

² *Annual Book of ASTM Standards*, Vol 04.02.


³ *Annual Book of ASTM Standards*, Vol 04.01.

⁴ *Annual Book of ASTM Standards*, Vol 04.05.

*A Summary of Changes section appears at the end of this standard.

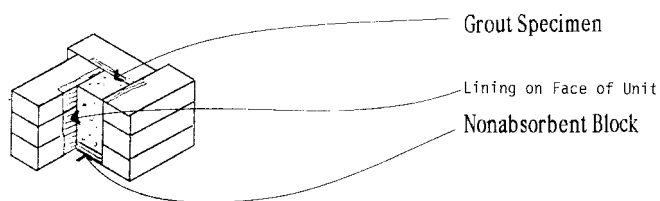

NOTE—Front masonry unit stack not shown to allow view of specimen.
FIG. 1 Grout Mold (Units 6 in. (152.4 mm) or Less in Height, 2¼ in. (57.2 mm) High Brick Shown)

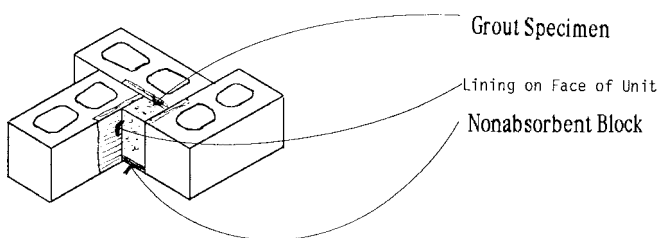

NOTE—Front masonry unit not shown to allow view of specimen.
FIG. 2 Grout Mold (Units Greater than 6 in. (152.4 mm) High, 8 in. (203.2 mm) High Concrete Masonry Unit Shown)

NOTE 4—Frequency of sampling and age of test is to be determined by the specifier of this test method and is usually found in the construction documents.

6. Mold Construction

6.1 Select a level location where the molds remain undisturbed for 48 h.

NOTE 5—The location of specimen construction should be protected and as free from perceptible vibration as possible.

6.2 The construction of the mold shall simulate the in-situ construction. If the grout is placed between two different types of masonry units, both types shall be used to construct the mold.

6.3 Form a space with a square cross-section, 3 in. (76 mm) or larger on each side and twice as high as its width, by stacking masonry units of the same type and moisture condition as those being used in the construction. The surface of the unit in contact with the grout specimen shall not have been previously used to mold specimens. Place nonabsorbent blocks, cut to proper size and of the proper thickness or quantity, at the bottom of the space to achieve the necessary height of specimen. Tolerance on space and specimen dimensions shall be within 5 % of the specimen width. See Fig. 1 and Fig. 2 and accompanying notes.

NOTE 6—Other methods of obtaining grout specimens and specimens of different geometry have been employed in grout testing, but are not described in this test method. Other methods used to obtain grout specimens include: drilling grout-filled cores of regular units; filling cores of masonry units specifically manufactured to provide grout specimens; filling compartments in slotted corrugated cardboard boxes specifically manufactured to provide grout specimens; and forming specimens from different sized masonry units of the same or similar material.

Since test results vary with methods of forming and specimen geometry, comparative test results between the specimen described in this test method and the proposed specimen should be required and confined to a single specimen shape and method of forming.

6.4 Line the masonry surfaces that will be in contact with the grout specimen with a thin, permeable material to prevent bond to the masonry units.

NOTE 7—The lining, such as paper towel, is used to aid in stripping the grout specimen from the mold. Proper installation of the lining prevents irregularly sized specimens and varying test results.

6.5 Brace units to prevent displacement during grouting and curing.

7. Sampling Grout

7.1 *Size of Sample*—Grout samples to be used for slump and compressive strength tests shall be a minimum of ½ ft³ (0.014 m³). Sample size retained at ½ ft³.

7.2 *Procedure*—The procedures used in sampling shall include the use of precautions that will assist in obtaining samples that are representative of the nature and condition of the grout. After the final slump adjustment has been made, sample grout as the grout is being placed.

7.2.1 *Field Sampling*—Collect two or more portions taken at regularly spaced intervals during the discharge of the middle portion of the batch. The elapsed time between obtaining the first and final portions of the sample shall be as short as possible, but not more than 15 min.

7.2.2 *Laboratory Sampling*—The entire mixed batch of grout is the sample.

NOTE 8—The field technician sampling, making, and curing specimens for acceptance testing should be certified (American Concrete Institute Field Testing Technician—Grade I, National Concrete Masonry Association Masonry Testing Technician, or equivalent). Equivalent certification programs should include both written and performance examinations.

7.3 Transport the grout sample to the mold location. Protect the sample from the sun, wind, and other sources of rapid evaporation and from contamination. Remix the sample with a shovel or trowel to ensure uniformity.

8. Temperature and Slump Test

8.1 Measure and record the temperature of the grout sample in accordance with Test Method C 1064.

8.2 Begin filling the slump cone within 5 min of obtaining the final portion of the sample.

8.3 Measure and record the slump in accordance with the requirements of Test Method C 143.

9. Compressive Test Specimen

9.1 If grout from the slump test is used for the compressive test specimens, remix the sample. Begin filling the compressive strength molds within 15 min of obtaining the final portion of the sample.

9.2 Fill the mold with grout in two layers of approximately equal depth. Rod each layer 15 times with the tamping rod. Rod the bottom layer through its depth. Slightly overfill the mold. Rod the second layer with the tamping rod penetrating ½ in. (12.7 mm) into the lower layer. Distribute the strokes uniformly over the cross section of the mold.

9.3 Strike off the top surface of the specimen with a straightedge to produce a flat surface that is even with the top edge of the mold and that has no depressions or projections larger than ⅛ in. (3.2 mm). Cover immediately with a damp

absorbent material such as cloth or paper towel. Keep the top surface of the specimens damp by wetting the absorbent material and covering with a nonabsorbent, nonreactive material to retain the moisture. Do not disturb the specimens.

9.4 Within 30 min after filling the mold, add sufficient grout without rodding to fill the depression caused by initial water loss. Strike off the top surface of the specimen with a straightedge to produce a flat surface that is even with the top edge of the mold. Cover immediately with a damp absorbent material such as cloth or paper towel. Keep the top surface of the specimen damp by wetting the absorbent material and covering with a nonabsorbent, nonreactive material. Do not disturb the specimen until the molds are removed.

9.5 Protect the specimens from freezing and variations in temperature. Store an indicating maximum-minimum thermometer with the specimens and record the maximum and minimum temperatures experienced prior to the time the specimens are placed in the final curing environment.

10. Transportation, Curing, and Testing of the Specimens

10.1 Remove the molds between 24 and 48 h after making the specimens.

10.2 Immediately transport field specimens to the laboratory, keeping the specimens damp and in a protective container, or place the specimens in a moist condition with free water maintained on their surfaces at all time within 30 min after removing molds.

10.3 Within 72 h from initial molding, store in a moist room conforming to Specification C 511.

10.4 Cap the specimens in accordance with the applicable requirements of Practice C 617.

NOTE 9—Practice C 617 refers to capping cylindrical specimens; therefore, the alignment devices may need to be modified to ensure proper use with the rectangular prism specimens of this method. All other sections of Practice C 617 are applicable.

10.5 Measure and record the width of each face at mid-height. Measure and record the height of each face at mid-width. Measure and record the amount out of plumb at mid-width of each face.

10.6 Test the specimens in a damp condition in accordance with the applicable requirements of Test Method C 39.

11. Calculations

11.1 Determine the average cross-sectional area by measuring the width of each face at its mid-height, calculating the average width of opposite faces, and multiplying the averages.

11.2 Calculate the compressive strength by dividing the maximum load by the average cross-sectional area and express the result to the nearest 10 psi (69 kPa).

12. Report

12.1 The report shall include the following:

12.1.1 Mix design,

12.1.2 Slump of the grout,

12.1.3 Type and number of units used to form mold for specimens,

TABLE 1 Statistics of Laboratory-Prepared Specimens

Number of Specimens	Mean, psi (MPa)	Standard Deviation, psi (MPa)	Coefficient of Variation, %
5	3784 (26.1)	306 (2.11)	8.1
5	2494 (17.2)	220 (1.52)	8.8
5	3178 (21.9)	634 (4.37)	20.0
6	5480 (37.8)	899 (6.2)	16.4
10	5350 (36.9)	826 (5.7)	15.4
12	3872 (26.7)	333 (2.30)	8.6

TABLE 2 Statistics of Field-Prepared Specimens

Number of Specimens	Mean, psi (MPa)	Standard Deviation, psi (MPa)	Coefficient of Variation, %
3	3583 (24.7)	118 (0.81)	3.3
6	5455 (37.6)	324 (2.23)	5.9
6	3992 (27.5)	228 (1.57)	5.7

12.1.4 Description of the specimens—dimensions, amount out of plumb in percent,

12.1.5 Curing history, including initial temperature, maximum and minimum temperatures, and age of specimens when transported to laboratory and when tested,

12.1.6 Maximum load and compressive strength of each specimen and average compressive strength of the specimens, and

12.1.7 Description of failure.

13. Precision and Bias

13.1 *General:*

13.1.1 The masonry units used to form the mold have different absorption rates and will remove slightly different amounts of water from each specimen. Thus the standard deviation for this test method is higher than that using a nonabsorbent mold.

13.1.2 The standard deviation from field specimens of grout will be higher than that for laboratory specimens. There is less control of grout ingredients, conditions of units for mold construction, and initial curing environment in field-prepared specimens.

13.2 Limited test data are available for analysis at this time. A more detailed statement will be provided later. The following summary of available data is provided for review.

13.2.1 *Laboratory Specimens*—The coefficients of variation for a series of three laboratory prepared specimens ranged from 5.8 % with a mean value of 6452 psi (44.45 MPa) to 24.6 % with a mean value of 1373 psi (9.47 MPa) averaging 14.4 %. The standard deviation ranged from 211 psi (1.46 MPa) to 505 psi (3.48 MPa). Tests with a larger number of specimens had the characteristics found in Table 1.

13.2.2 *Field Specimens*—Test reports from one project show the characteristics found in Table 2.

14. Keywords

14.1 cementitious; compressive strength; grout; masonry units

SUMMARY OF CHANGES

Committee C12 has identified the location of selected changes to this standard since C 1019–00a that may impact the use of this standard.

(1) Changes from permissive to mandatory language were made in Paragraphs 3.2, 3.3, and 6.1. Also, Note 2 was added.

The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).