



# Standard Practice for Estimating Consistency of Wet-Mixed Thermal Insulating Cement<sup>1</sup>

This standard is issued under the fixed designation C 405; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This practice covers estimating the consistency of thermal insulating cements, after mixing with a known amount of water. The consistency of a wet cement affects such properties as ease of trowelling, wet adhesion, drying shrinkage, dry density, and thermal conductivity.

1.2 This practice estimates consistency of thermal insulating cements in terms of either percentage of deformation as described in Method A or inches of penetration as described in Method B.

1.3 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are for information only.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

2.1 *ASTM Standards:*

C 163 Practice for Mixing Thermal Insulating Cement Samples<sup>2</sup>

C 168 Terminology Relating to Thermal Insulating Materials<sup>2</sup>

## 3. Terminology

3.1 *Definitions*—Except for 3.2, Terminology C 168 shall apply to the terms used in this standard.

3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *consistency*—the degree to which wet-mixed thermal insulating cement resists deformation due to the application of outside forces such as trowel pressure.

## METHOD A—DEFORMATION METHOD

## 4. Apparatus

4.1 *Dead Load Tester* (Fig. 1), equipped with two clamps,

<sup>1</sup> This practice is under the jurisdiction of ASTM Committee C-16 on Thermal Insulation and is the direct responsibility of Subcommittee C16.31 on Chemical and Physical Properties.

Current edition approved June 25, 1982. Published August 1982. Originally published as C 405 – 58 T. Last previous edition C 405 – 60 (1979).

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 04.06.

one of which permits the loading member arm to swivel out of the way while the sample is put in position, while the other keeps the loading member from sliding until it is released. The total weight of the loading member (sliding vertical bar plus 8-in. (203-mm) diameter disk) is adjusted to exactly 5 lb (2.27 kg) by adding weights as necessary at the top of the bar. A cylindrical brass mold, 3 in. (76.2 mm) in inside diameter by 6 in. (152.4 mm) in height, is used to prepare the sample.

## 5. Sample Preparation

5.1 Sample at least 3 lb (1.4 kg) of dry cement and mix with a weighed amount of water at a temperature of 70 to 75°F (21 to 24°C) in accordance with Practice C 163. When thoroughly mixed, smooth the cement into a circular mound 3 to 4 in. high (75 to 100 mm) and allowed to sit for 1 h. Then mix once again before testing (hydraulic setting cements shall be tested 15 min after mixing).

NOTE 1—All the water to be mixed with the dry cement shall be added at one time: tests at other water-cement ratios shall be performed using entirely new batches of cement mixed in accordance with 5.1.

## 6. Procedure

6.1 Oil the inside of the cylindrical mold lightly. Fill the mold by throwing 25 to 30 small pieces of wet cement into it with just enough force to eliminate voids. When the mold is slightly over full, strike off the excess cement level with the top of the mold, with a trowel or spatula; take care not to compress the cement when this is done.

6.2 Center the filled mold under the load member of the apparatus, remove the mold, and place the load member flush on the sample. If the sample deforms (sags) when it is free standing, still place the load member flush on the sample, and include the amount of sag as part of the measured deformation. Release the load member, and measure the deformation 30 s later.

6.3 Obtain at least three tests from each batch of wet-mixed cement prepared in accordance with 5.1.

## 7. Calculation

7.1 Calculate the percentage deformation for each test as follows:

7.1.1 *Inch-Pound Units:*

$$\text{Deformation, \%} = [(6 - A)/6] \times 100 \quad (1)$$

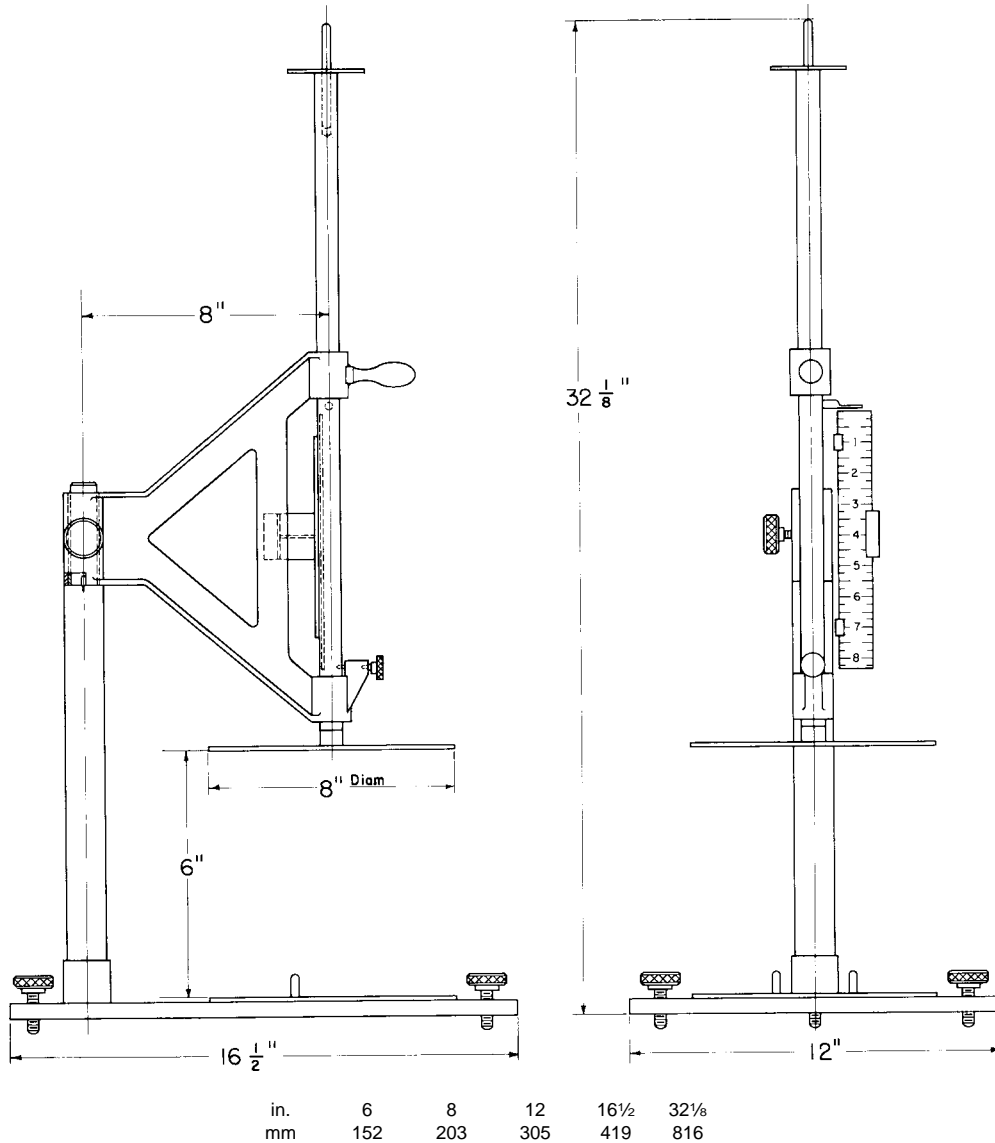


FIG. 1 Apparatus for Measuring Consistency by Deformation of Wet-Mixed Thermal Insulating Cements

where:

A = height after deformation, in.

7.1.2 Metric Units:

$$\text{Deformation, \%} = [(152.4 - A)/152.4] \times 100 \quad (2)$$

where:

A = height after deformation, mm.

8. Report

8.1 Average the percentage deformations for all tests and report the average, along with the water-cement ratio used. If any single test value differs from the average by more than ± 5 % deformation, discard it and repeat the determination.

METHOD B—PENETRATION METHOD

9. Apparatus

9.1 Penetration Tester (Fig. 2)—The three pointed steel rods or spears have a loose sliding fit in their guides, which are

22 in. (559 mm) long. The rods are held up by three electromagnets connected to a switch; when the switch is thrown, the three spears are released and drop simultaneously. A ruler is attached to one of the supports so that the penetrations of the spears can be read directly.


10. Sample Preparation

10.1 Prepare the sample in accordance with Section 4.

11. Procedure

11.1 Drop handfuls of wet cement into the sample can from a height of approximately 40 in. (1000 mm). When the can is slightly over full, strike off the excess cement with a trowel or spatula, flush with the top of the can but without exerting any pressure on the cement. Then place the filled sample can in position below the raised spears of the apparatus.

11.2 Release the spears by means of the electrical switch. Measure the depth of penetration of each of the spears 30 s later, and take the average depth of penetration of the three

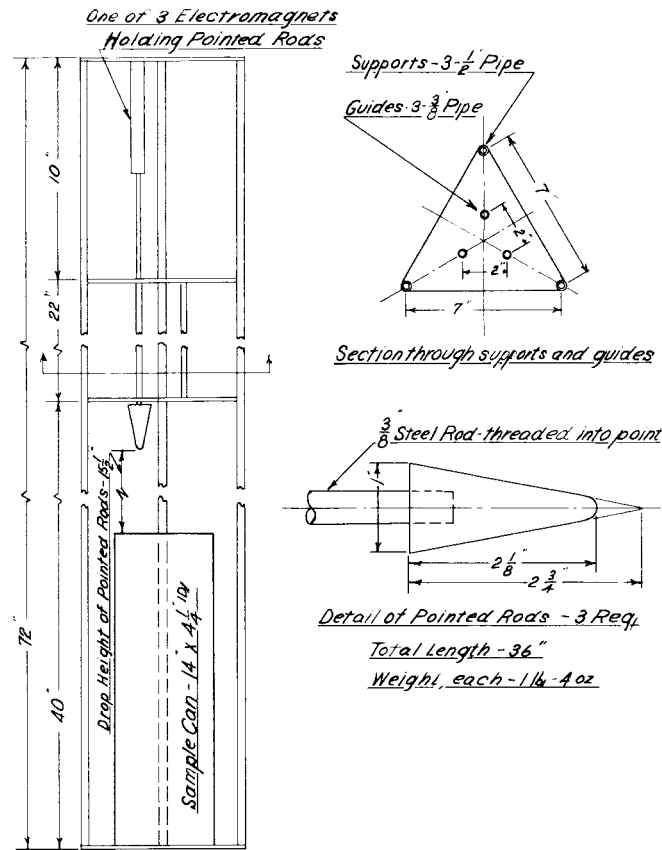

in.	3/8	1	2	2 1/8	2 3/4	3 3/8	3 1/2	4 1/2	7	10	14	15 1/2	22	36	40	72
mm	10	25	51	54	70	86	89	114	178	254	356	394	559	914	1016	1829

FIG. 2 Apparatus for Measuring Consistency by Penetration of Wet-Mixed Thermal Insulating Cements

spears as the measure of the consistency for that test.

11.3 Perform at least two tests at each water-cement ratio to be tested.

**12. Report**

12.1 Average the penetration from all tests and report the average, along with the water-cement ratio used. Discard the value and repeat the determination if the penetration of any spear differs from the average by more than ± 1 in. (± 25.4 mm).

**13. Precision and Bias**

13.1 This practice has been found to be useful to many users as a way to estimate the proper amount of water to be used in mixing insulating cements. No attempt to develop a precision and bias statement has been made, and none is anticipated.

**14. Keywords**

14.1 cement; thermal insulating; consistency; deformation; penetration; thermal insulating cements; thermal insulating materials; cement

*The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).*