



Designation: E 580 – 002

## Standard Practice for Application of Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels in Areas Requiring Seismic Restraint<sup>1</sup>

This standard is issued under the fixed designation E 580; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

*This standard has been approved for use by agencies of the Department of Defense.*

### 1. Scope

1.1 This practice covers acoustical ceiling suspension systems and their additional requirements for application in areas subject to light to moderate seismic disturbance such as Uniform Building Code Seismic Zone 2, the BOCA Basic National Building Code where  $A_v$  is less than 0.20 but greater than 0.10, and the Standard Building Code (SBC) where  $A_v$  is less than 0.20 but greater than 0.05. This practice also covers areas subject to moderate to severe seismic disturbance such as Uniform Building Code Seismic Zones 3 and 4, the BOCA Basic National Building Code where  $A_v$  is greater than 0.20, and the SBC where  $A_v$  is greater than 0.20. The application of this practice is to be determined by local authorities. Current seismic maps published by recognized authorities

---

<sup>1</sup> This practice is under the jurisdiction of ASTM Committee E33 on Environmental Acoustics and is the direct responsibility of Subcommittee E33.04 on Application. Current edition approved ~~March~~ April 10, 2000<sup>2</sup>. Published ~~June 2000~~ July 2002. Originally published as E 580 – 76. Last previous edition E 580 – 9600.

such as those previously mentioned, should be consulted. Related material such as Open File 82-1033<sup>2</sup> and MS-812 Seismicity Map<sup>3</sup> may also be consulted.

1.2 Specification C 635 and Practice C 636 cover suspension systems and their application without special regard to seismic restraint needs. They remain applicable and should be followed when this practice is specified.

1.3 This practice is not intended to stifle research and development of new products or methods which may simplify this specified application method. A variation, however, must be substantiated by verifiable engineering data.

1.4 A ceiling area of 144 ft<sup>2</sup>(13.4 m<sup>2</sup>) or less, surrounded by walls that connect directly to the structure above shall be exempt from this practice.

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

### 2.1 ASTM Standards:

C 635 Specification for the Manufacture, Performance, and Testing of Metal Suspension Systems for Acoustical Tile and Lay-in Panel Ceilings<sup>4</sup>

C 636 Practice for Installation of Metal Ceiling Suspension Systems for Acoustical Tile and Lay-in Panels<sup>4</sup>

### 2.2 Other Standards:

National Electric Code, 1993<sup>5</sup>

Uniform Building Code, 1994<sup>6</sup>

BOCA Basic Building Code, 1993<sup>7</sup>

## 3. Areas Subject to Light to Moderate Seismic Disturbance

### 3.1 Suspension System Components:

3.1.1 The actual average weight of the ceiling system, including grid, panel or tile, light fixtures, and air terminals must be 2.5 lb/ft<sup>2</sup>(12.2 kg/m<sup>2</sup>) or less. All other services must be supported independently from the ceiling system. For ceilings that have an average weight greater than 2.5 lb/ft<sup>2</sup>, the ceiling may be installed as specified in Section 4. Other deviations or variations must be substantiated by verifiable engineering data.

3.1.2 The main runners and cross runners of the ceiling system and their splices, intersection connectors, and expansion devices shall be designed and constructed to carry a mean ultimate test load of not less than 60 lb (27.2 kg) in tension with a 5° misalignment of the members in any direction and in compression. Instead of a 5° misalignment, the load may be applied with a 1-in. (25.4-mm) eccentricity on a sample not more than 24 in. (609 mm) long on each side of the splice.

3.1.3 Evaluation of test results shall be made on the basis of the mean values resulting from tests of not fewer than three identical specimens, provided the deviation of any individual test result from the mean value does not exceed ±10 %.

### 3.2 Suspension System Application:

3.2.1 All perimeter closure angles or channels shall provide a support ledge of approximately 7/8 in. (22.2 mm) or greater.

#### ~~3.2.2 A terminal~~

~~3.2.2 The end of a grid member (or tile) shall rest that rests on the ledge or molding with shall have at least 3/8-in. (9.5-mm) clearance from an edge or wall as shown in Fig. 1. Reveal (shadow) edge wall closures should accommodate these clearances as shown in Fig. 2. Ends of main runners and cross members shall be tied together to prevent their spreading.~~

3.2.3 Direct concealed suspended ceiling systems shall have positively connected stabilizer struts or mechanically connected cross runner at a maximum spacing of 60 in. (1524 mm) perpendicular to the main runners (see Fig. 3). Stabilizer bars shall occur within 24 in. (609 mm) of each wall.

### 3.2.4 Suspension Wire Application:

3.2.4.1 Suspension wires of soft, annealed, galvanized steel wire shall not be smaller than No. 12 gage spaced at 4 ft (1219 mm) on center or No. 10 gage at 5 ft (1524 mm) on center along each main runner unless calculations justifying the increased spacing are provided.

3.2.4.2 Each vertical wire shall be attached to the ceiling suspension member and to the support above with a minimum of three turns with a connection device capable of carrying not less than a 100-lb (45.4-kg) allowable load.

3.2.4.3 Suspension wires shall not hang more than one in six out of plumb unless countersloping wires are provided.

3.2.4.4 Wires shall not attach to or bend around interfering material or equipment. A trapeze or equivalent device shall be used where obstructions preclude direct suspension. Trapeze suspensions shall be a minimum of back-to-back 1¼-in. (31.75 mm) cold-rolled channels for spans exceeding 48 in. (1219 mm).

<sup>2</sup> Open File 82-1033 Probabilistic Estimate of Maximum Acceleration in Rock published by United States Geological Survey.


<sup>3</sup> MS-8125 Seismicity Map of the Conterminous United States and Adjacent Areas, 1965–1974 published by United States Geological Survey.

<sup>4</sup> *Annual Book of ASTM Standards*, Vol 04.06.


<sup>5</sup> Available from National Fire Protection Association, Batterymarch Park, Quincy, MA 02269.

<sup>6</sup> Available from International Conference of Building Officials, 5360 S. Workman Mill Rd., Whittier, CA 90601.

<sup>7</sup> Available from Building Officials and Code Administrators International, 4051 W. Flossmoor Rd., Country Club Hills, IL 60477.

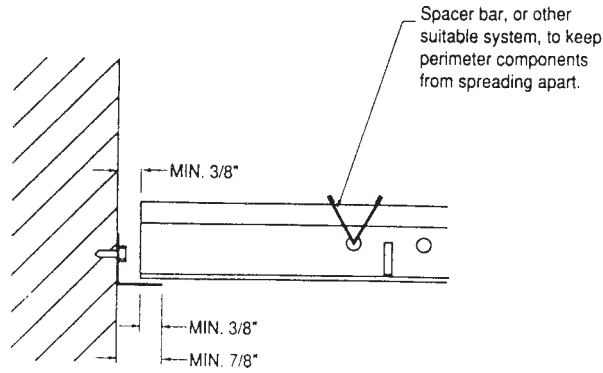

**FIG. 1 Light to Moderate Treatment of Cross Runners, Main Runners, and Wall Closures at Terminal Ends**

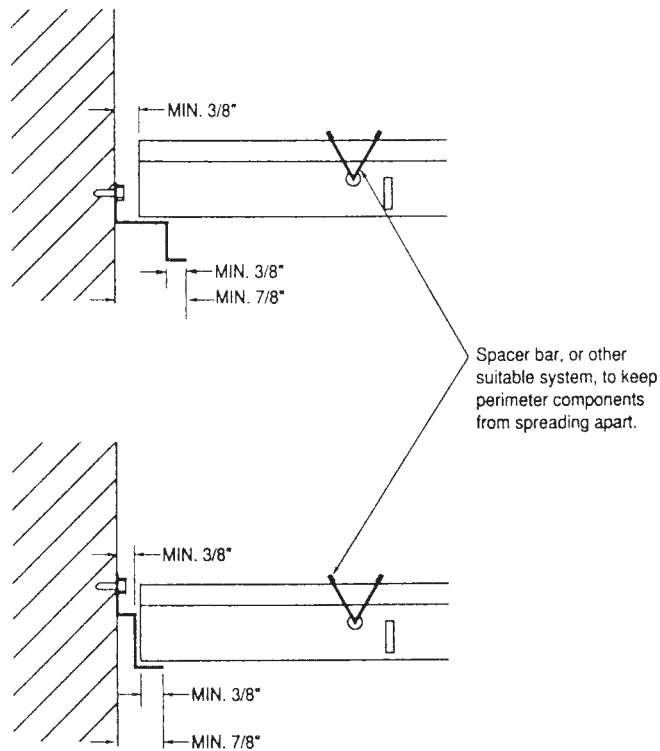

**FIG. 2 Light to Moderate Treatment of Cross Runners and Main Runners at Terminal Ends When Using Reveal (Shadow) Edge Wall Closures**


3.2.4.5 For perimeter closure angles that provide a support ledge of less than  $\frac{7}{8}$  in. (22.2 mm), the terminal ends of each cross runner or main runner shall be independently supported within 8 in. (203 mm) from each wall or ceiling discontinuity as shown in Fig. 3. This support may be a No. 12-gage hanger wire or other support that prevents the grid from falling. This wire does not need to be vertical but should not have a slope greater than one in six out of plumb. A  $\frac{3}{8}$ -in. (9.5-mm) grid end clearance from a wall should be maintained.

3.2.5 The intent of the preceding provisions is to provide an unrestrained ceiling system that will accommodate the movement of the structure during a seismic event. The objective is to have a free-floating ceiling. Nothing may be installed which prevents the ceiling system from moving. All ceiling penetrations (columns, sprinklers, etc.) and independently supported fixtures or services are to be considered as perimeter closures that also must allow the noted clearances by using suitable escutcheons or closure details.

3.2.6 For essential facilities, perimeter support of each cross runner and main runner, as mentioned in 3.2.4.5, is required. In addition, a  $\frac{1}{2}$ -in. (12.7-mm) grid end clearance from a wall should be maintained.

**3.3 Light Fixture Application:**

3.3.1 All lighting fixtures shall be positively attached to the suspended ceiling system by mechanical means as specified in the National Electrical Code, Section 410-16(c) unless independently supported. The attachment device, a minimum of two per fixture, shall have a capacity of 100 % of the lighting fixture weight acting in any direction.

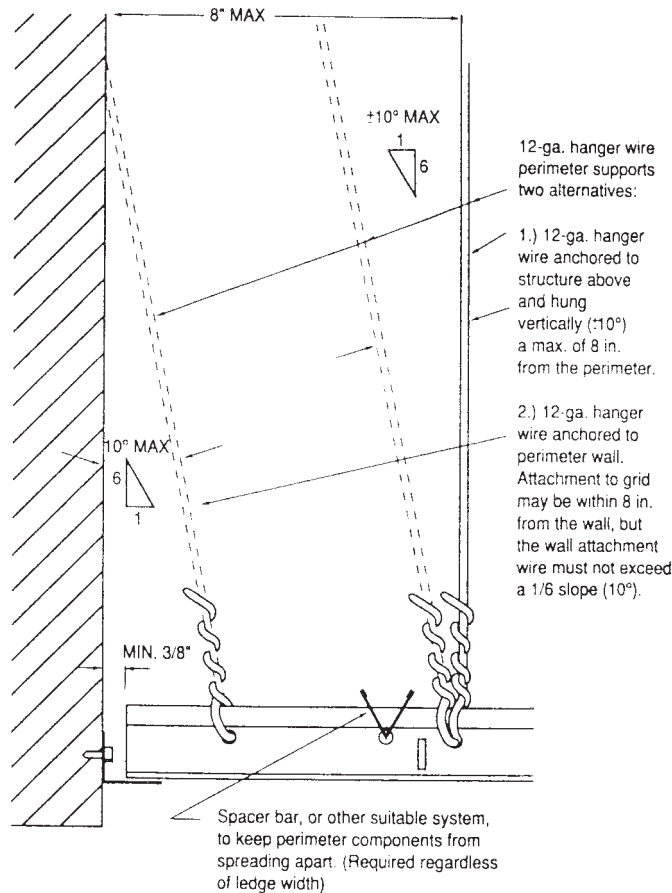

**FIG. 3 Light to Moderate Treatment of Cross Runners and Main Runners at Terminal Ends When Support Ledge of Perimeter Closure is Less Than Minimum  $\frac{3}{8}$  in.**

3.3.2 Surface-mounted lighting fixtures shall be attached to the ceiling system with positive clamping devices that completely surround the supporting members. Safety wires shall be attached between the clamping device and the adjacent ceiling hanger or to the structure above. In no case shall the fixture exceed the design carrying capacity of the supporting members.

3.3.3 Pendant-hung lighting fixtures shall be supported directly from the structure above using No. 9-gage wire or an approved alternate support without using the ceiling suspension system for direct support.

3.3.4 Lighting fixtures weighing less than 56 lb (25.3 kg) shall have, in addition to the requirements outlined in 3.3, two No. 12-gage hangers connected from the fixture housing to the structure above. These wires may be slack.

3.3.5 Lighting fixtures weighing 56 lb (25.3 kg) or more shall be supported directly from the structure above by approved hangers.

3.3.6 Rigid conduit is not permitted for attachment of the fixtures.

#### 3.4 Services Within the Ceiling:

3.4.1 Ceiling mounted air terminals or services weighing less than 20 lb (9.1 kg) shall be positively attached to the ceiling suspension main runners or cross runners.

3.4.2 Air terminals or services weighing more than 20 lb (9.1 kg) but not more than 56 lb (25.3 kg) shall have, in addition to the requirements in 3.4.1, two No. 12-gage hangers connected from the terminal or service to the ceiling system hangers or to the structure above. These wires may be slack.

3.4.3 Air terminals or services weighing more than 56 lb (25.3 kg) shall be supported directly from the structure above by approved hangers.

#### 3.5 Partition Application to Suspended Ceilings:

3.5.1 The ceiling system cannot be used to provide lateral support for walls or partitions. Walls or partitions may be attached to the ceiling grid provided they allow the ceiling membrane to move laterally to accommodate the required clearance as specified in Section 4.

### 4. Areas Subject to Severe Seismic Disturbance

#### 4.1 Suspension System Components:

4.1.1 Only intermediate and heavy-duty main tees, as defined in Specification C 635, may be used, except where no loads other

than ceiling panels or tiles less than 1.25 lb/ft<sup>2</sup> (6.1 kg/m<sup>2</sup>) are supported by the members.

4.1.2 The main runners and cross runners of the ceiling system and their splices, intersection connectors, and expansion devices shall be designed and constructed to carry a mean ultimate test load of not less than 180 lb (81.6 kg) or twice the actual load, whichever is greater, in tension with a 5° misalignment of the members in any direction and in compression. Instead of a 5° misalignment, the load may be applied with a 1-in. (25.4-mm) eccentricity on a sample not more than 24 in. (609 mm) long on each side of the splice. The connectors at splices and intersections all shall be of the mechanical interlocking type.

4.1.3 Evaluation of test results shall be made on the basis of the mean values resulting from test of not fewer than three identical specimens, provided the deviation of any individual test result from the mean value does not exceed ±10 %.

#### 4.2 Suspension System Application:

4.2.1 Unless perimeter members are a structural part of the approved system, wall angles or channels shall be considered as aesthetic closers and shall have no structural value assessed to themselves or their method of attachment to the walls.

4.2.2 Main runners and cross runners may be attached to the perimeter members on two adjacent walls. A clearance of ½ in. (12.7 mm) shall be maintained between the main runners and cross runner ends and the perimeter members on the two remaining walls (see Fig. 2, 4, C-C). Ends of main runners and cross members shall be tied together to prevent their spreading.

4.2.3 Direct concealed suspended ceiling systems shall have positively connected stabilizer struts or mechanically connected cross runners at a maximum spacing of 60 in. (1524 mm) perpendicular to the main runners (see Fig. 3). Stabilizer bars shall occur within 24 in. (609 mm) of each wall.

#### 4.2.4 Suspension Wire Application (see Fig. 4):

4.2.4.1 Suspension wires of soft, annealed, galvanized steel wire shall not be smaller than No. 12 gage spaced at 4 feet (1219 mm) on center or No. 10 gage at 5 ft (1524 mm) on center along each main runner unless calculations justifying the increased spacing are provided.

4.2.4.2 Each vertical wire shall be attached to the ceiling suspension member and to the support above with a minimum of three turns with a connection device capable of carrying not less than a 100-lb (45.4-kg) allowable load.

4.2.4.3 Suspension wires shall not hang more than one in six out of plumb unless countersloping wires are provided.

4.2.4.4 Wires shall not attach to or bend around interfering material or equipment. A trapeze or equivalent device shall be used where obstructions preclude direct suspension. Trapeze suspensions shall be a minimum of back-to-back 1¼-in. (31.75-mm) cold-rolled channels for spans exceeding 48 in. (1219 mm).

4.2.4.5 Where substantiating design calculations are not provided, horizontal restraints shall be effected by four No. 12-gage wires secured to the main runner within 2 in. (50.8 mm) of the cross runner intersection and splayed 90° from each other at an angle not exceeding 45° from the plane of the ceiling. A strut fastened to the main runner shall be extended to and fastened to the structural members supporting the roof or floor above. The strut shall be adequate to resist the vertical component induced by the bracing wires. These horizontal restraint points shall be placed 12 ft (3658 mm) on center in both directions with the first point within 6 ft (1829 mm) from each wall. Attachment of the restraint wires to the structure above shall be adequate for the load imposed. See Fig. 4.

4.2.4.6 Lateral force bracing members shall be spaced a minimum of 6 in. (152 mm) from all horizontal piping or duct work that is not provided with bracing restraints for horizontal forces. Bracing wire shall be attached to the grid and to the structure in such a manner that they can support a design load of not less than 200 lb (90.6 kg) or the actual design load, whichever is greater, with a safety factor of 2.

4.2.4.7 The terminal end of each cross runner and main runner shall be supported independently, a maximum of 8 in. (203 mm) from each wall or ceiling discontinuity with No. 12-gage wire or approved wall support. See Fig. 4.

#### 4.3 Light Fixture Application:

4.3.1 All lighting fixtures shall be positively attached to the suspended ceiling system by mechanical means as specified in the National Electrical Code, Section 410-16(c) unless independently supported. The attachment device, a minimum of two per fixture, shall have a capacity of 100 % of the lighting fixture weight acting in any direction.

4.3.2 Surface-mounted lighting fixtures shall be attached to the ceiling system with positive clamping devices that completely surround the supporting members. Safety wires shall be attached between the clamping device and the adjacent ceiling hanger or to the structure above. In no case shall the fixture exceed the design carrying capacity of the supporting members.

4.3.3 When intermediate-duty systems are used, No. 12-gage hangers shall be attached to the grid members within 3 in. (76.2 mm) of each corner of each fixture. Tandem fixtures may utilize common wires. Where heavy-duty systems are used, supplemental hangers are not required if a 48-in. (1219-mm) modular pattern is followed.

4.3.4 Pendant-hung lighting fixtures shall be supported directly from the structure above using No. 9-gage wire or an approved alternate support without using the ceiling suspension system for direct support.

4.3.5 Lighting fixtures weighing less than 56 lb (253 kg) shall have, in addition to the requirements outlined in 4.3.4, two No. 12-gage hangers connected from the fixture housing to the structure above. These wires may be slack.

4.3.6 Lighting fixtures weighing 56 lb (253 kg) or more shall be supported directly from the structure above by approved hangers.

4.3.7 Rigid conduit is not recommended for attachment of the fixtures.

#### 4.4 Services Within the Ceiling:

⊗ Bracing Location

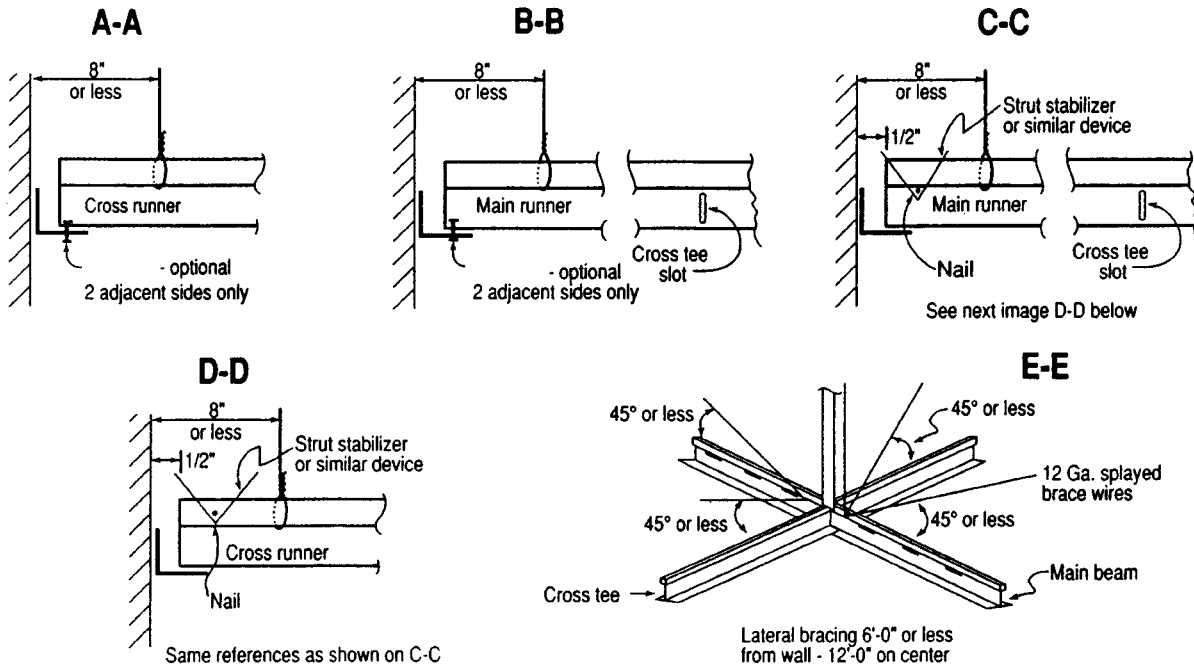
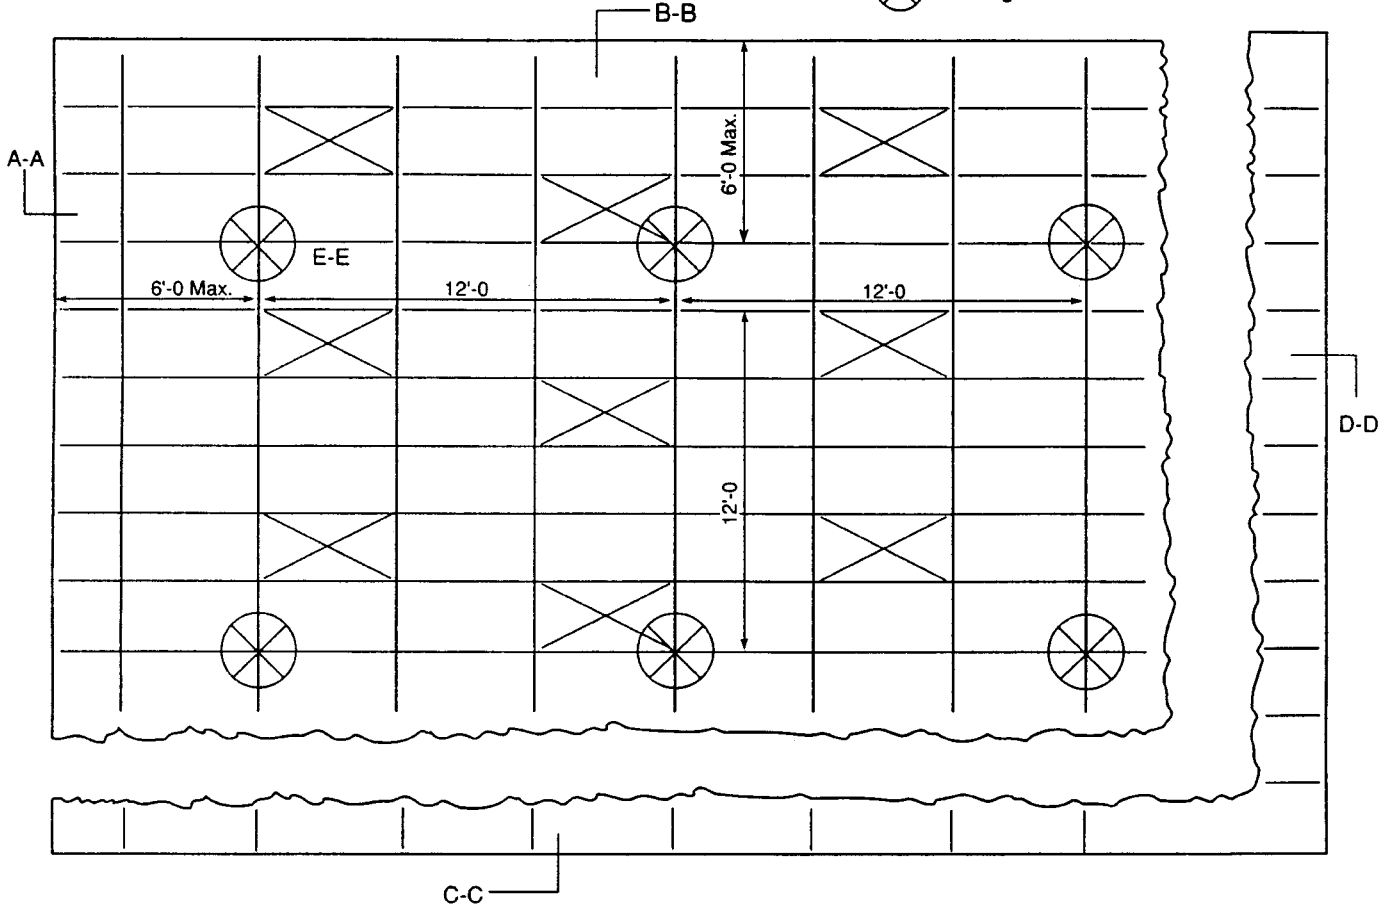


FIG. 4 Moderate to Severe Treatment

4.4.1 Ceiling-mounted air terminals or services weighing less than 20 lb (9.1 kg) shall be positively attached to the ceiling suspension main runners or to cross runners with the same carrying capacity as the main runners.

4.4.2 Air terminals or services weighing more than 20 lb (9.1 kg) but not more than 56 lb (253 kg) shall have, in addition to

the requirements in 4.4.1, two No. 12-gage hangers connected from the terminal or service to the ceiling system hangers or to the structure above. These wires may be slack.

4.4.3 Air terminals or services weighing more than 56 lb (253 kg) shall be supported directly from the structure above by approved hangers.

4.5 *Partition Application to Suspended Ceilings:*

4.5.1 Where the ceiling system provides lateral support for permanent or relocatable partitions, the connection of the partition to the ceiling system, the ceiling system members and their connections, and the lateral force bracing shall be designed to support the reaction force of the partition from prescribed loads applied perpendicular to the partition. The partition loads shall be in addition to any lateral ceiling loads prescribed by the applicable building code. Partition connections shall be engineered to suit the individual partition application and shall be shown or defined in the drawings or specifications.

## 5. Substantiation

5.1 Each ceiling system manufacturer shall furnish tension and compression force capabilities of main runner splices, cross runner connections, and expansion devices.

5.2 All tests shall be conducted or witnessed by an approved independent testing agency.

## 6. Drawings and Specifications

6.1 The drawings shall clearly identify all systems and shall define or show all supporting details, lighting fixture attachment, lateral force bracing, partition bracing, etc. Such definition may be by reference to the standard, or approved system, in whole or in part. Deviations or variation shall be shown or defined in detail.

## 7. Keywords

7.1 ceiling grid; earthquake; seismic; suspended ceiling

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).*