



## Standard Test Method for Slump of Sealants<sup>1</sup>

This standard is issued under the fixed designation D 2202; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

### 1. Scope

1.1 This test method covers a laboratory procedure for the determination of the degree of slump of a sealant when used in a vertical joint in a structure.

1.2 The values stated in either inch-pound or SI (metric) units are to be separately regarded as the standard. Within the text, the inch-pound units are shown in parentheses.

1.3 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

NOTE 1—A related ISO standard is ISO 7390. The user should compare to determine how it differs from this test method.

### 2. Referenced Documents

2.1 *ASTM Standards:*

C 717 Terminology of Building Seals and Sealants<sup>2</sup>

2.2 *ISO Standards:*<sup>3</sup>

ISO 7390 Building Construction—Sealants—Determination of Resistance to Flow

### 3. Terminology

3.1 *Definitions*—Refer to Terminology C 717 for definitions of the following terms found in this test method: bead, joint, sealant.

### 4. Significance and Use

4.1 Excessive sealant slump or sag in a vertical joint may cause improper bead shape or inadequate sealant thickness in the completed joint. Slump measurements, as described in this test method, serve to evaluate only this application characteristic; they do not predict the performance capability of the sealant after installation.

### 5. Apparatus

5.1 *Flow Test Jig*, constructed in accordance with Fig. 1 (SI

units) or Fig. 2 (inch-pound units).

NOTE 2—Most existing flow test jigs have been constructed in inch-pound units. Preferred construction of new jigs is as described in Fig. 1 in SI units.

5.2 *Gravity Convection Oven*, having a temperature controlled at  $50 \pm 2^\circ\text{C}$  ( $122 \pm 3.6^\circ\text{F}$ ).

5.3 *Steel Spatula*:

5.4 *Plastic Scraper*, such as an ordinary 114 by 114-mm ( $4\frac{1}{2}$  by  $4\frac{1}{2}$ -in.) plastic tile.

### 6. Reagent

6.1 *Solvent*, such as methyl ethyl ketone.

### 7. Sampling

7.1 Take test specimens from a previously unopened container and mix thoroughly before using, if required for homogeneity.

### 8. Conditioning

8.1 Condition both the test jig and the sealant to be tested for at least 5 h at  $23 \pm 2^\circ\text{C}$  ( $73.4 \pm 3.6^\circ\text{F}$ ).

### 9. Procedure

9.1 Thoroughly clean the test jig with the solvent; then place it on a level table with the front face upward and the plunger depressed to the limit of its travel.

9.2 Place the mixed, conditioned sealant in the jig cavity. Level the sealant flush with the surface of the block, using one gentle upward stroke of the plastic scraper held at a  $45^\circ$  angle. Avoid forming air pockets in the sealant, especially near the surface of the plunger.

9.3 Carefully clean the area around the cavity with the plastic scraper and a cloth; then place the jig immediately on its end and advance the plunger gently to one half its maximum travel, or 4.75 mm ( $\frac{3}{16}$  in.). This leaves a solid cylinder of caulking or sealant 38.1 mm ( $1\frac{1}{2}$  in.) in diameter and 4.75 mm ( $\frac{3}{16}$  in.) thick, ready to flow down the face of the instrument.

9.4 Place the jig immediately in a vertical position on a level shelf in the oven and condition it for 30 min at  $50 \pm 2^\circ\text{C}$  ( $122 \pm 3.6^\circ\text{F}$ ), taking care to avoid any movement or vibration of the oven during this period.

9.5 At the conclusion of the 30-min period, take a reading, to the nearest 0.2 mm (0.01 in.) of the maximum point of flow of the compound.

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee C24 on Building Seals and Sealants and is the direct responsibility of Subcommittee C24.20 on General Sealant Standards.

Current edition approved Jan. 10, 2000. Published April 2000. Originally published as D 2202 – 63 T. Last previous edition D 2202 – 93a.

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 04.07.

<sup>3</sup> Available from American National Standards Institute, 11 W. 42nd St., 13th Floor, New York, NY 10036.

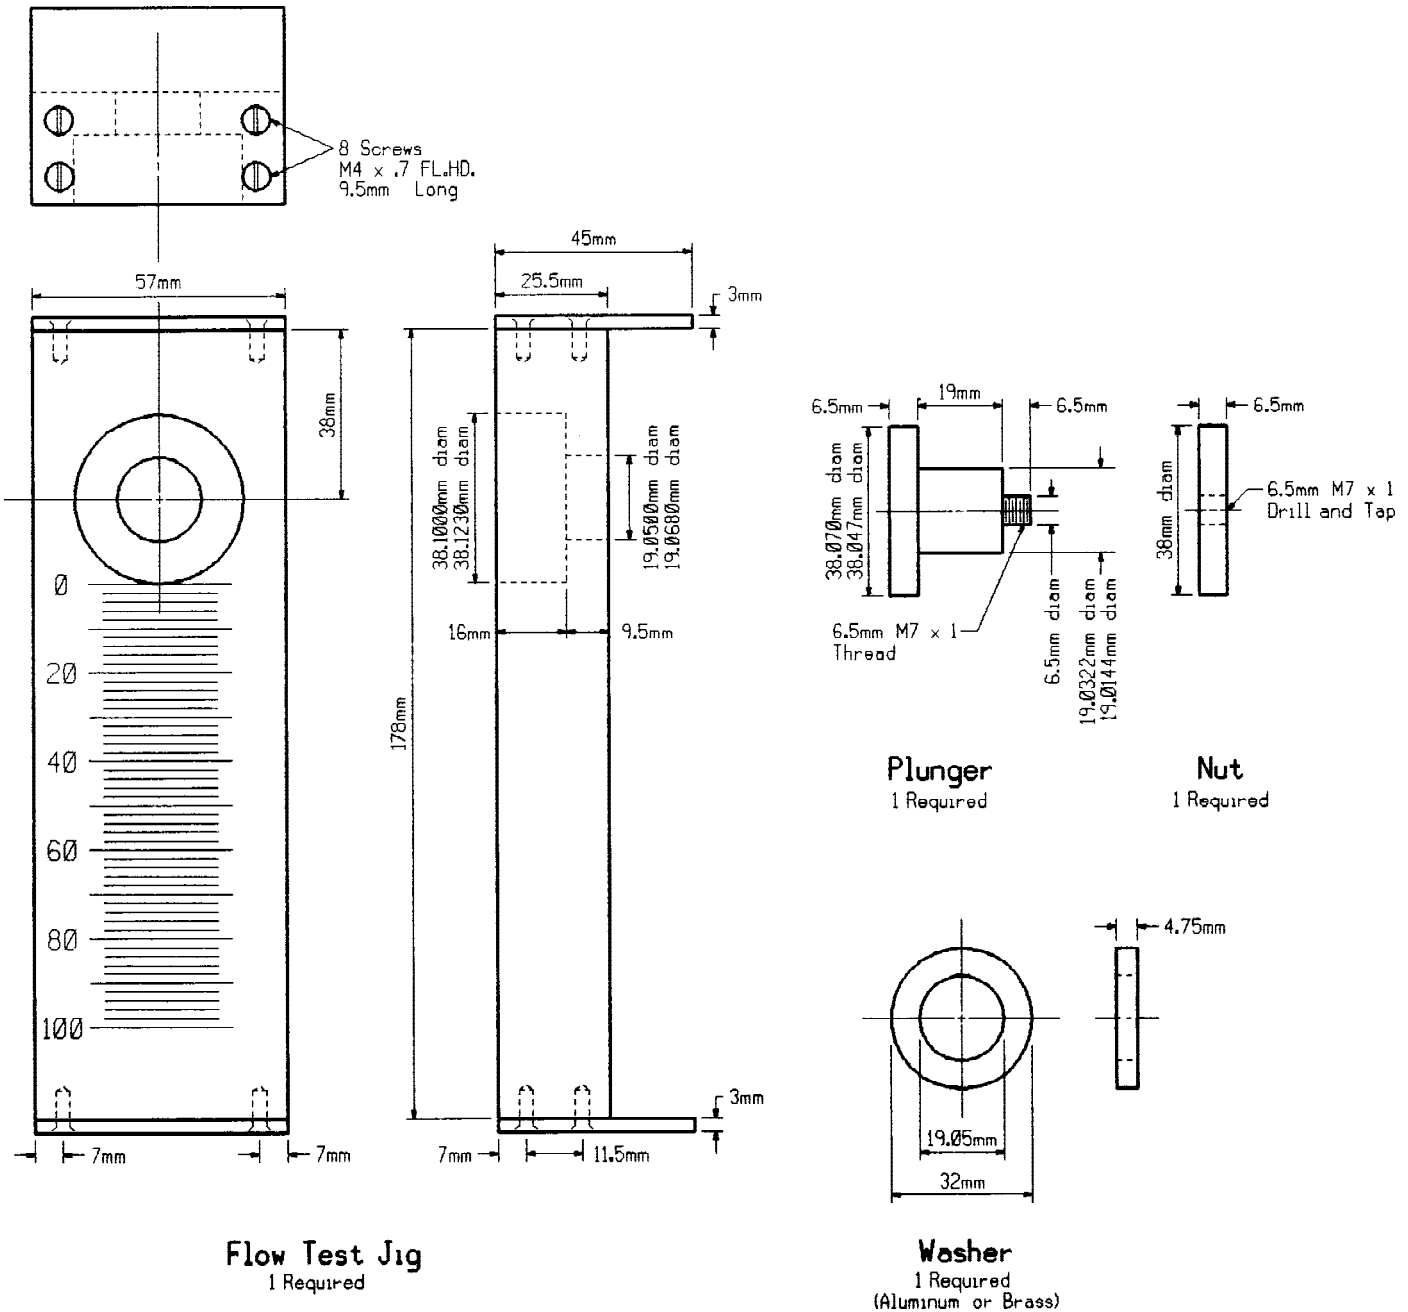


FIG. 1 Flow Test Jig (SI Units)

NOTE 1—For the Flow Test Jig, each scale division equals 2 mm.

NOTE 2— Material, aluminum alloy; finish, liquid hone; tolerances, (0.08 mm) unless otherwise indicated.

- 9.6 Clean the jig and recondition it as specified in 8.1.
- 9.7 Repeat 9.1-9.5 with another specimen of sealant.

**10. Report**

10.1 Report the slump readings obtained in each of two tests for each specimen as well as the average value.

**11. Precision and Bias <sup>4</sup>**


11.1 Precision—The precision statements for this test

method were obtained from two separate inter-laboratory tests. In one, five laboratories tested two (2) oil-based sealants, each in triplicate. The results are given in Table 1. In the other, four laboratories tested four (4) solvent release sealants, each in duplicate.

11.1.1 *Repeatability for Oil-Based Sealants*—At 95 % confidence, a variation of as much as 1.07 mm (0.042 in.) can be expected between two test results obtained by the same operator on the same material.

11.1.2 *Reproducibility for Oil-Based Sealants*—At 95 % confidence, a variation of as much as 1.93 mm (0.076 in.) can

<sup>4</sup> Supporting data are available from ASTM Headquarters. Request RR:C24-1026 and RR: C24-1039.

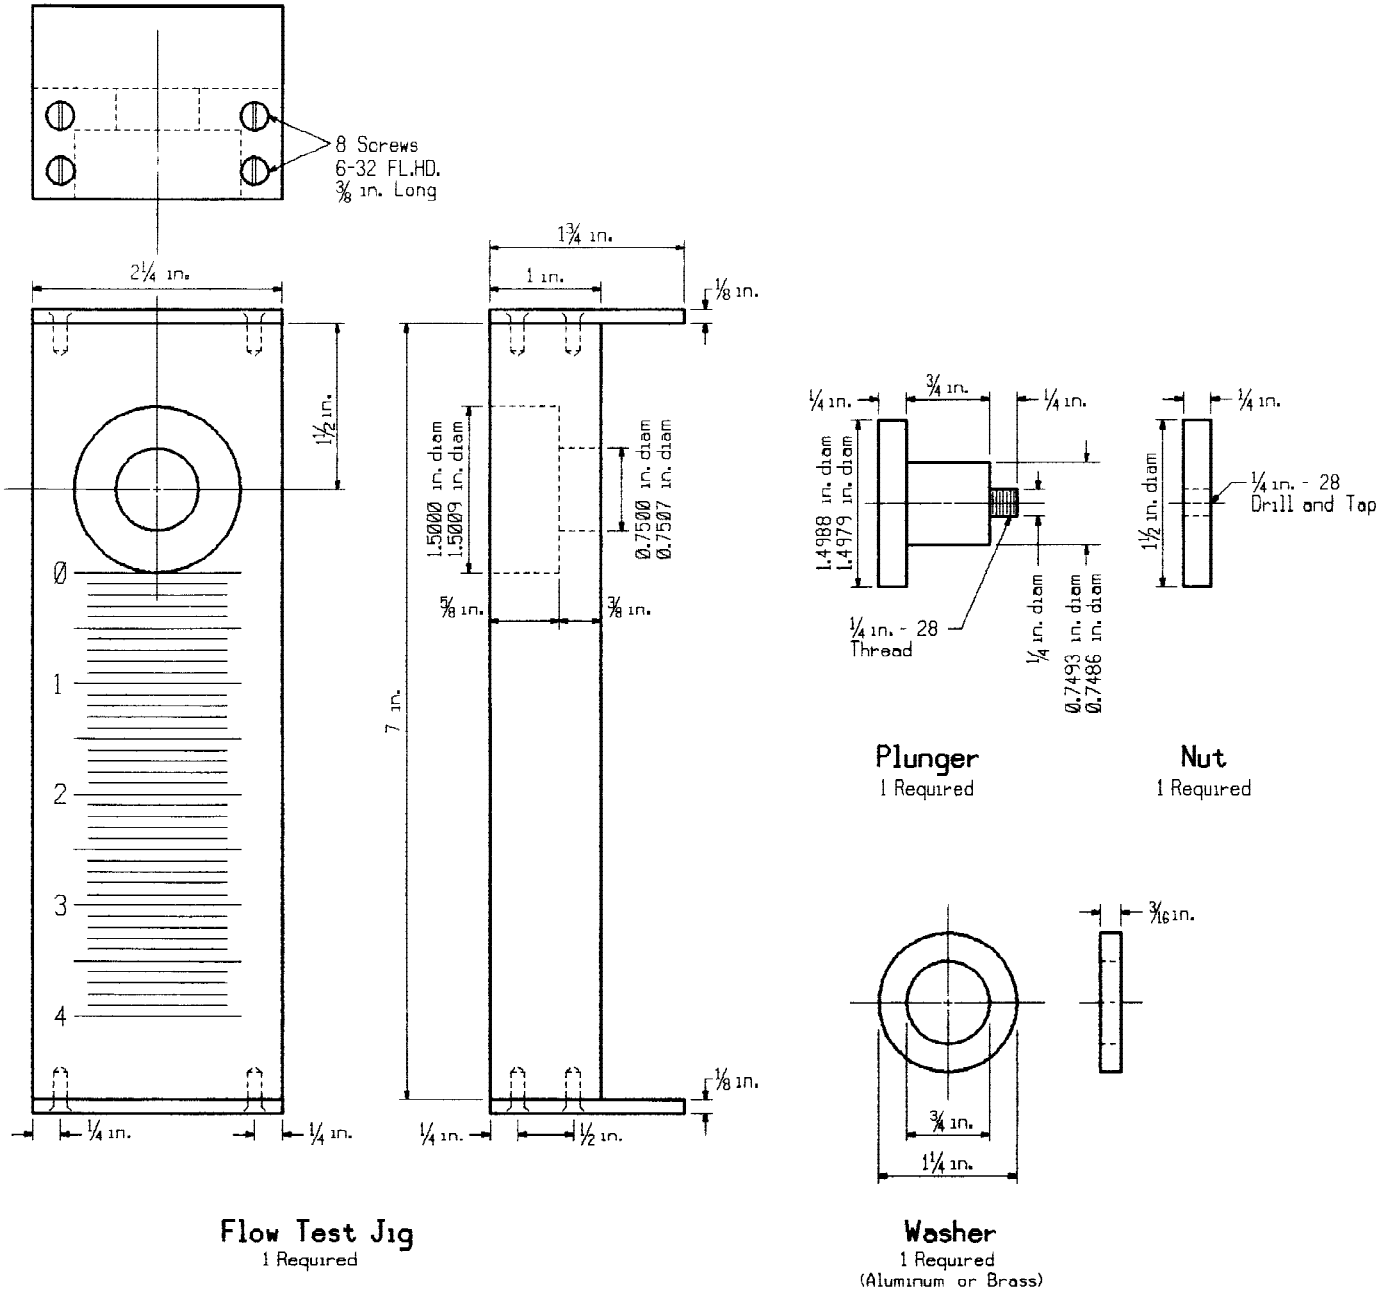

NOTE 1—For the Flow Test Jig, each scale division equals  $\frac{1}{10}$  in.  
 NOTE 2—Material, aluminum alloy; finish, liquid hone; tolerances,  $\pm 0.003$  in. unless otherwise indicated.

FIG. 2 Flow Test Jig (Inch-Pound Units)

TABLE 1 Precision and Bias Data

Material	Average, mm	Estimated Standard Deviation (Within Laboratory)	Estimated Standard Deviation (Between Laboratories)	Repeatability (Internal)	Reproducibility
G 1	0.037	0.006	0.027	0.017	0.076
G 2	0.172	0.015	0.027	0.042	0.076

be expected between two test results obtained by different operators in different laboratories on the same material.

11.1.3 The data for oil based sealants was generated by testing each sealant in triplicate, whereas the procedure in this

test method specifies only duplicate testing. Duplicate testing may yield more variable results than indicated in Table 1.

11.1.4 *Repeatability for Solvent-Release Sealants*—At 95 % confidence, a variation of as much as 1.35 mm (0.053 in.) can be expected between two test results obtained by the same operator on the same material.

11.1.5 *Reproducibility for Solvent Release Sealants*—At 95 % confidence, a variation of as much as 1.88 mm (0.074 in.) can be expected between two test results obtained by different operators in different laboratories on the same material.

11.2 *Bias*—Since there is no accepted reference material

suitable for determining the bias for this test method, bias has not been determined.

## 12. Keywords

12.1 sag; sealant; slump

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or [service@astm.org](mailto:service@astm.org) (e-mail); or through the ASTM website ([www.astm.org](http://www.astm.org)).*