



Designation: D 4737 – 96a

An American National Standard



Designation: 380/98

Standard Test Method for Calculated Cetane Index by Four Variable Equation¹

This standard is issued under the fixed designation D 4737; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope

1.1 The calculated Cetane Index by Four Variable Equation provides a means for estimating the ASTM cetane number of distillate fuels from density and recovery temperature measurements. The value computed from the equation is termed the Calculated Cetane Index by Four Variable Equation.²

1.2 The Calculated Cetane Index by Four Variable Equation is not an optional method for expressing ASTM cetane number. It is a supplementary tool for estimating cetane number when used with due regard for its limitations.

1.3 The test method “Calculated Cetane Index by Four Variable Equation” is particularly applicable to Grade 1-D and Grade 2-D diesel fuel oils containing straight-run and cracked stocks, and blends of the two. It can also be used for heavier fuels with 90 % recovery points less than 382°C and for fuels containing non-petroleum derivatives from tar sands and oil shale.

1.4 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

2. Referenced Documents

2.1 ASTM Standards:

- D 86 Test Method for Distillation of Petroleum Products³
- D 613 Test Method for Cetane Number of Diesel Fuel Oil⁴
- D 1298 Test Method for Density, Relative Density (Specific Gravity), or API Gravity of Crude Petroleum and Liquid Petroleum Products by Hydrometer Method³
- D 4052 Test Method for Density and Relative Density of

Liquids by Digital Density Meter⁵

3. Summary of Test Method

3.1 A correlation in SI units has been established between the ASTM cetane number and the density and 10 %, 50 %, and 90 % recovery temperatures of the fuel. The relationship is given by the following equation:

$$\begin{aligned} \text{CCI} = & 45.2 \\ & + (0.0892)(T_{10N}) \\ & + [0.131 + (0.901)(B)][T_{50N}] \\ & + [0.0523 - (0.420)(B)][T_{90N}] \\ & + [0.00049][(T_{10N})^2 - (T_{90N})^2] \\ & + (107)(B) + (60)(B)^2 \end{aligned} \quad (1)$$

where:

- CCI = Calculated Cetane Index by Four Variable Equation,
- D = Density at 15°C, determined by Test Method D 1298,
- DN = $D - 0.85$,
- B = $[e^{(-3.5)(DN)}] - 1$,
- T₁₀ = 10% recovery temperature, °C, determined by Test Method D 86 and corrected to standard barometric pressure,
- T_{10N} = T₁₀ - 215,
- T₅₀ = 50 % recovery temperature, °C, determined by Test Method 86 and corrected to standard barometric pressure,
- T_{50N} = T₅₀ - 260,
- T₉₀ = 90 % recovery temperature, °C, determined by Test Method D 86 and corrected to standard barometric pressure,
- T_{90N} = T₉₀ - 310.

3.2 The empirical equation for the Calculated Cetane Index by Four Variable Equation was derived using a generalized least squares fitting technique which accounted for measurement errors in the independent variables (fuel properties) as well as in the dependent variable (cetane number by Test Method D 613). The data base consisted of 1229 fuels including; commercial diesel fuels, refinery blending components

¹ This test method is under the jurisdiction of ASTM Committee D-2 on Petroleum Products and Lubricants and is the direct responsibility of Subcommittee D02.E on Burner, Diesel, and Gas Turbine Fuel Oils.

Current edition approved Nov. 10, 1996. Published January 1997. Originally published as D 4737 – 87. Last previous edition D 4737 – 96.

² This method of estimating cetane number was developed by Chevron Research Co. See Ingham, M. C., et al. “Improved Predictive Equations for Cetane Number,” SAE Paper No 860250.

³ Annual Book of ASTM Standards, Vol 05.01.

⁴ Annual Book of ASTM Standards, Vol 05.04.

⁵ Annual Book of ASTM Standards, Vol 05.02.

and non-petroleum fuels derived from tar sands, shale, and coal. The analysis also accounted for bias amongst the individual sets of data comprising the data base.

4. Significance and Use

4.1 The Calculated Cetane Index by Four Variable Equation is useful for estimating ASTM cetane number when a test engine is not available for determining this property directly. It may be conveniently employed for estimating cetane number when the quantity of sample available is too small for an engine rating. In cases where the ASTM cetane number of a fuel has been previously established, the Calculated Cetane Index by Four Variable Equation is useful as a cetane number check on subsequent samples of that fuel, provided the fuel's source and mode of manufacture remain unchanged.

4.2 Within the range from 32.5 to 56.5 cetane number, the expected error of prediction of the Calculated Cetane Index by Four Variable Equation will be less than ± 2 cetane numbers for 65 % of the distillate fuels evaluated. Errors may be greater for fuels whose properties fall outside the recommended range of application.

5. Procedure

5.1 Determine the density of the fuel at 15°C to the nearest 0.0001 kg/L, as described in Test Method D 1298 or Test Method D 4052.


5.2 Determine the 10 %, 50 %, and 90 % recovery temperatures of the fuel to the nearest 1°C, as described in Test Method D 86.

6. Calculation or Interpretation of Results

6.1 Compute the Calculated Cetane Index by Four Variable Equation using the equation given in 3.1. The calculation is more easily performed using a computer or programmable hand calculator. Round the value obtained to the nearest one-tenth.


6.1.1 Calculated Cetane Index by Four Variable Equation can also be easily determined by means of the nomographs appearing in Figs. 1-3. Fig. 1 is used to estimate the cetane number of a fuel based on its density at 15°C and its 50 % recovery temperature. Fig. 2 is used to determine a correction for the estimate from Fig. 1 to account for deviations in the density and the 90 % recovery temperature of the fuel from average values. Fig. 3 is used to determine a second correction for the estimate from Fig. 1 to account for deviations in the 10 % and the 90 % recovery temperatures of the fuel from average values. The corrections determined from Fig. 2 and Fig. 3 are summed algebraically with the cetane number estimate from Fig. 1 to find the Calculated Cetane Index by Four Variable Equation. The method of using these nomographs is indicated by the illustrative example shown below and on Figs. 1-3.

Part 1 – Estimate Based on Density and D 86 50% Recovery Temperature

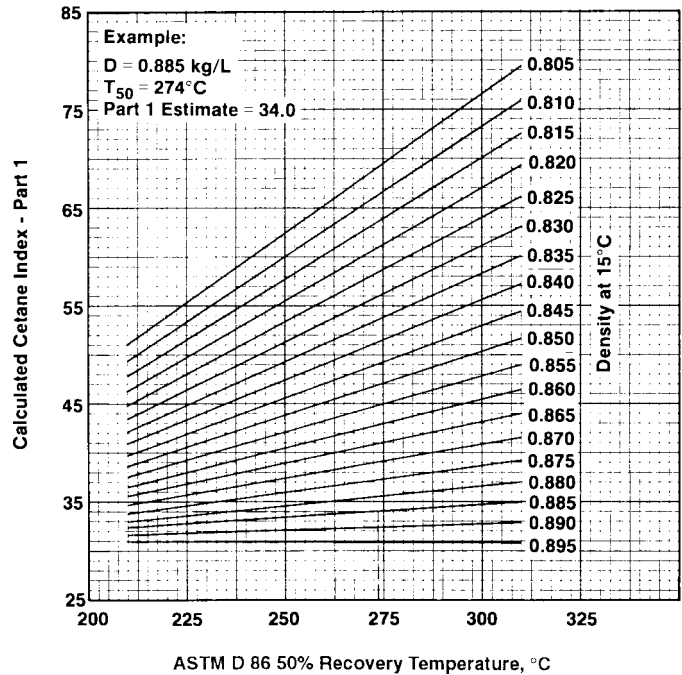


ASTM D 86 50% Recovery Temperature, °C
FIG. 1 Calculated Cetane Index

Part 2 – Correction for Deviations in Density and D 86 90% Recovery Temperature from Average Values

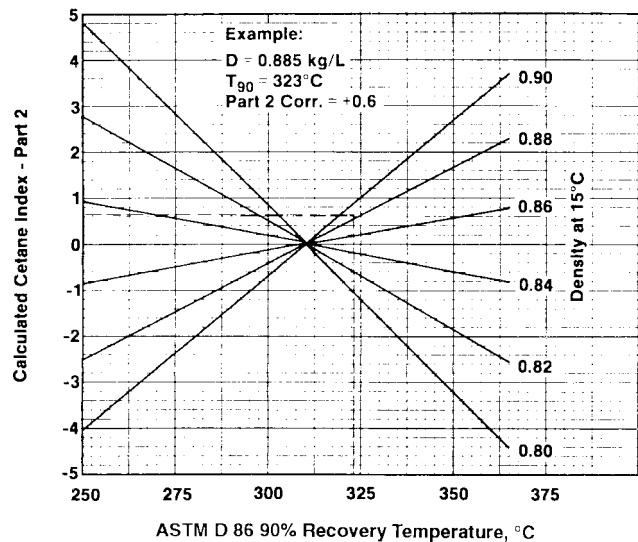

ASTM D 86 90% Recovery Temperature, °C
FIG. 2 Calculated Cetane Index

Part 3 – Correction for Deviations in D 86 10% and 90% Recovery Temperatures from Average Values

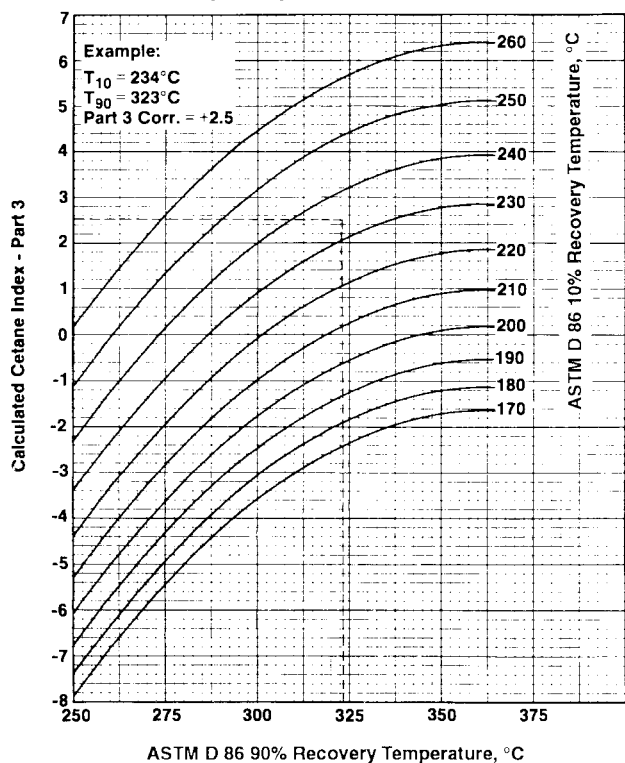

Estimate from Fig. 1	34.0
Correction from Fig. 2	+0.6
Correction from Fig. 3	+2.5
	CCI = 37.1

6.2 The Calculated Cetane Index by Four Variable Equation possesses certain inherent limitations which must be recognized in its application. These are as follows:

6.2.1 It is not applicable to fuels containing additives for raising the cetane number.

6.2.2 It is not applicable to pure hydrocarbons, nor to non-petroleum fuels derived from coal.

6.2.3 Substantial inaccuracies in correlation may occur if the equation is applied to residual fuels or crude oils.

7. Precision and Bias

7.1 The determination of Calculated Cetane Index by Four Variable Equation from measured density at 15°C and measured 10 %, 50 % and 90 % recovery temperatures is exact.

7.2 *Precision*—The precision of the Calculated Cetane Index by Four Variable Equation is dependent on the precision of the original density and recovery temperature determinations which enter into the calculation. Test Method D 1298 has a stated repeatability limit of 0.0006 kg/L and a stated reproducibility limit of 0.0015 kg/L at 15°C. Test Method D 86 has stated repeatability and reproducibility limits which vary with the rate of change of recovery temperature. See Figs. 2 through 7 and Tables 7 through 10 of Test Method D 86 for details.

7.3 *Bias*—No general statement is made on bias of this test method since a comparison with accepted reference values is not available.

8. Keywords

8.1 cetane; cetane index; diesel fuel

Measured Fuel Properties	
Test Method D 613 Cetane Number	37.0
Test Method D 1298 Density at 15°C, kg/L	0.885
Test Method D 86 10 % Recovery Temperature, °C	234
Test Method D 86 50 % Recovery Temperature, °C	274
Test Method D 86 90 % Recovery Temperature, °C	323
Calculated Cetane Index	

The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).