



## **Standard Specification for Joints for IPS PVC Pipe Using Solvent Cement<sup>1</sup>**

This standard is issued under the fixed designation D 2672; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

*This standard has been approved for use by agencies of the Department of Defense.*

### **1. Scope**

1.1 This specification covers the socket produced for solvent cement joints on both pressure and non-pressure IPS pipe. It also covers the testing of the joints on both pressure and non-pressure pipe, and includes requirements for socket dimensions, burst pressure, and joint tightness tests of the solvent cemented joints. The tests described are not intended for routine quality control, but rather to evaluate the performance characteristics of the joint.

NOTE 1—On dual marked Schedule 40 DWV and potable water pipe, the socket bells must conform to the dimensional and physical requirements for pressure socket bells.

1.2 The text of this specification references notes, footnotes, and appendixes which provide explanatory material. These notes and footnotes (excluding those in tables and figures) shall not be considered as requirements of the specification.

1.3 The values stated in inch-pound units are to be regarded as the standard. The values given in parentheses are for information only.

NOTE 2—Changes in ground, water, or air temperature will produce expansion or contraction forces in PVC piping, and these will result in longitudinal shear stresses in the solvent cement joints. These stresses must be considered in the design and operation of the system.

NOTE 3—See Practice D 618 for information relating to this specification.

1.4 The following safety hazards caveat pertains only to the test method portion, Section 10, of this specification. *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

### **2. Referenced Documents**

#### **2.1 ASTM Standards:**

- D 618 Practice for Conditioning Plastics for Testing<sup>2</sup>
- D 1599 Test Method for Short-Time Hydraulic Failure Pressure of Plastic Pipe, Tubing, and Fittings<sup>3</sup>
- D 1600 Terminology for Abbreviated Terms Relating to Plastics<sup>2</sup>
- D 1785 Specification for Poly(Vinyl Chloride) (PVC) Plastic Pipe, Schedules 40, 80, and 120<sup>3</sup>
- D 2122 Test Method for Determining Dimensions of Thermoplastic Pipe and Fittings<sup>3</sup>
- D 2241 Specification for Poly(Vinyl Chloride) (PVC) Pressure-Rated Pipe (SDR Series)<sup>3</sup>
- D 2564 Specification for Solvent Cements for Poly(Vinyl Chloride) (PVC) Plastic Piping Systems<sup>3</sup>
- D 2665 Specification for Poly(Vinyl Chloride) (PVC) Plastic Drain, Waste and Vent Pipe and Fittings<sup>3</sup>
- D 2855 Practice for Making Solvent-Cemented Joints with Poly(Vinyl Chloride) (PVC) Pipe and Fittings<sup>3</sup>
- F 412 Terminology Relating to Plastic Piping Systems<sup>3</sup>
- F 512 Specification for Smooth-Wall Poly(Vinyl Chloride) (PVC) Conduit and Fittings for Underground Installation<sup>3</sup>
- F 656 Specification for Primers for Use in Solvent Cement Joints of Poly(Vinyl Chloride) (PVC) Plastic Pipe and Fittings<sup>3</sup>

#### **2.2 NSF Standard:**

Standard No. 14 for Plastic Piping Components and Related Materials<sup>4</sup>

### **3. Terminology**

3.1 Definitions—Definitions are in accordance with Terminology F 412 and abbreviations are in accordance with Terminology D 1600, unless otherwise specified.

### **4. Materials**

4.1 *General*—PVC plastics used to make the pipe, which are belled under this specification, are designated in PVC product standards referencing this standard.

4.2 Solvent cements must conform to the requirements of Specification D 2564.

<sup>1</sup> This specification is under the jurisdiction of ASTM Committee F-17 on Plastic Piping Systems and is the direct responsibility of Subcommittee F17.20 on Joining.

Current edition approved Sept. 10, 1996. Published November 1996. Originally published as D 2672 – 68. Last previous edition D 2672 – 96.

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 08.01.

<sup>3</sup> *Annual Book of ASTM Standards*, Vol 08.04.

<sup>4</sup> Available from the National Sanitation Foundation, P.O. Box 1468, Ann Arbor, MI 48106.

4.3 Primers must conform to the requirements of Specification F 656.

**5. Requirements**

5.1 *Bell Socket Dimensions and Tolerances:*

5.1.1 *Diameters and Length*—The diameter, lengths, and tolerances of the bell sockets shall be as shown in Table 1 when measured in accordance with Test Method D 2122.

5.1.2 *Wall Thicknesses*—The minimum wall thicknesses of the sockets (bell) shall not be less than 90 % of the minimums shown for the pressure pipe in the applicable ASTM specification. For non-pressure pipe, the integral socket (bell) shall be considered satisfactory when formed from pipe which meets the minimum wall thickness requirements of the applicable ASTM specification when measured in accordance with Test Method D 2122.

5.2 *Joint Tests:*

5.2.1 *Burst Pressure*—The minimum burst pressures for pipe and (bell) socket on pressure pipe shall be as given for pressure pipe in the applicable ASTM specification when

determined in accordance with 10.3.

5.2.2 *Joint Tightness*—The (bell) socket joint on non-pressure pipe shall not leak when tested in accordance with 10.4.


**6. Workmanship**

6.1 Each socket (bell) is required to be uniform in depth, circular in cross section concentric with the pipe, and to have an end as square as commercially practicable.

**7. Retest and Rejection**

7.1 If the results of any test(s) do not meet the requirements of this specification, the test(s) shall be conducted again only by agreement between the purchaser and the seller. Under such agreement, minimum requirements shall not be lowered, nor tests omitted, substituted, changed, or modified, nor shall specification limits be changed. If upon retest, failure occurs, the quantity of product represented by the test(s) does not meet the requirements of this specification.

**TABLE 1 Tapered Sockets for Bell-End Pipe, in. (mm)**

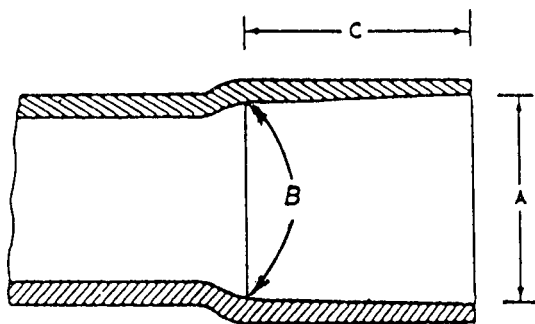

Pipe Size, in.	A Socket Entrance Diameter, in. (mm)			B Socket Bottom Diameter, in. (mm)			C Socket Length, in. (mm), min <sup>A</sup>	
	Nominal Diameter	Tolerance on Nominal Diameter	Maximum Out-of- Round <sup>B</sup>	Nominal Diameter	Tolerance on Nominal Diameter	Maximum Out-of- Round <sup>B</sup>	Pressure	Non-Pres- sure <sup>C</sup>
1/8	0.417 (10.59)	±0.004 (±0.10)	0.024 (0.61)	0.401 (10.18)	±0.004 (±0.10)	0.024 (0.61)	0.500 (12.70)	...
1/4	0.552 (14.02)	±0.004 (±0.10)	0.024 (0.61)	0.536 (13.61)	±0.004 (±0.10)	0.024 (0.61)	0.500 (12.70)	...
3/8	0.687 (17.45)	±0.004 (±0.10)	0.024 (0.61)	0.671 (17.04)	±0.004 (±0.10)	0.024 (0.61)	0.750 (19.05)	...
1/2	0.848 (21.54)	±0.004 (±0.10)	0.024 (0.61)	0.836 (21.23)	±0.004 (±0.10)	0.024 (0.61)	1.000 (25.40)	1.000 (25.40)
3/4	1.058 (26.87)	±0.004 (±0.10)	0.028 (0.71)	1.046 (26.57)	±0.004 (±0.10)	0.028 (0.71)	1.250 (31.75)	1.000 (25.40)
1	1.325 (33.65)	±0.005 (±0.13)	0.030 (0.76)	1.310 (33.27)	±0.005 (±0.13)	0.030 (0.76)	1.500 (38.10)	1.000 (25.40)
1 1/4	1.670 (42.42)	±0.005 (±0.13)	0.034 (0.86)	1.655 (42.04)	±0.005 (±0.13)	0.034 (0.86)	1.750 (44.45)	1.250 (31.75)
1 1/2	1.912 (48.56)	±0.006 (±0.15)	0.036 (0.91)	1.894 (48.11)	±0.006 (±0.15)	0.036 (0.91)	2.000 (50.80)	1.375 (34.92)
2	2.387 (60.63)	±0.006 (±0.15)	0.036 (0.91)	2.363 (60.02)	±0.006 (±0.15)	0.036 (0.91)	2.250 (57.15)	1.750 (44.45)
2 1/2	2.889 (73.38)	±0.007 (±0.18)	0.044 (1.12)	2.861 (72.67)	±0.007 (±0.18)	0.044 (1.12)	2.500 (63.50)	2.000 (50.80)
3	3.516 (89.31)	±0.008 (±0.20)	0.046 (1.17)	3.484 (88.49)	±0.008 (±0.20)	0.046 (1.17)	3.250 (82.55)	2.875 (73.02)
3 1/2	4.016 (102.01)	±0.008 (±0.20)	0.046 (1.17)	3.984 (101.19)	±0.008 (±0.20)	0.046 (1.17)	3.500 (88.90)	3.125 (79.37)
4	4.518 (114.76)	±0.009 (±0.23)	0.048 (1.22)	4.482 (113.84)	±0.009 (±0.23)	0.048 (1.22)	4.000 (101.60)	3.375 (85.72)
5	5.583 (141.81)	±0.010 (±0.25)	0.080 (2.03)	5.543 (140.79)	±0.010 (±0.25)	0.080 (2.03)	4.000 (101.60)	4.000 (101.60)
6	6.647 (168.83)	±0.011 (±0.28)	0.082 (2.08)	6.603 (167.72)	±0.011 (±0.28)	0.082 (2.08)	6.000 (152.40)	5.000 (127.00)
8	8.655 (219.84)	±0.015 (±0.38)	0.120 (3.05)	8.598 (218.39)	±0.015 (±0.38)	0.120 (3.05)	6.000 (152.40)	5.000 (127.00)
10	10.776 (273.71)	±0.015 (±0.38)	0.130 (3.30)	10.722 (272.34)	±0.015 (±0.38)	0.130 (3.30)	7.500 (190.50)	6.500 (165.10)
12	12.778 (324.56)	±0.015 (±0.38)	0.150 (3.81)	12.721 (323.11)	±0.015 (±0.38)	0.150 (3.81)	8.500 (215.90)	7.500 (190.50)
14	14.035 (356.49)	±0.015 (±0.38)	0.150 (3.81)	13.985 (355.22)	±0.015 (±0.38)	0.150 (3.81)	9.000 (228.60)	8.000 (203.20)
16	16.045 (410.08)	±0.015 (±0.38)	0.160 (4.06)	15.980 (405.89)	±0.015 (±0.38)	0.160 (4.06)	10.000 (254.00)	9.000 (228.60)
18	18.055 (458.60)	±0.020 (±0.51)	0.180 (4.57)	17.980 (456.69)	±0.020 (±0.51)	0.180 (4.57)	12.000 (304.80)	10.000 (254.00)
20	20.065 (509.65)	±0.025 (±0.64)	0.200 (5.08)	19.980 (507.49)	±0.025 (±0.64)	0.200 (5.08)	12.000 (304.80)	11.000 (279.40)
24	24.075 (611.51)	±0.030 (±0.76)	0.240 (6.10)	23.970 (608.84)	±0.030 (±0.76)	0.240 (6.10)	12.000 (304.80)	12.000 (304.80)

<sup>A</sup>All tolerances on minimum dimensions shall be on the plus side.

<sup>B</sup>"Out-of-round" is defined as the maximum measured diameter less the minimum measured diameter.

<sup>C</sup>Maximum length = +0.250 in. (6.350 mm).



## D 2672

### 8. Sampling and Test Specimens

8.1 Take at random a sample of the pipe with (bell) socket sufficient to determine conformance with this specification.

8.1.1 The test specimens for any pressure test shall have at least a part of the marking in their central sections. The central section is that portion of pipe which is at least one pipe diameter away from an end closure.

8.1.2 *Dry Fit of Joint*—Manually insert a chamfered or deburred pipe spigot into the socket (bell). There must be an interference between the spigot and bell after inserting the spigot one third to two thirds of socket (bell) depth.

### 9. Conditioning

9.1 Condition the test specimens at  $23 \pm 2^{\circ}\text{C}$  ( $73.4 \pm 3.6^{\circ}\text{F}$ ) and  $50 \pm 5\%$  relative humidity for not less than 40 h prior to test in accordance with Procedure A of Practice D 618, for those tests requiring conditioning.

### 10. Test Methods

10.1 *Test Conditions*—Conduct the tests in the Standard Laboratory Atmosphere of  $23 \pm 2^{\circ}\text{C}$  and  $50 \pm 5\%$  relative humidity, unless otherwise specified in Practice D 618 or in this specification.

10.2 *Socket Joint Assembly*—Assemble the socket joint per Practice D 2855, and condition at  $23^{\circ}\text{C}$  ( $73.4^{\circ}\text{F}$ ) for a minimum of 48 h.

10.3 *Burst Pressure Test of Joint Assembly*—Determine the burst pressure of one specimen in accordance with Test Method D 1599. The assembled socket (bell) joint shall be within the middle 30 % of the overall specimen length. The time to failure of the specimen shall be between 60 and 70 s.

10.4 *Socket Joint Tightness Test*—Subject the assembly to an internal pressure of 170 kPa (25 psi) using water as the test medium. Maintain this pressure for at least 1 h. There shall be no leakage.

### 11. Marking and Quality Assurance

11.1 When pipe, made in accordance with Specifications D 1785, D 2241, D 2665 and F 512 is marked with ASTM designation D 2672, in addition to the pipe standard, it affirms that the sockets (bell) were manufactured, inspected, sampled, and tested in accordance with this specification and have been found to meet the requirements of this specification. However, the designation marking, D 2672, is not required.

## APPENDIX

### (Nonmandatory Information)

#### X1. SOLVENT CEMENTING JOINTS 10 IN. AND LARGER

X1.1 If it is necessary, cut the pipe to length, making sure the cut is square. Chamfer cut ends and remove all burrs.

X1.2 Examine bell and pipe end for damage before cementing joint.

X1.3 Clean the mating surfaces of the pipe and fitting to remove dirt and foreign matter immediately before proceeding to the next step. Mark the pipe end with a bell depth line which will show when full penetration has been achieved.

X1.4 Check the dry fit of pipe in bell. This is critical on larger sizes because tolerances increase as the diameters increase. If a slightly loose fit occurs, apply a second coat of cement to the pipe end before assembly.

X1.5 Prepare the joining surfaces by applying an approved primer. The surfaces are softened by this process. The primer takes longer to penetrate the surfaces at lower temperatures. Below  $40^{\circ}\text{F}$ , it may take three to four times as long to get good surface penetration. Penetration is satisfactory when 2 to 5 mils can be scraped from the surface. The interior surface of the bell should be given special attention because some silicone release agent residue may be present.

X1.6 Immediately after priming, apply the solvent cement using a wide bristle paint brush or a roller. Apply a heavy coat of solvent cement to the pipe end, and a light coat to the inside

of the bell. *Both mating surfaces should be completely covered.* Apply sufficient cement to the mating surfaces to fill the gap between the pipe and the bell. If there are no finished surfaces below the joint, the cement may be poured on the pipe surface and inside the bell and spread with a brush. Use an extra-heavy-bodied cement to extend the working time when elevated temperature and low humidity conditions exist.

X1.7 The pipe must immediately be pushed into the bell while the (cement) surfaces are still wet. Two operators are needed to simultaneously apply primer and cement, and subsequently push the pipe into the bell. The force is provided by using a bar and wood plank. Alternatively, one or two “come-alongs” or lever pullers may be used, but sufficient chain with a choker strap must be laid out on either side of the joint before the cement is applied. Immediately after the primer and cement are applied, the “come-alongs” must be hooked up, and the joint is pulled together.

X1.8 The new assembly must be held in place with the assembly apparatus for 1 to 2 min (depending on size and degree of interference) to permit the handling set to occur. The handling set must be completed before starting on the next joint. Handling set has been attained when there is no evidence of joint push out after the holding force is released.

X1.9 Before subjecting the joint to installation stresses such as realignment to adjust slope, or bending, allow for initial set. See initial set times recommended in Table X1.1.



**TABLE X1.1 Initial Set Time, h**

NOTE 1—After initial set, the joint will withstand the stresses of a normal installation.

Temperature Range During Initial Set Time, °F	Pipe Sizes, in.	
	10 to 14	16 to 24
60 to 100	2	4
40 to 60	8	16
0 to 40	24	48

X1.10 Allow the joint to cure for the times recommended in Table X1.2 before filling the line for test, or placing it in service.

NOTE X1.1—Other joint systems are available for use when weather

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).*

**TABLE X1.2 Joint Cure Time, h**

Relative Humidity 60 % or Less <sup>A</sup>	Pipe Sizes (in.)	
	10 to 14	16 to 24
Temperature Range During Assembly Cure Periods, °F	Maximum Test Pressure	
	180 psi	100 psi
60 to 100	24 h	48–72 h
40 to 60	72 h	5 days
0 to 40	8 days	10–14 days

<sup>A</sup>In damp or humid weather allow 50 % more cure time.

and installation conditions make the solvent cementing of larger size PVC pipe very difficult.

NOTE X1.2—Also refer to Practice D 2855.