



Standard Specification for Rigid Poly(Vinyl Chloride) (PVC) Siding¹

This standard is issued under the fixed designation D 3679; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

1. Scope *

1.1 This specification establishes requirements and test methods for the materials, dimensions, warp, shrinkage, impact strength, expansion, appearance, and windload resistance of extruded single-wall siding manufactured from rigid (unplasticized) PVC compound. Methods of indicating compliance with this specification are also provided.

1.2 Rigid PVC recycled plastic may be used in this product in accordance with the requirements in Section 4.

1.3 Nonmandatory color-hold guidelines are provided in Appendix X1 for manufacturer's product development and quality performance use only.

1.4 Rigid (unplasticized) PVC soffit is covered in Specification D 4477.

1.5 Siding produced to this specification shall be installed in accordance with Practice D 4756. Reference shall also be made to the manufacturer's installation instructions for the specific product to be installed.

NOTE 1—Information with regard to siding maintenance shall be obtained from the manufacturer.

NOTE 2—Siding color-hold guidelines are for dark gray-blue, light-gray blue, green, dark beige, light beige, gold, yellow, white, and gray regions. Additional colors will be added and color-hold guidelines refined as weathering program data is developed.²

1.6 The values stated in inch-pound units are to be regarded as the standard. The SI units given in parentheses are for information purposes only.

1.7 The following precautionary caveat pertains to the test method portion only, Section 6, of this specification: *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

NOTE 3—There are no ISO standards covering the primary subject matter of this specification.

2. Referenced Documents

2.1 ASTM Standards:

- D 256 Test Methods for Determining the Izod Pendulum Impact Resistance of Plastics³
- D 374 Test Methods for Thickness of Solid Electrical Insulation⁴
- D 523 Test Method for Specular Gloss⁵
- D 618 Practice for Conditioning Plastics for Testing³
- D 635 Test Method for Rate of Burning and/or Extent and Time of Burning of Self-Supporting Plastics in a Horizontal Position³
- D 696 Test Method for Coefficient of Linear Expansion of Plastics Between -30°C and 30°C³
- D 883 Terminology Relating to Plastics³
- D 1042 Test Method for Linear Dimensional Changes of Plastics Under Accelerated Service Conditions³
- D 1435 Practice for Outdoor Weathering of Plastics³
- D 1600 Terminology for Abbreviated Terms Relating to Plastics³
- D 1898 Practice for Sampling of Plastics³
- D 2244 Test Method for Calculation of Color Differences from Instrumentally Measured Color Coordinates⁵
- D 3892 Practice for Packaging/Packing of Plastics⁶
- D 4216 Specification for Rigid Poly(Vinyl Chloride) (PVC) and Related PVC and Chlorinated Poly(Vinyl Chloride) (CPVC) Building Products⁷
- D 4226 Test Methods for Impact Resistance of Rigid Poly(Vinyl Chloride) (PVC) Building Products⁸
- D 4477 Specification for Rigid (Unplasticized) Poly(Vinyl Chloride) (PVC) Soffit⁸
- D 4756 Practice for the Installation of Rigid Poly(Vinyl Chloride) (PVC) Siding and Soffit⁸
- D 5033 Guide for the Development of Standards Relating to the Proper Use of Recycled Plastics⁶
- D 5206 Test Method for the Windload Resistance of Rigid Poly(Vinyl Chloride) (PVC) Siding⁸
- E 631 Terminology of Building Construction⁹

¹ This specification is under the jurisdiction of ASTM Committee D20 on Plastics and is the direct responsibility of Subcommittee D20.24 on Plastic Building Products.

Current edition approved June 10, 2001. Published August 2001. Originally published as D 3679 – 79. Last previous edition D 3679 – 01.

² Refer to ASTM Research Report RR:D20-1144. Available from ASTM Headquarters.

³ *Annual Book of ASTM Standards*, Vol 08.01.

⁴ *Annual Book of ASTM Standards*, Vol 10.01.

⁵ *Annual Book of ASTM Standards*, Vol 06.01.

⁶ *Annual Book of ASTM Standards*, Vol 08.03.

⁷ *Annual Book of ASTM Standards*, Vol 08.02.

⁸ *Annual Book of ASTM Standards*, Vol 08.04.

⁹ *Annual Book of ASTM Standards*, Vol 04.11.

***A Summary of Changes section appears at the end of this standard.**

E 805 Practice for Identification of Instrumental Methods of Color or Color-Difference Measurement of Materials⁵

2.2 *ASCE Standard:*

ASCE 7-98 Minimum Design Loads for Buildings and Other Structures¹⁰

3. Terminology

3.1 Definitions are in accordance with Terminologies D 883, E 631, and D 1600, unless otherwise specified.

3.2 *Definitions of Terms Specific to This Standard:*

3.2.1 *color-hold guidelines*—predictive target color regions within a three-dimensional model which constitute acceptable appearance retention levels of color change resulting from weathering of a specific product type and color.

3.2.2 *Discussion*—Commercial products that demonstrate weathering behavior within reasonable conformance to these target guidelines during a two-year test period can be anticipated to weather without exhibiting unacceptable color changes.

3.2.3 *dark beige siding*—siding the color of which is defined by the color space falling within the parameters $L_H = 50$ to 75, $a_H = -3$ to 4, and $b_H = 5$ to 18.

3.2.4 *dark gray-blue siding*—siding the color of which is defined by the color space falling within the parameters $L_H = 45$ to 65, $a_H = -7$ to 0, and $b_H = -10$ to 0.

3.2.5 *gold siding*—siding the color of which is defined by the color space falling within the parameters $L_H = 65$ to 100, $a_H = -5$ to 3, and $b_H = 18$ to 30.

3.2.6 *gray siding*—siding the color of which is defined by the color space falling within the parameters $L_H = 65$ to 85, $a_H = -3$ to 1, and $b_H = -3$ to 2.

3.2.7 *green siding*—siding the color of which is defined by the color space falling within the parameters $L_H = 55.6$ to 80.5, $a_H = -12$ to -3 , and $b_H = 4$ to 13.

3.2.8 *light beige siding*—siding the color of which is defined by the color space falling within the parameters $L_H = 75$ to 100, $a_H = -3$ to 4, and $b_H = 5$ to 18.

3.2.9 *light gray-blue siding*—siding the color of which is defined by the color space falling within the parameters $L_H = 65$ to 100, $a_H = -7$ to 0, and $b_H = -10$ to -3 .

3.2.10 *temperate northern climate*— *in weather testing*, a North American metropolitan area testing site located within 73 to 100°W longitude and 37 to 45°N latitude.

3.2.11 *vinyl siding*—a shaped material, made principally from rigid poly(vinyl chloride) (PVC), that is used to clad exterior walls of buildings.

3.2.12 *Discussion*—Any exception to a homogeneous rigid PVC compound is present in a coextruded or laminated capstock.

3.2.13 *white siding*—siding the color of which is defined by the color space falling within the parameters $L_H = 85$ to 100, $a_H = 2$ to -3 , and $b_H = -2$ to 4.

3.2.14 *yellow siding*—siding the color of which is defined by the color space falling within the parameters $L_H = 65$ to 100, $a_H = -10$ to -5 , and $b_H = 13$ to 24.

4. Materials and Manufacture

4.1 The siding shall be made principally of PVC compound prepared from PVC homopolymer resin that conforms to the requirements for Class 1, 2, or 3 (see Table 1).

4.2 Rigid PVC recycled plastic, as defined in Guide D 5033, may be used in this product if all the requirements in the sections on Terminology (Section 3), on Materials and Manufacture (Section 4), and on Physical Requirements (Section 5) are met by the siding containing rigid PVC recycled plastic.

4.3 All specimen-preparation procedures and test conditions shall be the same as indicated in the Specimen Preparation and Test Methods sections of Specification D 4216.

4.4 The compound shall have a minimum Izod impact strength of 0.65 ft·lbf/in. (34.7 J/m) notch at 0°C (32°F) when tested in accordance with Test Method D 256.

4.5 The poly(vinyl chloride) compound, when tested in accordance with Test Method D 635, shall not exceed an average extent of burn of 4 in. (100 mm), with an average time of burn not to exceed 10 s. A sample thickness of 0.040 in. (1 mm) $\pm 10\%$ is required.

NOTE 4—The flammability testing data, conclusions, and recommendations of Test Method D 635 related solely to the measurement and description of properties for classification of the poly(vinyl chloride) compound in response to flame under controlled laboratory conditions and shall not be used for the description or appraisal of the fire hazard of vinyl siding under actual fire conditions.

4.6 The PVC compound when extruded into siding shall maintain uniform color and be free of any visual surface or structural changes, such as peeling, chipping, cracking, flaking, or pitting.

4.7 The PVC compound shall be compounded so as to provide the heat stability and weather exposure stability required for the siding market application.

5. Physical Requirements

5.1 *Length and Width*—The nominal length and width of the siding shall be as agreed upon between the purchaser and the seller. The actual length shall not be less than ¼ in. (6.4 mm) of the nominal length and the actual width shall be within $\pm 1/16$ in. (1.6 mm) of the nominal width when measured in

TABLE 1 Class Requirements for Rigid Poly(Vinyl Chloride) Compounds Used for Siding

NOTE 1—The minimum property test value will determine the class number, even though other higher property test values may fall within another class.

Compound Class Number	1	2	3
Izod Impact Strength at 73.4°F (23°C), min:			
ft·lbf/in. of notch	1.5	2.4	9.9
(J/m of notch)	(80.0)	(130.0)	(530)
Tensile Strength, min:			
psi	6970	5800	5510
(MPa)	(48.0)	(40.0)	(38.0)
Modulus of elasticity in tension, min:			
psi	392 000	319 000	290 000
(MPa)	(2700)	(2200)	(2000)
Deflection temperature under load, min:			
°F at 264 psi	158	158	158
(°C at 1.82 MPa)	(70)	(70)	(70)

¹⁰ Available from the American Society of Civil Engineers, 1801 Alexander Bell Dr., Reston, VA 20191-4400.

accordance with 6.3 and 6.4.

5.2 *Thickness*—The minimum thickness of the siding shall be 0.035 in. (0.9 mm) when measured in accordance with 6.5.

5.3 *Camber*—A full length of siding (typically 10 or 12 ft (3.05 or 3.61 m)) shall not have a camber greater than 1/8 in. (3.2 mm) when measured in accordance with 6.6.

5.4 *Heat Shrinkage*—The average heat shrinkage shall not exceed 3.0 % when determined by the method described in 6.7.

5.5 *Impact Resistance*—Siding shall have a minimum impact strength of 60 in.-lbf (6.78 J) when tested in accordance with 6.8.

5.6 *Coefficient of Linear Expansion*—The siding shall have a coefficient of linear expansion not greater than 4.5 by 10^{-5} in./in./°F (8.1 by 10^{-5} mm/mm/°C) when tested in accordance with 6.9.

5.7 *Gloss*—The gloss of smooth and embossed siding shall be uniform across the exposed surface. Variations in the glossmeter readings for smooth siding shall not be more than ± 10 % or ± 5.0 points (whichever is greater). Variations for embossed siding shall not be more than ± 20 % or ± 10.0 points (whichever is greater). Gloss of smooth and embossed siding shall be tested in accordance with 6.11.

5.8 *Surface Distortion*—The siding shall be free of bulges, waves, and ripples when tested to a minimum temperature of 120°F (49°C) in accordance with the procedure in 6.12. This distortion is called “oil-canning.”

5.9 *Color*—The color of the siding shall be within the defined color space parameters for the specific color agreed upon between the purchaser and the manufacturer. The color specified shall be uniform on the surface of the siding panels, except in the case of multicolored woodgrain panels.

5.9.1 *Uniformity of Color*—When tested in accordance with 6.13, the total color change, ΔE , between a production specimen and the appropriate reference specimen or agreed-upon color coordinates shall not vary by more than 1.5, and the chromatic coordinates thereof shall not change by more than $\pm \Delta a_H = 1.0$ and $\pm \Delta b_H = 1.0$.

5.10 *Weathering*:

5.10.1 The siding shall maintain a uniform color and be free of any visual surface or structural changes such as peeling, chipping, cracking, flaking, and pitting when tested in accordance with 6.10.

NOTE 5—It is recommended that manufacturers utilize the color-hold guidelines in Appendix X1 to ensure quality performance and to optimize siding weathering product development studies.

NOTE 6—Weathering-conformance-testing requirements are to reflect performance of a “typical” extrusion siding profile representing a specific color of PVC compound and a specific extrusion technology. In no case is there an implied requirement for testing all the various shaped and sized siding profiles produced in this color. The lengthy outdoor weatherability testing for new products may be performed concurrently with market development and sales of siding to existing markets. Completion of weatherability testing prior to marketing of the product is not required.

5.11 *Windload Resistance*—The siding panel(s) shall be able to withstand a minimum static test pressure of 17.2 lbf/ft² (824 Pa) when tested in accordance with 6.14.

5.11.1 The static test pressure of 17.2 lbf/ft² (824 Pa) was established to withstand structural loading conditions that occur in 90 mph (145 km/h) wind-zone areas for elevations of

30 ft (9.1 m) and less in exposure category B, and is equivalent to 22.9 lbf/ft² (1096 Pa) design pressure.

5.11.1.1 The design-pressure values can be negative (suction loads) or positive. The negative values are the largest in magnitude and are the values used in this specification.

NOTE 7—In that the siding is being tested as a weather-resistant exterior product applied to an existing exterior structural wall, forces (negative) working to pull the siding off the wall, fasteners, or disengage locks will be the most important criteria for testing. Positive wind forces test the integrity of the total wall sections, and do not provide a measure of the performance of the siding.

5.11.2 Refer to Annex A1 for an explanation as to how the 22.9 lbf/ft² (1096 Pa) design pressure was established, and for applications where the effective design pressure as specified in ASCE 7-98 is greater than 22.9 lbf/ft² (1096 Pa) (for example, wind-zone areas greater than 90 mph (145 km/h) or elevations above 30 ft (9.1 m), or exposures other than exposure category B).

6. Test Methods

6.1 *General*—The inspection and test procedures contained in this section are used to determine the conformance of products to the requirements of this specification. Each producer who represents his products as conforming to this specification may utilize statistically based sampling plans that are appropriate for each manufacturing process, but shall keep the essential records necessary to document, with a high degree of assurance, his claim that all of the requirements of this specification have been met. Additional sampling and testing of the product, as may be agreed upon between the purchaser and the manufacturer, are not precluded by this section.

6.2 *Conditioning and Test Conditions*—Condition the test specimen in accordance with Procedure A of Practice D 618 and test under those conditions, unless otherwise specified herein.

6.3 *Length*—Lay the specimen on a flat surface and measure with a steel tape. Measure the length of a siding panel to the nearest 1/16 in. (1.6 mm) at the center, the butt edge, and the bottom of the top lock. The average of the three measurements is the actual length.

6.4 *Width*—Interlock two 2-ft (610-mm) long specimens in the normal mode for installation. Lay the two specimens on a flat surface. Measure to the nearest 1/16 in. (1.6 mm), the distance between the lowest butt edge of the top specimen and the lowest butt edge of the bottom specimen. Make a measurement at one end of the specimens and at 6-in. (152.4-mm) intervals along the entire length, making sure that the measurement is made perpendicular to the butt edge. Average the measurements. The average constitutes the exposed width of siding.

6.5 *Thickness*—Make a minimum of five equally spaced measurements across the width of the siding specimen perpendicular to the exposed surface with a micrometer similar to that described in Test Method D 374, Method A or B, with the exception that the vernier reading shall be to 0.001 in. (0.0254 mm). The average constitutes the thickness of the siding.

6.6 *Camber*—Place a full length of siding (typically 10 or 12 ft (3.05 or 3.61 m)) on a flat surface alongside a straightedge at least as long as the siding specimen. Measure the maximum

space between edge of the siding specimen and the straight-edge for each edge to the nearest $\frac{1}{16}$ in. (1.6 mm).

6.7 Heat Shrinkage:

6.7.1 Apparatus:

6.7.1.1 *Scriber*, similar to that described in Test Method D 1042, with the exception that the needle points shall be separated by 10 ± 0.01 in. (254 ± 0.254 mm).

6.7.1.2 *Test Media*, a controlled-temperature water bath of 5 gal (10 L) or more, equipped with an efficient stirrer that will maintain uniform temperature throughout. Heater and temperature-control devices must maintain the water at $160 \pm 1^\circ\text{F}$ ($71 \pm 0.5^\circ\text{C}$). Use a wire rack to raise and lower specimens into the water bath. As an alternative to the use of a water bath, the specimens may be heated for 30 min in a uniformly heated forced-air oven maintained at a temperature of $160 \pm 1^\circ\text{F}$ ($71 \pm 0.5^\circ\text{C}$).

6.7.1.3 Make measurements with any device capable of measuring the distance between two scribe marks to the nearest 0.01 in. (0.254 mm).

6.7.2 Procedure:

6.7.2.1 Cut three specimens from the siding panel, each 1 in. (25.4 mm) wide by 12 in. (305 mm) long. Cut one specimen from the center and one from each of the extreme edges of the flat surface. The long axis shall be parallel to the machine direction.

6.7.2.2 Condition specimens at $73.4 \pm 3.6^\circ\text{F}$ ($23 \pm 2^\circ\text{C}$) and $50 \pm 5\%$ relative humidity for at least 24 h.

6.7.2.3 Make a slight mark with the scribe on each specimen so that a reference point will be clearly visible.

6.7.2.4 Place specimens in the test medium.

6.7.2.5 Remove specimens after 30 min and place on a flat surface until cool.

6.7.2.6 Repeat conditioning in accordance with 6.7.2.2.

6.7.2.7 Make a second mark with the scribe on each specimen, using the same center.

6.7.2.8 Measure the distance, D , between the scribe marks to the nearest 0.01 in. (0.254 mm).

6.7.2.9 Calculate the percent shrinkage as $(D/10) \times 100$.

6.7.2.10 Report the average shrinkage of the three specimens tested.

6.8 *Impact Resistance*—Test impact resistance of siding in accordance with Test Method D 4226, Procedure A, impactor head configuration H.25. 4 in.-lb increments (0.5 in. height increments with 8 lb falling weight) shall be used. Minimum sample dimensions shall be 1.5 by 1.5 in. Samples shall be tested with the normally exposed surface facing up. Conditioning time for quality-control tests shall be at least 1 h.

6.9 *Coefficient of Linear Expansion*—Conduct this test in accordance with Test Method D 696.

6.10 Weatherability:

6.10.1 Expose extruded specimens at least 6 in. (150 mm) long for six months, one year, and two years in at least three widely different climatic areas. A hot, dry climate, such as Phoenix, AZ; a hot, humid climate such as Miami, FL; and a temperate, northern climate are suggested sites.

6.10.2 All exposures shall be conducted at an angle of 45° S, plywood backed, in accordance with Practice D 1435.

6.11 Gloss:

6.11.1 *Apparatus*—Measure gloss with using a 75° geometry glossmeter; for measuring embossed siding, the glossmeter shall be operated with an “integrating mode.”¹¹

6.11.2 Procedure A:

6.11.2.1 For smooth siding, measure gloss on one piece of siding on at least three widely separated points across the width of the exposed surface. The area tested must be flat.

6.11.2.2 Each reading shall be within the limit specified in 5.7.

6.11.2.3 The average reading of all readings shall be used to represent the gloss of the sample.

6.11.3 Procedure B:

6.11.3.1 For embossed siding, measure gloss on one piece of siding on at least three widely separated sections across the width of the exposed surface. The specimen to be tested shall be flat.

6.11.3.2 Using the “integrating measurement mode”; at each section, measure the gloss by sliding the glossmeter longitudinally for approximately 12 in. (305 mm). Take care to ensure a good contact between the glossmeter measuring port and the surface of the sample. When sliding the glossmeter, a steady speed of approximately 6 in./s (150 mm/s) shall be maintained, to coincide with the opening time of the measurement. Use care to ensure that a new surface is used for each reading since instrument contact may leave scratches on the specimen surface.

6.11.3.3 Each reading of gloss shall be within the limit specified in 5.7.

6.11.3.4 Use the average result of all readings to represent the gloss of the sample.

6.12 Surface Distortion:

6.12.1 Test Specimen/Apparatus:

6.12.1.1 The test specimen shall consist of three courses of siding, a minimum of 6 ft (1.83 m) in length, mounted on a flat rigid frame in accordance with the manufacturer’s recommended installation instructions.

6.12.1.2 Heat-sensing elements shall be located at the midpoint of the backside of the second course of siding.

6.12.1.3 *Radiant-Heat Rod*, 600 W for each linear foot (0.31 m), mounted parallel to the middle course and approximately 32 in. (810 mm) away from the surface of the siding.

6.12.1.4 *Temperature-Control Device*, used to regulate the temperature of the radiant-heat rod, shall be able to maintain the conditions specified in 6.12.2.1.

6.12.2 Procedure:

6.12.2.1 Heat the test panel (second course of siding) at a rate of 3.0 to $6.0^\circ\text{F}/\text{min}$ (1.7 to $3.3^\circ\text{C}/\text{min}$) until a minimum temperature of 120°F (49°C) is achieved as measured by the heat-sensing element on the midpoint of the backside of the second course. During this heating period, observe the test panel for surface distortion.

6.12.2.2 Failure is defined as the appearance of bulges, waves, or ripples before a temperature of 120°F (49°C) is reached.

6.13 *Color Uniformity*—Calculate the difference between the L_H , a_H , and b_H color coordinates for a production specimen

¹¹ Micro-gloss 75, available from BYK-Gardner USA, 2435 Linden Lane, Silver Spring, MD 20910, or equivalent is suitable.

to those of either the appropriate reference specimen or the agreed upon color coordinates for that specific color product in accordance with Test Method D 2244. Calculate the total difference ΔE between the production specimen and the reference specimen in accordance with Test Method D 2244.

6.14 *Windload Resistance*—Conduct the test on windload resistance of finished siding in accordance with Test Method D 5206.

7. Product Marking

7.1 In order that purchasers may identify siding conforming to all requirements of this specification, producers and distributors shall include a statement of compliance in conjunction with their name and address on product labels, invoices, sales literature, and the like. The following statement is suggested when sufficient space is available:

This PVC siding conforms to all the requirements established in ASTM Specification D 3679, developed cooperatively with the industry and published by ASTM.

Full responsibility for the conformance of this product to the specification is assumed by (name and address of producer or distributor).

7.2 The following abbreviated statement is suggested when available space on labels is insufficient for the full statement: Conforms to ASTM Specification D 3679 (name and address of producer or distributor).

8. Packing, Packaging, and Package Marking

8.1 The siding shall be packed in such a manner as to provide reasonable protection against damage in ordinary handling, transportation, and storage.

8.2 Provisions of Practice D 3892 shall apply to this specification.

9. Keywords

9.1 plastic building products; plastic weatherability; recycled plastic; rigid PVC siding; specification; weatherability color-hold guidelines

ANNEX

(Mandatory Information)

A1. WINDLOAD RESISTANCE TEST DESIGN FACTORS

A1.1 *Windload Criteria:*

A1.1.1 ASCE 7-98 is the basis for determining the design pressures used in this test method. The velocity pressures, q , used in this test method have been computed using the following equation:

$$q = 0.00256 K_z K_d V^2 I \text{ (lb/sq ft)}$$

$$= 0.613 K_z K_d V^2 I \text{ (N/m}^2\text{)}$$

where:

V = wind velocity, mph (km/h). The basic wind speed corresponds to a 3-s gust speed at 33 ft (10.1 m) above ground in exposure category C, as described in ASCE 7-98. A velocity of 90 mph (145 km/h) was used in this specification

I = “importance factor” as described in ASCE 7-98. A value of 1.0 was used.

K_z = “velocity pressure coefficient” as described in ASCE 7-98. A “ K_z ” of 0.70 was used in the wind pressure calculations, which is the value from ASCE 7-98 for an elevation of 30 ft (9.1 m) above ground level and Exposure Category B.

K_d = “wind directionality factor” as described in ASCE 7-98. A “ K_d ” of 0.85 is used.

The velocity pressure = -12.3 lbf/ft^2 (589 Pa).

A1.1.2 ASCE 7-98 recommends various internal and external pressure coefficients, which include gust response factors. These coefficients vary with the effective area of the cladding component, the location of the cladding component relative to building corners, and the configuration of the building (open versus enclosed). The internal and external pressure coeffi-

icients are taken from Tables 6–7 and Figure 6–5A of ASCE 7–98. The effective area is taken as 10 square ft (the area of one piece of siding), an enclosed building is assumed, and factors for the building corners are used. The pressure coefficients are as follows:

$$\text{Internal Pressure Coefficient} = \pm 0.18$$

$$\text{External Pressure Coefficient} = \pm 1.00 \text{ and } -1.40$$

The design pressure is calculated by multiplying the velocity pressures by the algebraic sum of the internal and external pressure coefficients.

A1.2 *Design Pressure:*

$$\text{Positive Design Pressure} = (12.3)(1.00 + 0.18) = 14.5 \text{ psf}$$

$$\text{Negative Design Pressure} = (12.3)(-1.40 - 0.18) = -19.4 \text{ psf}$$

A1.2.1 The negative values (suction loads) are the largest in magnitude and are the design values used in this test method. Based on AAMA research work as reported in “Windload Resistance of Residential Siding Products” (1),¹² a certain amount of pressure equalization occurs through residential siding products installed with sheathing under high dynamic

¹² The boldface numbers in parentheses refer to a list of references at the end of the text.

pressures. In light of this pressure equalization, the design pressure in the ASCE 7-98 windload standards is reduced by a factor of 50 %.

A1.2.2 Therefore, the required test pressures may be calculated as follows:

$$P_t = D_p \times 0.5 \times 1.5$$

where:

P_t = test pressure, lbf/ft² (Pa),

D_p = design pressure, lbf/ft² (Pa),

0.5 = pressure equalization factor, and

1.5 = safety factor.

A1.2.3 In a 90 mph (145 km/h) wind zone area specifying a design pressure of -19.4 lbf/ft² (929 Pa) for a building 30 ft (9.1m) in height or less, the required siding uniform load test pressure is 14.6 lbf/ft² (699 Pa). For applications where the effective design pressure is greater than -19.4 lbf/ft² (929 Pa) (for example, wind zone areas greater than 90 mph (145km/h), elevations over 30 ft (9.1 m), or exposure conditions other than Exposure B), refer to ASCE 7-98 for the effective design

pressure. The product shall be subjected to a static test pressure determined by the formula in A1.2.2A1.2.2. These loading conditions apply only to siding installed to solid walls, with internal or external sheathing. For applications where the siding is installed over open studding, rapid pressure equalization does not occur. In these applications, the load the siding will see is equal to the total design pressure. The static test pressure required for products used under these conditions is as follows:

$$P_t = 1.5 \times DP$$

where:

P_t = static test pressure, lbf/ft² (Pa),

D_p = design pressure, lbf/ft² (Pa), and

1.5 = safety factor.

A1.3 Wind Design Pressures:

A1.3.1 Design wind pressures may be selected for particular geographic locations from the wind velocity maps in ASCE 7-98.

APPENDIX

(Nonmandatory Information)

X1. COLOR-HOLD GUIDELINES WEATHERING TEST

X1.1 Scope

X1.1.1 Color-hold guideline weatherability testing provides a predictive method for estimating the acceptability of color change in a siding product over a period of years of service.

X1.1.2 It has been shown that commercial siding products which demonstrate weathering behavior within reasonable conformance to these target guidelines during a two-year test program can be anticipated to weather for extended periods of many years without exhibiting unacceptable color changes.

X1.1.3 These predictive tests are designed for a siding manufacturer's product development and quality performance use only and are not for specification or regulatory use.

X1.2 Significance and Use

X1.2.1 Color-hold guidelines provide boundary target color regions within a three-dimensional model, which constitutes acceptable appearance retention levels of color change resulting from weathering of a specific window or door profile product type, formulation, and color.

X1.2.2 Each color region is defined by the manufacturers of vinyl siding as specific color-hold guidelines (see Note X1.1). Regardless of where a specific color falls within the region, it becomes the control on each of the three graphs plotting color difference of each manufacturer's formulation and color.

NOTE X1.1—Nine color regions are presently defined as specific color-hold guidelines.

X1.2.3 It should be observed that color-hold guidelines are controlled by specific product application such as siding, since they are developed using the perspective of manufacturers of

those products for that application.

X1.3 Establishing Window and Door Color Regions

X1.3.1 The siding manufacturer's color panel uses the following steps to establish the siding color regions.

Step 1—All commercial unweathered siding colors are divided into rational similar color regions representing a visibly definable hue (white, dark gray-blue, light gray-blue, green, dark beige, light beige, gold, yellow, and gray). Each color is then measured in Hunter L_H , a_H , and b_H units and plotted in color space.

Step 2—The color region itself is then defined by the extreme Hunter L_H , a_H , and b_H units within the population of colors. Refer to 3.2.5 to 3.2.14.

Step 3—Any specific color being evaluated within the color region becomes the control for color-difference studies. Refer to X1.3.

Step 4—Simulate 2-year weathered samples for each color region encompassing areas within that region are prepared.

Step 5—A visual examination and rating of each simulated weathered sample is conducted by a panel of siding manufacturers and color specialists to establish a visual average rating of limits of acceptability of color change for the siding application. After visual examination, the acceptable delta (Δ) limits are plotted three dimensionally and considered preliminary limits.

Step 6—Real-world data from 2-year weathering studies in Florida, Arizona, and temperate Northern climate test sites are then plotted in terms of change of Hunter L_H , a_H , b_H from the

control for each of the colors within that region.

Step 7—The final reference ellipses of color-hold guidelines for each region are then established by adjustment of the preliminary data by use of the real-world data. Refer to X1.3.

Step 8—Concurrent with development of the color-hold guidelines for each color region, outdoor weathering of all commercial siding samples is continued in Florida, Arizona, and Northern temperate climate sites in a 10-year program followed each 5 years by a new study including new siding colors and formulations representing current commercial products. By use of this program, the relation between 2-year predictive color-hold guidelines and real-world long-term weathering can be ensured.

X1.4 Summary of Procedure for Measuring Weatherability

X1.4.1 Flat section specimens cut from finished product siding are exposed in a dry, hot climate such as Phoenix, AZ; a hot, humid climate such as Miami, FL; and a temperate northern climate.

X1.4.2 Color change due to weather exposure at each exposure site is measured after six months, one year, and two years of exposure.

X1.4.3 The acceptability in the change in color resulting from weathering at each test site and exposure frequency is determined by reference to the appropriate color-hold guideline ellipses for that specific color.

X1.5 Sampling and Specimen Preparation

X1.5.1 Select samples in conformance with Practice D 1898. The samples shall be representative of the siding product to be qualified.

X1.5.2 If commercial parts are to be used, they shall be cut into specimens that are flat and are free of any imperfections. Cut sufficient number of specimens to allow removal of a specimen at each weathering time interval specified at each testing site plus retained, unweathered specimens. Alternatively, samples can be washed, measured, and returned to the test site. Samples prepared in the laboratory by a similar process may be used as an alternative to a commercial sample. The laboratory sample must be extruded under similar conditions to those used to prepare the commercial product.

X1.5.3 The thickness of any test specimen must differ from the average test specimen by no more than 10 %.

X1.6 Weathering Practice

X1.6.1 Prepare test specimens as outlined in X1.5.5.

X1.6.2 Mark each specimen permanently so as to ensure retention of identity during and after weathering.

X1.6.3 Measure in replicate the original tristimulus X , Y ,

and Z values for each specimen using 2° observer and Illuminant C, specular components included, in accordance with Practice E 805. Calculate the Hunter L_H , a_H , and b_H units in accordance with the equations in the section on “Hunter L_H , a_H , and b_H Color Space and Color-Difference Equation” in Test Method D 2244 using the average of the replicate measurements and record them in a permanent record.

X1.6.4 Weather specimens (back side protected) at 45° South in accordance with Practice D 1435 in a hot, dry climate, such as Phoenix, AZ; a hot, humid climate, such as Miami, FL; and in a temperate northern climate. Remove specimens for testing after six months, one year, and two years of exposure.

X1.6.5 It is recommended that exposed specimens be evaluated for color characterization at the test site. If this practice is not possible, use an expedient shipping procedure to minimize time between exposure and testing. Color measurement shall be completed within seven days after removal from the exposure rack.

X1.6.6 Wash the exposed specimens gently with cheesecloth in warm deionized or distilled water, unless the dirt pickup is a variable being studied.

X1.6.7 Measure and record color of the exposed specimens in accordance with X1.6.3 after each exposure frequency.

X1.6.8 Calculate and record the change in L_H , a_H , and b_H color coordinates for each specimen exposure frequency by reference to the original color (see X1.6.3) and the exposed color (see X1.6.7).

X1.6.9 Note and record any nonuniform change in color on any specimen.

X1.6.10 Determine the acceptability of the change in color resulting from weathering at each test site and exposure frequency by reference to the appropriate series of color-hold guideline ellipses for that specific color. The target three-dimension color space is plotted as guideline ellipses for each color (Δa_H versus Δb_H), (Δa_H versus ΔL_H), and (Δb_H versus ΔL_H) in Figs. X1.1-X1.9. For example, in the case of dark gray-blue siding, use Figs. X 1.1(a), X 1.1(b), and X 1.1(c). Plot the specific change in the color coordinates when compared to the unweathered specimen color coordinates (see X1.6.3) by plotting on each of the guideline ellipses for that color. To meet the color-hold guidelines, the plotted change in color for Δa_H , Δb_H , and ΔL_H must fall essentially within the acceptance regions in all three color ellipses.

X1.6.11 Report any deviation and extent of deviation from the target guideline ellipses by Δa_H , Δb_H , and ΔL_H for any test site and exposure frequency. Report any deviation from uniform color change in any specimen. Report any other appearance change in any specimen.

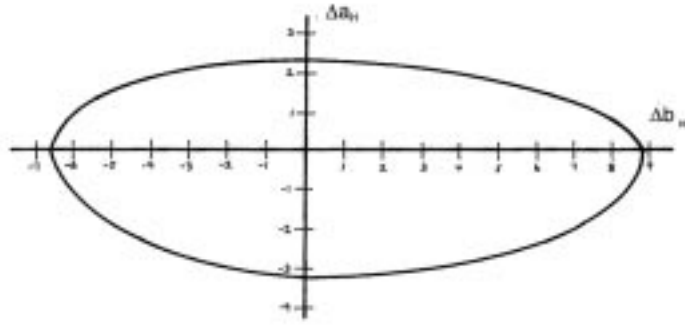


FIG. X1.1(a) Dark Gray-Blue Siding ($\Delta a_H - \Delta b_H$) Color-Hold Guidelines

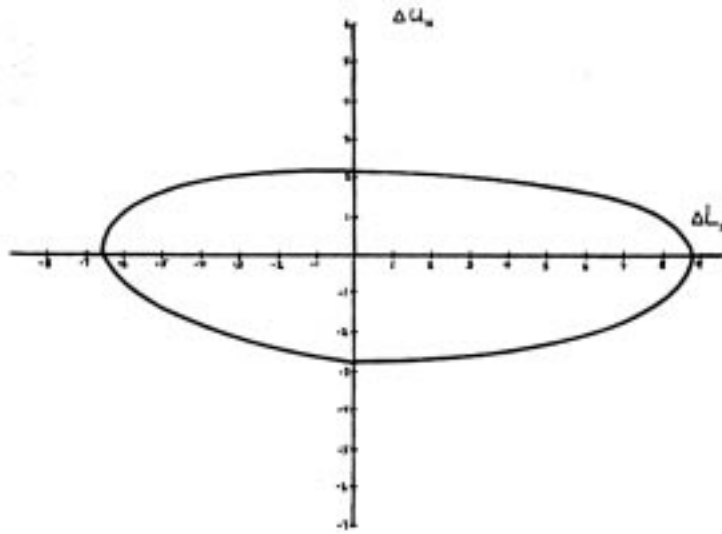


FIG. X1.1(b) Dark Gray-Blue Siding ($\Delta a_H - \Delta L_H$) Color-Hold Guidelines

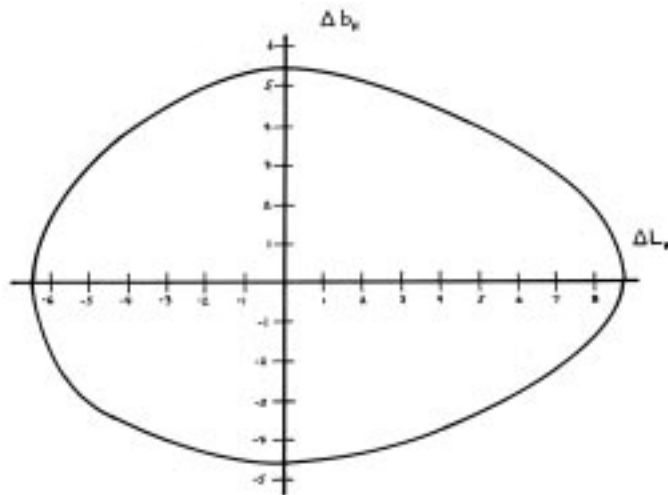


FIG. X1.1(c) Dark Gray-Blue Siding ($\Delta b_H - \Delta L_H$) Color-Hold Guidelines

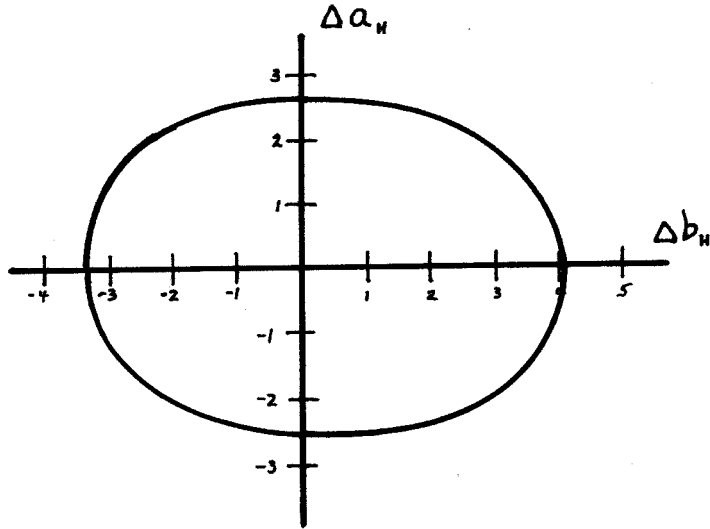


FIG. X1.2(a) Light Gray-Blue Siding ($\Delta a_H - \Delta b_H$) Color-Hold Guidelines

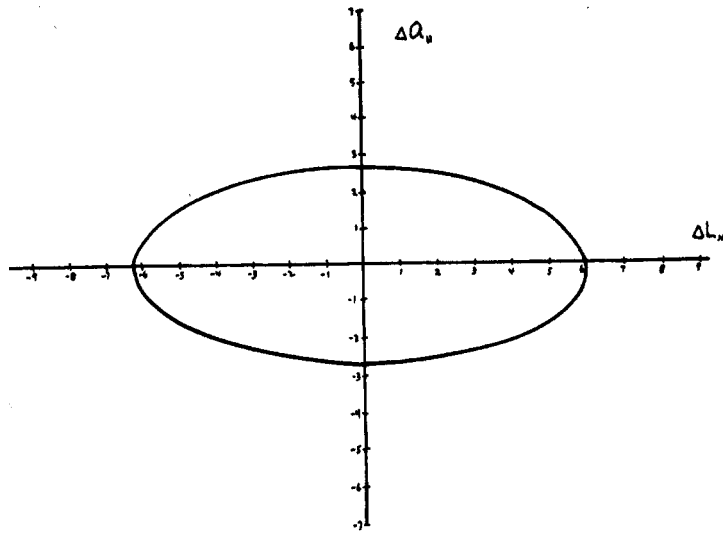


FIG. X1.2(b) Light Gray-Blue Siding ($\Delta a_H - \Delta L_H$) Color-Hold Guidelines

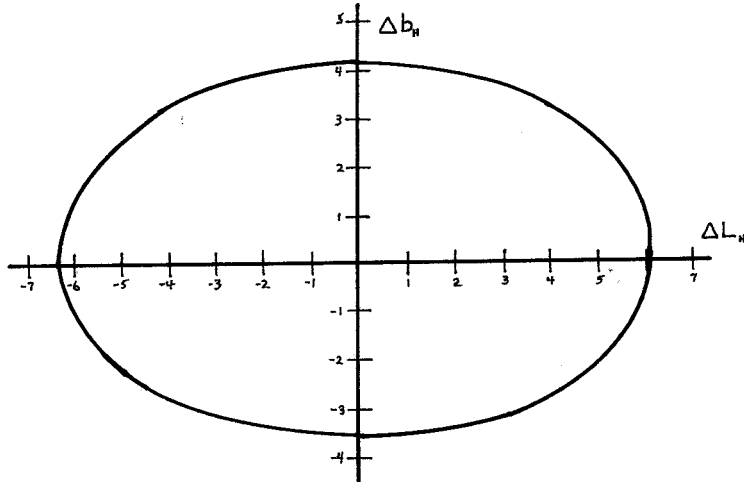


FIG. X1.2(c) Light Gray-Blue Siding ($\Delta b_H - \Delta L_H$) Color-Hold Guidelines

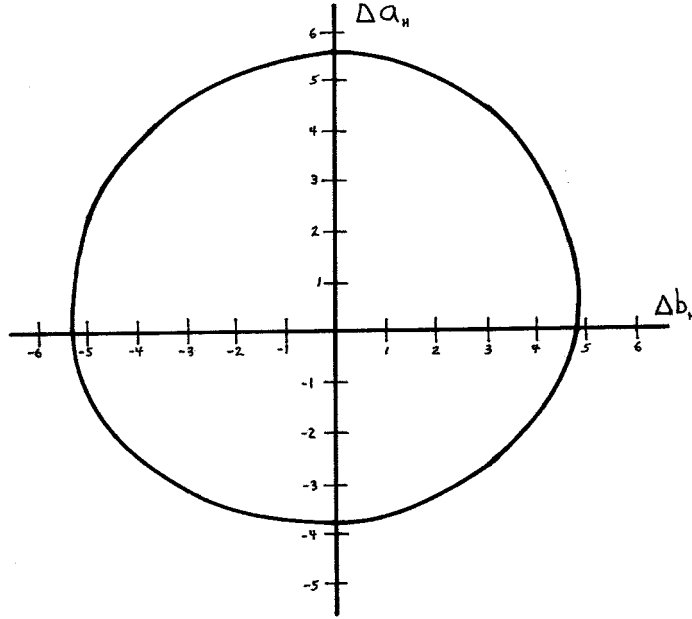


FIG. X1.3(a) Green Siding ($\Delta a_H - \Delta b_H$) Color-Hold Guidelines

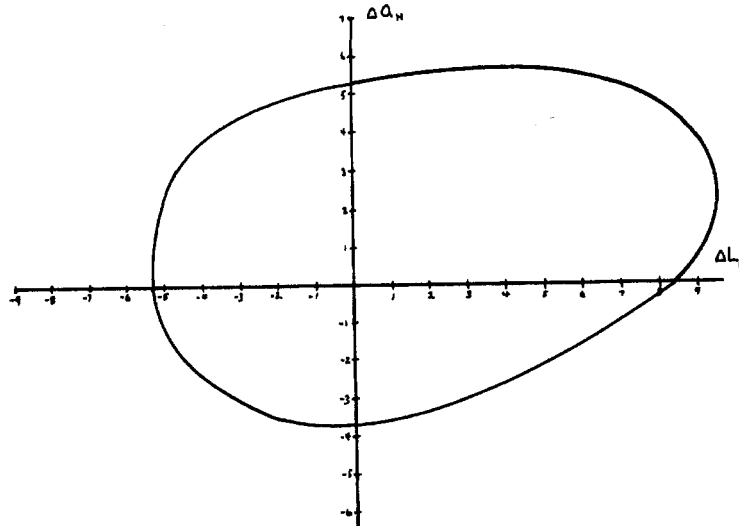


FIG. X1.3(b) G Siding ($\Delta a_H - \Delta L_H$) Color-Hold Guidelines

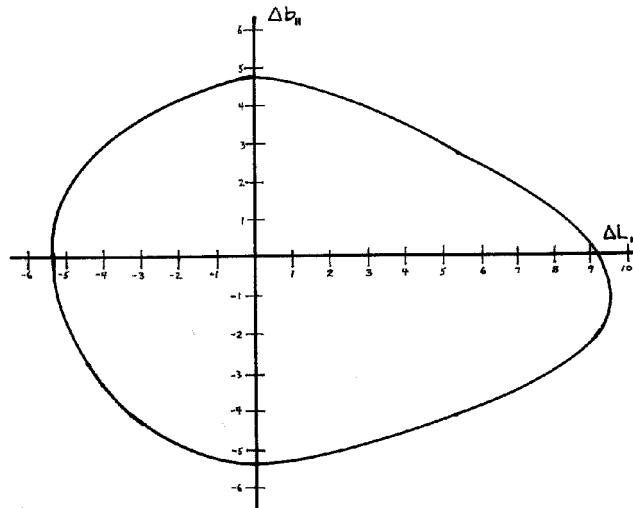


FIG. X1.3(c) Green Siding ($\Delta b_H - \Delta L_H$) Color-Hold Guidelines

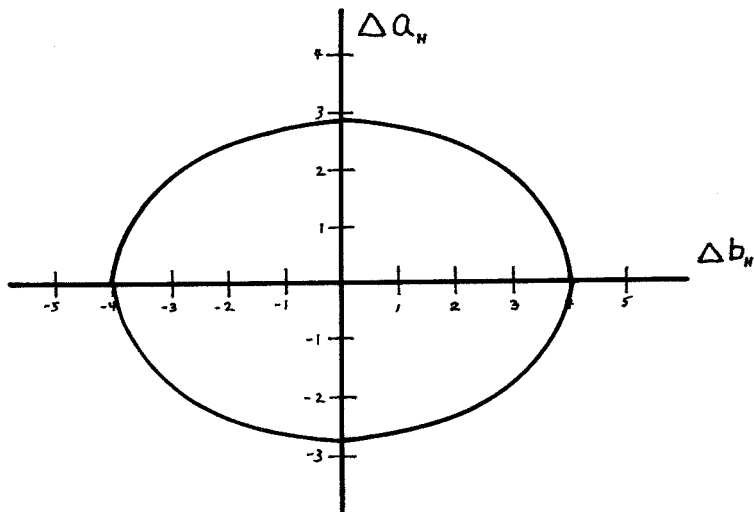


FIG. X1.4(a) Dark Beige Siding ($\Delta a_H - \Delta b_H$) Color-Hold Guidelines

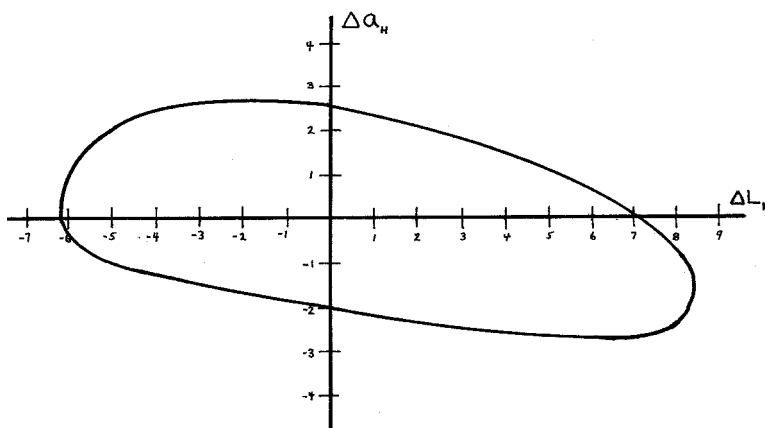


FIG. X1.4(b) Dark Beige Siding ($\Delta a_H - \Delta L_H$) Color-Hold Guidelines

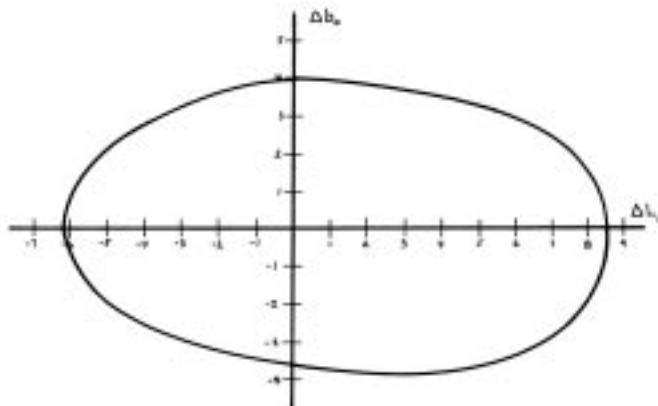


FIG. X1.4(c) Dark Beige Siding ($\Delta b_H - \Delta L_H$) Color-Hold Guidelines

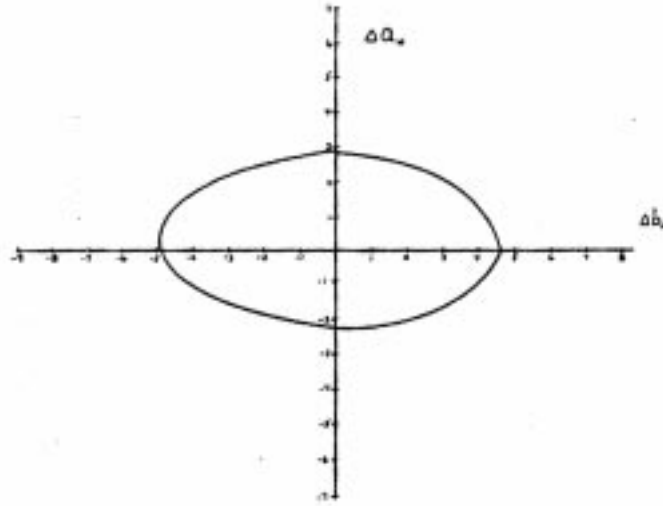


FIG. X1.5(a) Light Beige Siding ($\Delta a_H - \Delta b_H$) Color-Hold Guidelines

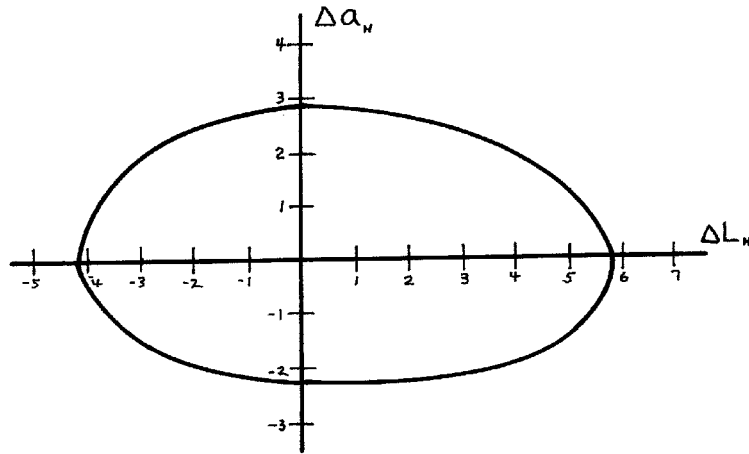


FIG. X1.5(b) Light Beige Siding ($\Delta a_H - \Delta L_H$) Color-Hold Guidelines

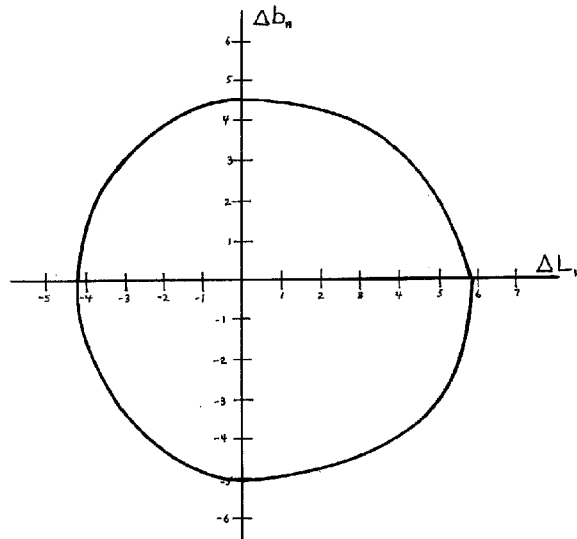


FIG. X1.5(c) Light Beige Siding ($\Delta b_H - \Delta L_H$) Color-Hold Guidelines

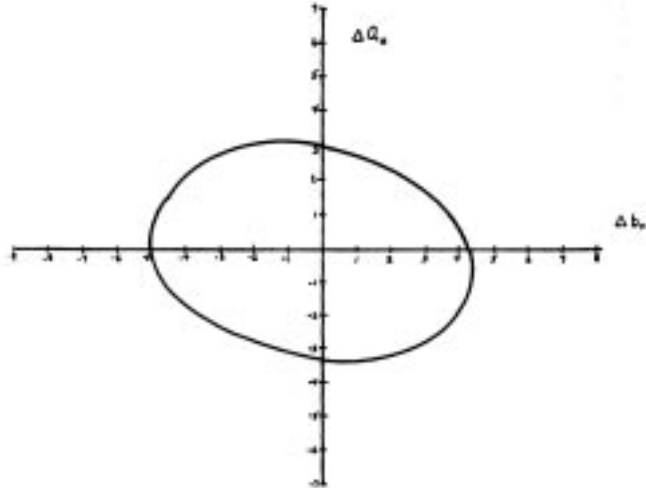


FIG. X1.6(a) Gold Siding ($\Delta a_H - \Delta b_H$) Color-Hold Guidelines

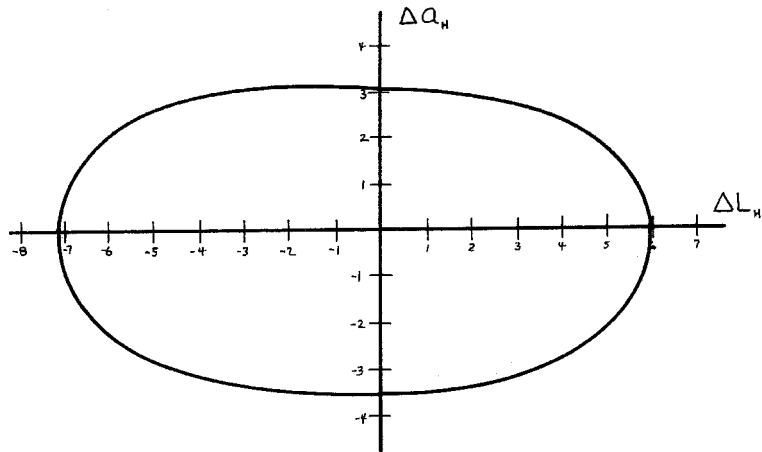


FIG. X1.6(b) Gold Siding ($\Delta a_H - \Delta L_H$) Color-Hold Guidelines

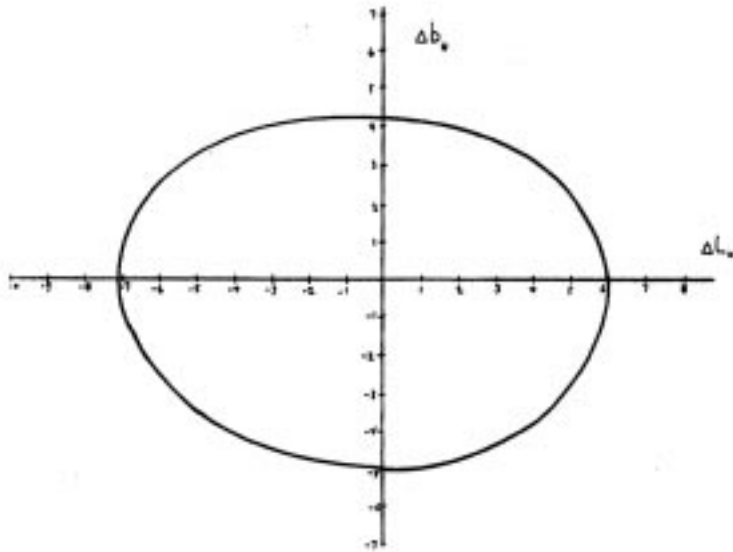


FIG. X1.6(c) Gold Siding ($\Delta b_H - \Delta L_H$) Color-Hold Guidelines

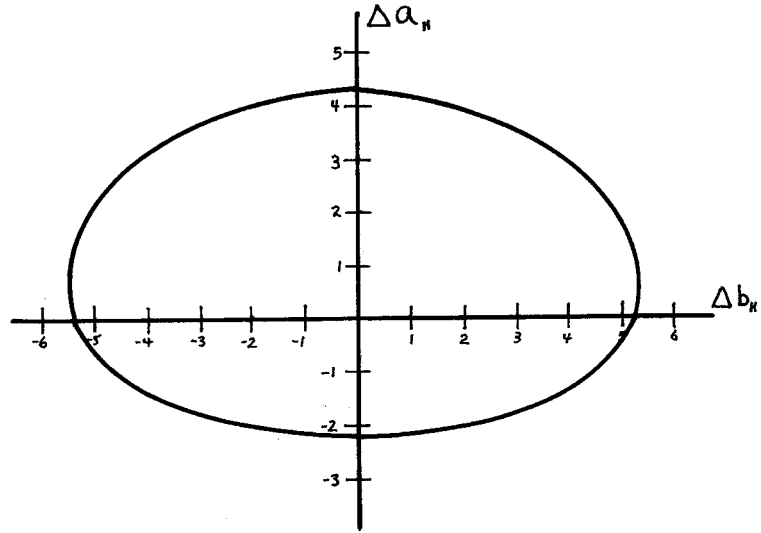


FIG. X1.7(a) Yellow Siding ($\Delta a_H - \Delta b_H$) Color-Hold Guidelines

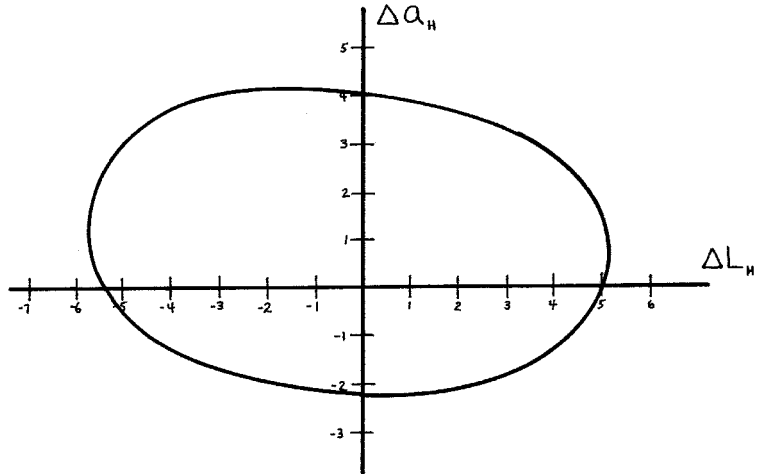


FIG. X1.7(b) Yellow Siding ($\Delta a_H - \Delta L_H$) Color-Hold Guidelines

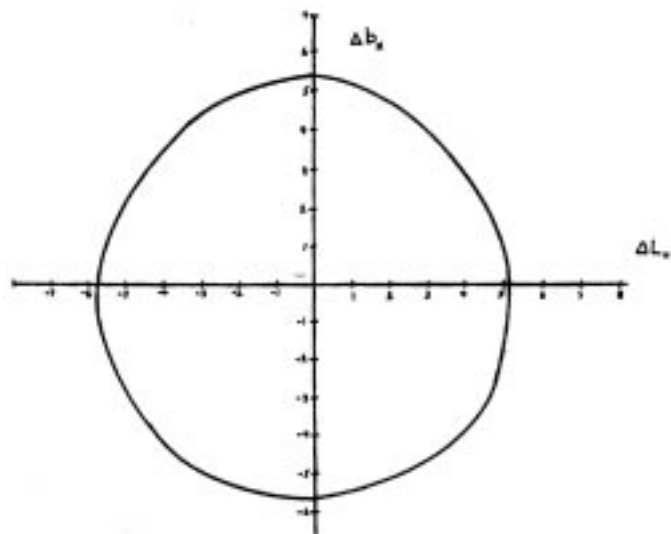


FIG. X1.7(c) Yellow Siding ($\Delta b_H - \Delta L_H$) Color-Hold Guidelines

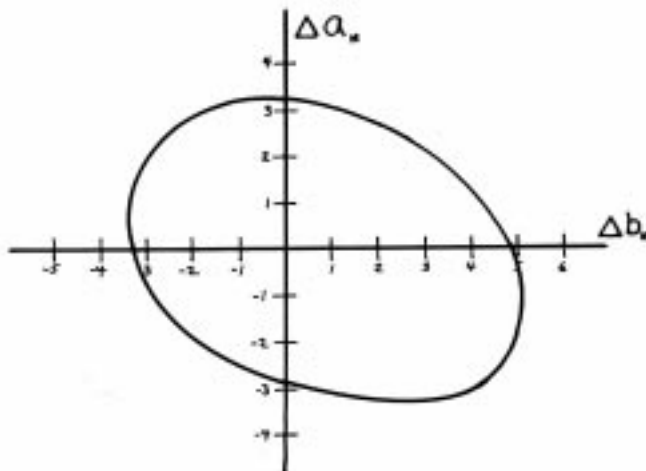


FIG. X1.8(a) White Siding ($\Delta a_H - \Delta b_H$) Color-Hold Guidelines

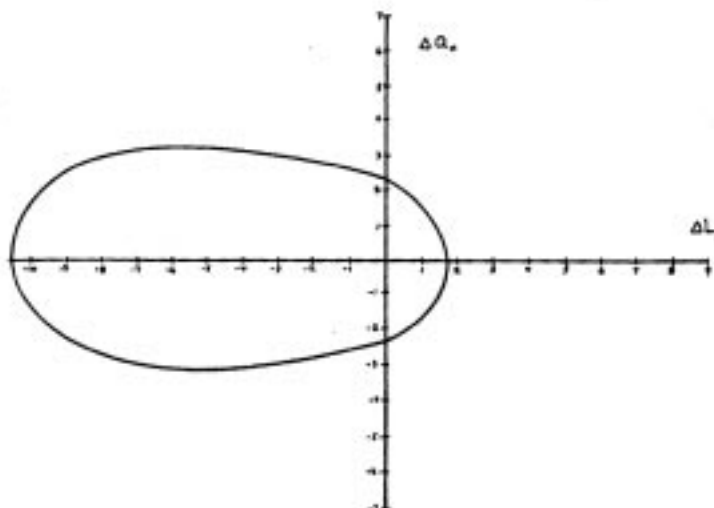


FIG. X1.8(b) White Siding ($\Delta a_H - \Delta L_H$) Color-Hold Guidelines

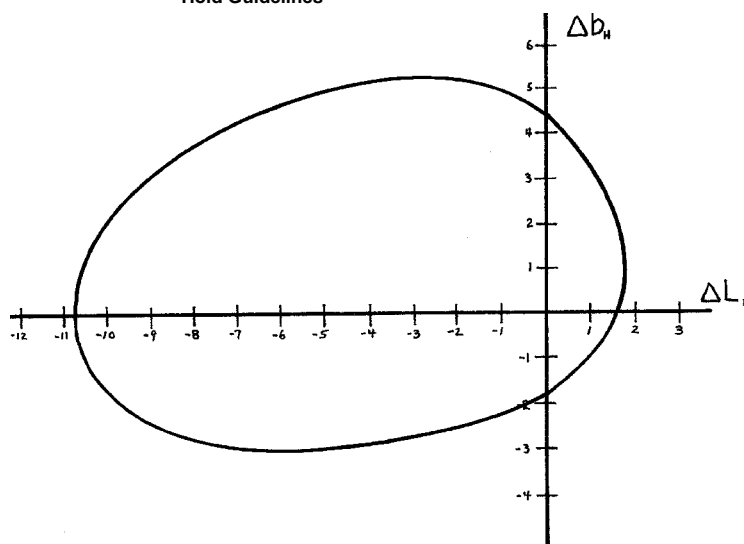


FIG. X1.8(c) White Siding ($\Delta b_H - \Delta L_H$) Color-Hold Guidelines

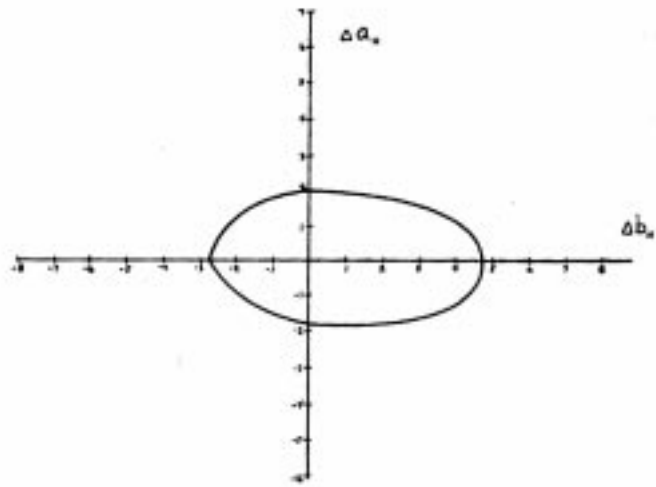


FIG. X1.9(a) Gray Siding ($\Delta a_H - \Delta b_H$) Color-Hold Guidelines

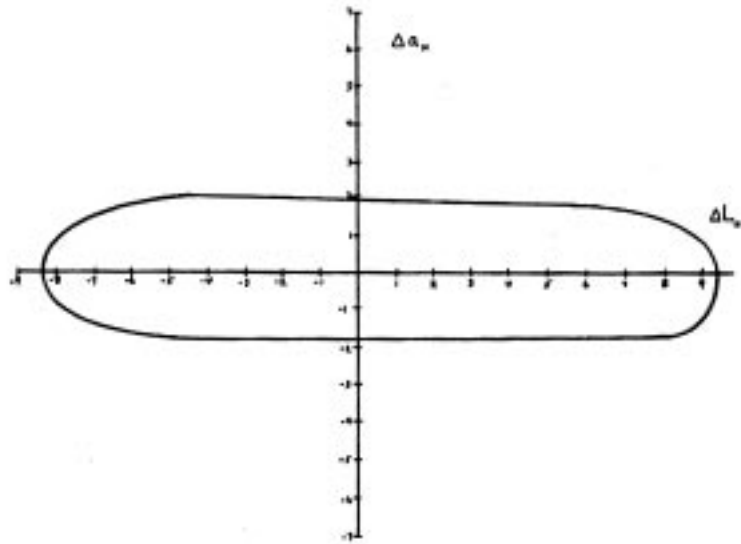


FIG. X1.9(b) Gray Siding ($\Delta a_H - \Delta L_H$) Color-Hold Guidelines

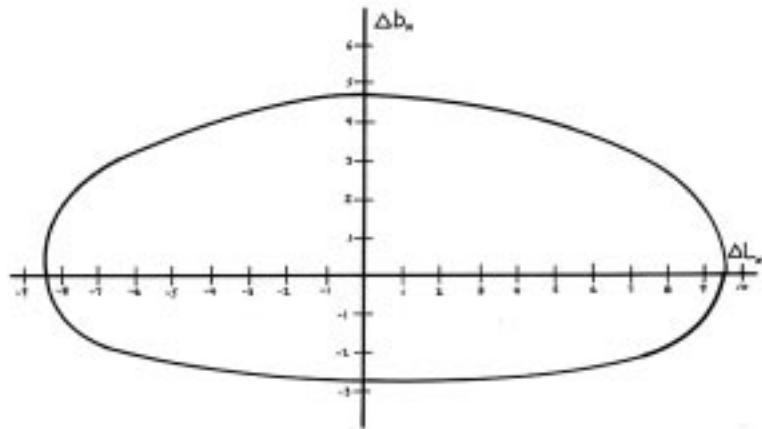


FIG. X1.9(c) Gray Siding ($\Delta b_H - \Delta L_H$) Color-Hold Guidelines

REFERENCES

- (1) *Research Report to Establish Performance Criteria for Siding/Fastener Systems with Emphasis on Determining the Windload Resistance of Residential Siding Products*, American Architectural Manufacturers Association, Palatine, IL.
- (2) *ASHRAE Handbook of Fundamentals*, American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. Chapter 26, 1977.
- (3) "Wind Forces on Structures," *Transactions of the American Society of Civil Engineers*, Vol 126, Part II, 1961, pp. 1124–1198.
- (4) AAMA, TIR-A2, American Architectural Manufacturers Assn., Design Wind Loads for Aluminum Curtain Walls, American Architectural Manufacturers Assn., 2700 River Rd., Palatine, IL.
- (5) Thom, H. C. S., *New Distribution of Extreme Winds in the United States*, American Society of Civil Engineers, Environmental Engineering Conference Preprint 431, Dallas, TX, Feb. 6, 1967.
- (6) Sachs, Peter, *Wind Forces in Engineering*, Pergamon Press, Elmsford, NY 1972.
- (7) MacDonald, A. J., *Wind Loading on Buildings*, Applied Sciences Publishers, Ltd., Essex, England, 1975.
- (8) Houghton, E., and Carruthers, N., *Wind Forces on Buildings and Structures*, John Wiley & Sons, New York, NY, 1976.

SUMMARY OF CHANGES

Committee D20 has identified the location of the following changes to this standard since the last issue that may impact on the use of this standard.

- (1) ASCE 7–98 replaced ASCE 7–88.
- (2) The wind exposure category was revised from Category C to Category B.
- (3) Annex A1, section A1.1.2 was revised.
- (4) Annex A1, section A1.3.1, dissertation on wind procedures, was removed.
- (5) Added definition of specimen side to be tested in 6.8.
- (6) Added minimum sample size requirements in 6.8.

ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.

This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).