



# Standard Test Method for Open Channel Flow Measurement of Water with the Parshall Flume<sup>1</sup>

This standard is issued under the fixed designation D 1941; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon ( $\epsilon$ ) indicates an editorial change since the last revision or reapproval.

## 1. Scope

1.1 This test method covers measurement of the volumetric flowrate of water and wastewater in open channels with the Parshall flume.

1.1.1 Information related to this test method can be found in ISO 1438 and 4359.

1.2 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applicability of regulatory limitations prior to use.*

## 2. Referenced Documents

### 2.1 ASTM Standards:

D 1129 Terminology Relating to Water<sup>2</sup>

D 2777 Practice for Determination of Precision and Bias of Applicable Methods of Committee D-19 on Water<sup>2</sup>

D 3858 Test Method for Open Channel Flow Measurement of Water by Velocity-Area Method<sup>2</sup>

### 2.2 ISO Standards:

ISO 555 Liquid Flow Measurements in Open Channels—Dilution Methods for Measurement of Steady Flow—Constant Rate Injection Method<sup>3</sup>

ISO 1438 Liquid Flow Measurement in Open Channels Using Thin-Plate Weirs and Venturi Flumes<sup>3</sup>

ISO 4359 Liquid Flow Measurement in Open Channels—Rectangular Trapezoidal and U-shaped Flumes<sup>3</sup>

## 3. Terminology

3.1 *Definitions:* For definitions of terms used in this test method, refer to Terminology D 1129.

### 3.2 Definitions of Terms Specific to This Standard:

3.2.1 *free flow*—a condition where the flowrate is governed by the state of flow at the crest overfall and hence can be determined from a single upstream depth measurement.

3.2.2 *head*—the height of a liquid above a specified point; that is, the flume crest.

3.2.3 *hydraulic jump*—an abrupt transition from supercritical to subcritical flow, accompanied by considerable turbulence or gravity waves, or both.

3.2.4 *normal depth*—the uniform depth of flow for a given flowrate in a long open channel of specific shape, roughness, and slope.

3.2.5 *primary instrument*—the device (in this case, the flume) that creates a hydrodynamic condition that can be sensed by the secondary instrument.

3.2.6 *scow float*—an in-stream flat for depth sensing usually mounted on a hinged cantilever.

3.2.7 *secondary instrument*—in this case, a device which measures the depth of flow at an appropriate location in the flume. The secondary instrument may also convert the measured depth to an indicated flow rate.

3.2.8 *stilling well*—a small reservoir connected through a constricted passage to the main channel, that is, the flume, so that a depth measurement can be made under quiescent conditions.

3.2.9 *subcritical flow*—open channel flow at a velocity less than the velocity of gravity waves in the same depth of water. Subcritical flow is affected by downstream conditions, since disturbances are able to travel upstream.

3.2.10 *submerged flow*—a condition where the water stage downstream of the flume is sufficiently high to affect the flow over the flume crest and hence the free-flow depth-discharge relation no longer applies and discharge depends on two head measurements.

3.2.11 *supercritical flow*—open channel flow at a velocity greater than that of gravity waves in the same depth, so disturbances cannot travel upstream, and downstream conditions do not affect the flow.

3.2.12 *throat*—the constriction in a flume.

## 4. Summary of Test Method

4.1 Parshall flumes are measuring flumes of specified geometries for which empirical relations of the form

$$Q = C H_a^n \quad (1)$$

<sup>1</sup> This test method is under the jurisdiction of ASTM Committee D-19 on Water and is the direct responsibility of Subcommittee D19.07 on Sediments, Geomorphology, and Open-Channel Flow.

Current edition approved Jan. 25, 1991. Published March 1991. Originally published in 1962. Last previous edition D 1941 – 67 (1975) $\epsilon^2$ .

<sup>2</sup> *Annual Book of ASTM Standards*, Vol 11.01.

<sup>3</sup> Available from American National Standards Institute, 11 W. 42nd St., 13th Floor, New York, NY 10036.

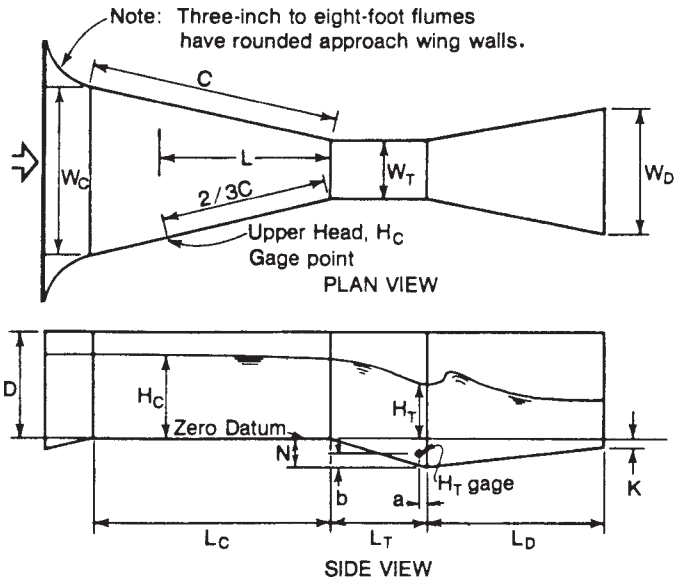


FIG. 1 Parshall Flume

have been established so that the flowrate,  $Q$ , can be determined from a single depth measurement,  $H_a$ , in free flow. If the flow is submerged, an additional downstream depth,  $H_b$ , must be measured and suitable adjustments made.

## 5. Significance and Use

5.1 Flume designs are available for throat sizes of 1 in. (2.54 cm) to 50 ft (15.2 m) which cover maximum flows of 0.2 to 3000 ft<sup>3</sup>/s (0.0057 to 85 m<sup>3</sup>/s) (1) and (2)<sup>4</sup>. They can therefore be applied to a wide range of flows, with head losses that are moderate.

5.2 The flume is self-cleansing for moderate solids transport and therefore is suited for wastewater and flows with sediment.

## 6. Interferences

6.1 The flume is applicable only to open channel flow and is inoperative under full-pipe flow conditions.

6.2 Although the flume has substantial self-cleansing capacity, it can be clogged by debris or affected by accumulation of aquatic growth and cleaning or debris removal may be required.

## 7. Apparatus

7.1 A Parshall flume measuring system consists of the flume itself (primary) and a depth-measuring device (secondary). The secondary device can range from a simple scale for manual readings to an instrument which continuously senses the depth, converts it to flowrate, and provides a readout or record of instantaneous flowrate or totalized flow, or both.

### 7.2 The Flume:

7.2.1 Parshall flumes are characterized by throat width; dimensions and flowrates for each size are given in Fig. 1 and Table 1, respectively. The dimensions must be maintained within 2 %, because the flume is an empirical device and

corrections for non-standard geometry are only estimates. The inside surface of the flume should be at least as smooth as a good quality concrete finish.

7.2.2 The measurement location for depth  $H_a$  is shown in Fig. 1. In submerged flow a second depth,  $H_b$ , must be measured in the throat as indicated. However, in the 1, 2, and 3-in. (2.54, 5.08, and 7.62-cm) flumes, this measurement is made at  $H_c$  instead, because disturbances have been observed at the  $H_b$  location in these sizes ((1) and (2)). See Fig. 2 for the relation between  $H_b$  and  $H_c$ .

### 7.3 Stilling Well and Connector:

7.3.1 Stilling wells are recommended for accurate depth measurements; they are required when wire- or tape-supported cylindrical floats are used or when the liquid surface is fluctuating.

7.3.2 The lateral area of the stilling well is governed in part by the requirements of the depth sensor. For example, the clearance between a float and the stilling-well wall should be at least 0.1 ft (3 cm) and should be increased to 0.25 ft (7.6 cm) if the well is made of concrete or other rough material, the float diameter itself being determined in part by permissible float lag error (see 11.4.2). Other types of depth sensors may also impose size requirements on the stilling well, and the maximum size may be limited by response lag.

7.3.3 Provision should be made for cleaning and flushing the stilling well to remove accumulated solids. It may be necessary to add a small purge flow of tap water to help keep the well and any connector pipe and the sensor parts clean. This flow should be small enough for any depth increase in the stilling well to be imperceptible.

7.3.4 The opening in the flume sidewall connecting to the stilling well either directly or through a short perpendicular pipe must have a burr-free junction with the wall. The hole or pipe must be small enough to dampen surface disturbances; an area of about 1/1000th of the stilling-well area is considered adequate for this purpose. However, the diameter should not be so small (or the pipe so long) that it is difficult to keep open or a lag is introduced in the response to changing flows (3); hole and pipe diameters of about 1/2 in. (1.3 cm) should be considered a minimum. If changes are made in pipe sizes, they should be done sufficiently removed from the flume wall that no drawdown will occur. The intake dimensions cited in this paragraph should be regarded as suggestions only.

### 7.4 Depth-Discharge Relations:

7.4.1 *Free Flow*—The values of  $C$  and  $n$  for use with Eq 1 are given in Table 2, along with approximate limiting flowrates. The maximum submergence ratios,  $H_b/H_a$ , for which free flow will occur are:

$H_b/H_a < 0.5$ , for 1, 2, and 3-in. (2.54, 5.08, and 7.62-cm) flumes;

$H_b/H_a < 0.6$ , for 6 and 9-in. (15.24 and 22.86-cm) flumes;

$H_b/H_a < 0.7$ , for 1 to 8-ft (30.48 to 243.8-cm) flumes;

$H_b/H_a < 0.8$ , for 10 to 50-ft (304.8 to 1524.0-cm) flumes.

### 7.4.2 Submerged Flow:

7.4.2.1 Discharge rates for submerged-flow conditions are given for 1, 2, 3, 6, and 9-in. (2.54, 5.08, 7.62, 15.24, and 22.86-cm) flumes in Table 3, Table 4, Table 5, Table 6, and

<sup>4</sup> The boldface numbers in parentheses refer to a list of references at the end of this test method.


TABLE 1 Dimensions and Capacities of Standard Parshall Flumes

NOTE 1—Flume sizes 3 in. through 8 ft have approach aprons rising at 25 % slope and the following entrance roundings: 3 through 9 in., radius = 1.33 ft; 1 through 3 ft, radius = 1.67 ft; 4 through 8 ft, radius = 2.00 ft.

Throat, $W_T$	Widths		Axial lengths, ft			Wall Depth in Converging Section, $D$ , ft	Vertical distance below crest, ft		Converging wall length $C^A$ , ft	Gage Points, ft			Free-flow Capacities, $\text{ft}^3/\text{s}$	
	Upstream end, $W_C$ , ft	Downstream end, $W_D$ , ft	Converging Section, $L_C$	Throat section, $L_T$	Diverging section, $L_D$		Dip at Throat, $N$	Lower end of flume, $K$		$H_C$ , wall length upstream of crest <sup>B</sup>	$H_T$		Minimum	Maximum
1 in.	0.549	0.305	1.17	0.250	0.67	0.5–0.75	0.094	0.062	1.19	0.79	0.026	0.042	0.005	0.15
2 in.	0.700	0.443	1.33	0.375	0.83	0.50–0.83	0.141	0.073	1.36	0.91	0.052	0.083	0.01	0.30
3 in.	0.849	0.583	1.50	0.500	1.00	1.00–2.00	0.188	0.083	1.53	1.02	0.083	0.125	0.03	1.90
6 in.	1.30	1.29	2.00	1.00	2.00	2.0	0.375	0.25	2.36	1.36	0.167	0.25	0.05	3.90
9 in.	1.88	1.25	2.83	1.00	1.50	2.5	0.375	0.25	2.88	1.93	0.167	0.25	0.09	8.90
1.0 ft	2.77	2.00	4.41	2.0	3.0	3.0	0.75	0.25	4.50	3.00	0.167	0.25	0.11	16.1
1.5 ft	3.36	2.50	4.66	2.0	3.0	3.0	0.75	0.25	4.75	3.17	0.167	0.25	0.15	24.6
2.0 ft	3.96	3.00	4.91	2.0	3.0	3.0	0.75	0.25	5.00	3.33	0.167	0.25	0.42	33.1
3.0 ft	5.16	4.00	5.40	2.0	3.0	3.0	0.75	0.25	5.50	3.67	0.167	0.25	0.61	50.4
4.0 ft	6.35	5.00	5.88	2.0	3.0	3.0	0.75	0.25	6.00	4.00	0.167	0.25	1.30	67.9
5.0 ft	7.55	6.00	6.38	2.0	3.0	3.0	0.75	0.25	6.50	4.33	0.167	0.25	1.60	85.6
6.0 ft	8.75	7.00	6.86	2.0	3.0	3.0	0.75	0.25	7.0	4.67	0.167	0.25	2.60	103.5
7.0 ft	9.95	8.00	7.35	2.0	3.0	3.0	0.75	0.25	7.5	5.0	0.167	0.25	3.00	121.4
8.0 ft	11.15	9.00	7.84	2.0	3.0	3.0	0.75	0.25	8.0	5.33	0.167	0.25	3.50	139.5
10 ft	15.60	12.00	14.0	3.0	6.0	4.0	1.12	0.50	9.0	6.00	...	...	6	300
12 ft	18.40	14.67	16.0	3.0	8.0	5.0	1.12	0.50	10.0	6.67	...	...	8	520
15 ft	25.0	18.33	25.0	4.0	10.0	6.0	1.50	0.75	11.5	7.67	...	...	8	900
20 ft	30.0	24.00	25.0	6.0	12.0	7.0	2.25	1.00	14.0	9.33	...	...	10	1340
25 ft	35.0	29.33	25.0	6.0	13.0	7.0	2.25	1.00	16.5	11.00	...	...	15	1660
30 ft	40.4	34.67	26.0	6.0	14.0	7.0	2.25	1.00	19.0	12.67	...	...	15	1990
40 ft	50.8	45.33	27.0	6.0	16.0	7.0	2.25	1.00	24.0	16.00	...	...	20	2640
50 ft	60.8	56.67	27.0	6.0	20.0	7.0	2.25	1.00	29.0	19.33	...	...	25	3280

<sup>A</sup>For sizes 1 to 8 ft,  $C = W_T/2 + 4$  ft.

<sup>B</sup> $H_C$  located  $2/3 C$  distance from crest for all sizes; distance is wall length, not axial.

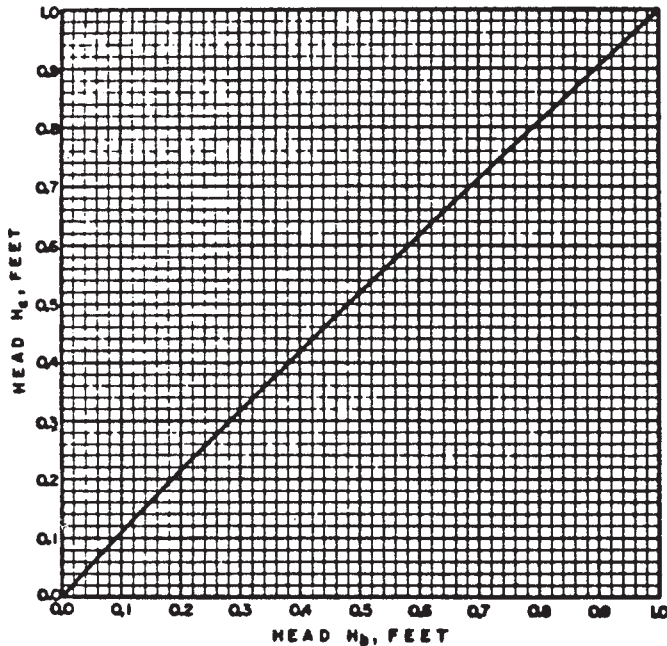

NOTE 1—1 ft = 30.48 cm

FIG. 2 Relation Between  $H_b$  and  $H_c$  for 1, 2, and 3-in. (2.54, 5.08, and 7.62-cm) flumes (Reference (2))

TABLE 2 Free-Flow Values of  $C$  and  $n$  for Parshall Flumes (See Eq 1)

Throat Width	$C^A$		$n$	$Q$ , min <sup>B</sup>		$Q$ , max <sup>B</sup>		
	ft-in	cm		inch-pound	SI	$\text{ft}^3/\text{s}$	$\text{m}^3 \times 10^{-3}/\text{s}$	$\text{ft}^3/\text{s}$
0-1	2.54	0.338	0.0479	1.55	0.01	0.28	0.2	0.0057
0-2	5.08	0.676	0.0959	1.55	0.02	0.56	0.5	0.014
0-3	7.62	0.992	0.141	1.55	0.03	0.85	1.1	0.031
0-6	15.24	2.06	0.264	1.58	0.05	1.42	3.9	0.11
0-9	22.80	3.07	0.393	1.53	0.09	2.55	8.9	0.25
1-0	30.48	4.00	0.624	1.522	0.11	3.1	16.1	0.46
1-6	45.72	6.00	0.887	1.538	0.15	4.2	24.6	0.69
2-0	60.96	8.00	1.135	1.550	0.42	11.9	38.1	0.93
3-0	91.44	12.00	1.612	1.566	0.61	17.3	50.4	1.42
4-0	121.92	16.00	2.062	1.578	1.3	36.8	67.9	1.92
5-0	152.40	20.00	2.500	1.587	1.6	45.3	85.6	2.42
6-0	182.88	24.00	2.919	1.595	2.6	73.6	103.5	2.93
7-0	213.36	28.00	3.337	1.601	3.0	85.0	121.4	3.44
8-0	243.84	32.00	3.736	1.607	3.5	99.1	139.5	3.95
10-0	304.8	39.38	4.709	1.6	6	170	200	5.6
12-0	365.8	46.75	5.590	1.6	8	227	350	9.9
19-0	457.2	57.81	6.912	1.6	8	227	600	17.0
20-0	609.6	76.25	9.117	1.6	10	283	1000	28.3
25-0	762.0	94.69	11.32	1.6	15	425	1200	34.0
30-0	914.4	113.13	13.53	1.6	15	425	1500	42.5
40-0	1219.2	150.00	17.94	1.6	20	566	2000	56.6
50-0	1524.0	186.88	22.35	1.6	25	708	3000	84.9

<sup>A</sup>Listed values of  $C$  should be used in Eq 1 with  $H_a$  in feet to obtain flowrate in cubic feet per second. Listed values of  $C$  (metric) should be used with  $H_a$  in centimetres to obtain flowrate in litres per second.

<sup>B</sup>From Ref (1).

**TABLE 3 Flume, 1-in. (2.54-cm), Submerged—Flowrate, ft<sup>3</sup>/s**

Sub-merged, %	$H_a$ , ft															
	0.05	0.06	0.08	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.55	0.60	0.70	0.80
50	0.0033	0.0044	0.0067	0.0095	0.0180	0.028	0.039	0.052	0.066	0.082	0.097	...	...	...	...	...
55	0.0032	0.0043	0.0066	0.0094	0.0180	0.028	0.038	0.052	0.065	0.081	0.096	...	...	...	...	...
60	0.0032	0.0042	0.0065	0.0093	0.0179	0.027	0.038	0.051	0.064	0.079	0.094	...	...	...	...	...
65	0.0031	0.0041	0.0064	0.0090	0.0173	0.026	0.037	0.050	0.061	0.076	0.091	...	...	...	...	...
70	0.0030	0.0040	0.0062	0.0087	0.0165	0.025	0.035	0.047	0.058	0.072	0.087	...	...	...	...	...
75	...	0.0038	0.0059	0.0083	0.0156	0.024	0.033	0.044	0.055	0.068	0.081	0.096	...	...	...	...
80	...	0.0036	0.0055	0.0077	0.0145	0.022	0.031	0.040	0.051	0.063	0.074	0.088	0.100	...	...	...
85	...	0.0032	0.0050	0.0069	0.0130	0.020	0.028	0.036	0.045	0.056	0.066	0.077	0.090	0.100	...	...
90	...	...	0.0042	0.0060	0.0112	0.017	0.024	0.031	0.038	0.046	0.055	0.064	0.074	0.083	...	...
95	...	...	0.0034	0.0048	0.0089	0.014	0.018	0.024	0.030	0.037	0.042	0.050	0.056	0.062	0.075	0.090

**TABLE 4 Flume, 2-in. (5.08-cm), Submerged—Flowrate, ft<sup>3</sup>/s**

Sub-merged, %	$H_a$ , ft															
	0.06	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.55	0.60	0.70	0.80	0.90	1.00
50	0.0086	0.0189	0.0350	0.0554	0.080	0.103	0.137	0.165	0.200	0.230	0.271	0.314	...	...	...	...
55	0.0086	0.0188	0.0350	0.0550	0.079	0.103	0.136	0.163	0.198	0.229	0.270	0.314	0.382	...	...	...
60	0.0085	0.0185	0.0345	0.0549	0.078	0.102	0.134	0.161	0.194	0.226	0.268	0.312	0.377	...	...	...
65	0.0083	0.0182	0.0340	0.0534	0.077	0.101	0.132	0.158	0.190	0.223	0.263	0.307	0.371	...	...	...
70	0.0080	0.0175	0.0332	0.0520	0.075	0.098	0.129	0.154	0.186	0.216	0.254	0.296	0.361	...	...	...
75	0.0077	0.0164	0.0312	0.0498	0.072	0.093	0.123	0.148	0.179	0.207	0.242	0.282	0.344	...	...	...
80	0.0071	0.0152	0.0289	0.0458	0.067	0.087	0.114	0.139	0.167	0.193	0.228	0.261	0.326	0.396	...	...
85	...	0.0138	0.0258	0.0409	0.060	0.080	0.101	0.126	0.151	0.176	0.203	0.235	0.300	0.358	...	...
90	...	0.0117	0.0212	0.0346	0.049	0.067	0.087	0.104	0.129	0.150	0.177	0.200	0.259	0.315	0.369	...
95	...	0.0088	0.0158	0.0244	0.035	0.047	0.064	0.078	0.092	0.111	0.130	0.150	0.198	0.250	0.300	0.350

**TABLE 5 Flume, 3-in. (7.62-cm), Submerged—Flowrate, ft<sup>3</sup>/s**

Sub-merged, %	$H_a$ , ft																	
	0.12	0.16	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.55	0.60	0.70	0.80	0.90	1.0	1.2	1.4	1.6
50	0.037	0.057	0.082	0.117	0.156	0.195	0.240	0.287	0.335	0.397	0.450	0.562	0.700	0.841	0.977	1.31	...	...
55	0.037	0.057	0.082	0.117	0.156	0.194	0.239	0.286	0.334	0.394	0.448	0.561	0.696	0.836	0.974	1.31	...	...
60	0.037	0.057	0.082	0.116	0.155	0.192	0.238	0.285	0.333	0.390	0.443	0.559	0.686	0.826	0.967	1.29	...	...
65	0.037	0.057	0.082	0.115	0.154	0.191	0.236	0.282	0.331	0.383	0.436	0.557	0.680	0.817	0.958	1.27	...	...
70	0.036	0.056	0.080	0.113	0.150	0.188	0.230	0.277	0.325	0.374	0.425	0.545	0.665	0.800	0.935	1.25	...	...
75	0.036	0.055	0.077	0.108	0.144	0.182	0.221	0.264	0.312	0.359	0.408	0.520	0.642	0.763	0.900	1.19	1.49	...
80	0.034	0.052	0.073	0.101	0.136	0.171	0.206	0.247	0.293	0.339	0.383	0.488	0.604	0.712	0.841	1.12	1.41	...
85	0.031	0.047	0.066	0.092	0.123	0.153	0.188	0.223	0.263	0.309	0.350	0.439	0.545	0.651	0.758	1.00	1.28	...
90	...	0.041	0.057	0.081	0.104	0.134	0.163	0.192	0.225	0.264	0.304	0.379	0.465	0.562	0.653	0.853	1.09	1.33
95	...	0.033	0.045	0.062	0.081	0.098	0.125	0.148	0.174	0.198	0.228	0.290	0.355	0.422	0.500	0.648	0.815	0.988

Table 7 (Table 8, Table 9, Table 10, Table 11, and Table 12), which were compiled from published curves (2).

7.4.2.2 For all larger flumes, that is, 1 to 50 ft (30.48 to 1524 cm) throat widths, flowrates under submerged-flow conditions are given as corrections to be subtracted from the free-flow discharge at the same  $H_a$ . These corrections are found in Table 13, Table 14, Table 15, and Table 16 (Table 17, Table 14, Table 18, and Table 16), which were compiled from published curves (2).

7.4.2.3 It is recommended that submergence be avoided if possible and that ratios not be allowed to exceed 0.95.

### 7.5 Installation Requirements:

7.5.1 It is highly desirable that the Parshall flume installation be designed for free flow. The depth-discharge relations for free flow are more accurate than those for submerged flow, particularly at high submergence ratios. Further, the secondary instrumentation for free flow is simpler and more readily available. Design for free flow requires an estimate of the

normal depth of flow in the channel downstream of the flume and the assumption that the resulting surface elevation prevails approximately at the  $H_b$  location. Design examples are available in the References.

7.5.2 The flow entering the flume should be tranquil and uniformly distributed across the channel. For this purpose, *uniform* velocity distribution can be defined as that associated with fully developed flow in a long, straight, moderately smooth channel. As a general guideline, a straight upstream approach length of 10 to 20 times the throat width will meet this entrance condition. The adequacy of the approach flow must be demonstrated on a case-by-case basis using current-meter traverses, experience with similar situations, or analytical approximations.

7.5.3 If the approach flow is supercritical, the installation should be designed so that a hydraulic jump is formed at a distance upstream of at least 30  $H_a$ . If the existence of the

TABLE 6 Flume, 6-in. (15.24-cm), Submerged—Flowrate, ft<sup>3</sup>/s

Sub-merged, %	$H_a$ , ft														
	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5
60	0.050	0.162	0.300	0.462	0.655	0.870	1.12	1.40	1.70	2.00	2.34	2.68	3.03	3.38	3.77
62	0.050	0.160	0.297	0.458	0.651	0.865	1.12	1.39	1.67	1.98	2.32	2.65	3.00	3.36	3.74
64	0.050	0.158	0.291	0.455	0.646	0.859	1.11	1.38	1.66	1.96	2.29	2.63	2.97	3.33	3.71
66	0.050	0.156	0.287	0.452	0.639	0.854	1.10	1.37	1.64	1.94	2.26	2.60	2.94	3.30	3.67
68	0.050	0.154	0.285	0.445	0.633	0.849	1.09	1.35	1.63	1.93	2.24	2.56	2.90	3.26	3.64
70	0.050	0.152	0.283	0.440	0.624	0.839	1.07	1.34	1.60	1.90	2.20	2.53	2.85	3.22	3.60
72	0.050	0.150	0.278	0.432	0.617	0.828	1.06	1.33	1.57	1.86	2.16	2.49	2.80	3.17	3.54
74	0.050	0.147	0.274	0.424	0.607	0.817	1.04	1.30	1.54	1.83	2.13	2.44	2.75	3.11	3.47
76	0.050	0.144	0.270	0.414	0.593	0.802	1.02	1.26	1.52	1.80	2.09	2.39	2.70	3.04	3.40
78	0.050	0.141	0.263	0.402	0.580	0.782	1.00	1.23	1.47	1.75	2.04	2.33	2.64	2.97	3.32
80	0.048	0.137	0.252	0.389	0.564	0.764	0.97	1.20	1.44	1.70	1.97	2.26	2.56	2.89	3.22
82	0.045	0.131	0.243	0.377	0.540	0.741	0.94	1.16	1.40	1.65	1.90	2.19	2.48	2.80	3.10
84	0.042	0.125	0.235	0.356	0.520	0.709	0.90	1.12	1.34	1.59	1.83	2.11	2.39	2.68	2.99
86	0.040	0.121	0.224	0.342	0.498	0.674	0.87	1.07	1.29	1.52	1.75	2.02	2.29	2.56	2.85
88	0.038	0.115	0.211	0.322	0.471	0.638	0.82	1.02	1.23	1.44	1.67	1.92	2.17	2.44	2.72
90	0.035	0.106	0.196	0.300	0.438	0.593	0.76	0.95	1.15	1.36	1.57	1.80	2.04	2.30	2.55
92	0.030	0.100	0.175	0.278	0.402	0.544	0.70	0.88	1.07	1.26	1.47	1.67	1.91	2.14	2.38
94	0.028	0.088	0.155	0.250	0.359	0.487	0.64	0.80	0.97	1.15	1.35	1.54	1.74	1.95	2.17
95	0.025	0.083	0.145	0.230	0.330	0.453	0.60	0.75	0.86	1.03	1.21	1.45	1.64	1.85	2.06

TABLE 7 Flume, 9-in. (22.86-cm), Submerged—Flowrate, ft<sup>3</sup>/s

Sub-merged, %	$H_a$ , ft														
	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5
60	0.093	0.276	0.490	0.750	1.05	1.37	1.75	2.17	2.57	3.02	3.52	4.06	4.57	5.10	5.65
62	0.093	0.276	0.486	0.747	1.05	1.37	1.75	2.16	2.56	3.01	3.50	4.04	4.55	5.07	5.62
64	0.090	0.272	0.479	0.745	1.04	1.36	1.74	2.15	2.55	3.00	3.48	4.01	4.52	5.04	5.58
66	0.090	0.269	0.476	0.739	1.04	1.35	1.73	2.13	2.53	2.97	3.45	3.97	4.48	5.00	5.54
68	0.089	0.262	0.472	0.732	1.03	1.34	1.72	2.12	2.52	2.95	3.43	3.94	4.44	4.96	5.50
70	0.087	0.259	0.469	0.726	1.02	1.33	1.70	2.10	2.49	2.93	3.40	3.90	4.40	4.91	5.45
72	0.084	0.252	0.466	0.719	1.01	1.32	1.68	2.07	2.46	2.90	3.35	3.85	4.34	4.85	5.39
74	0.081	0.247	0.459	0.707	1.00	1.31	1.66	2.04	2.44	2.87	3.32	3.80	4.30	4.80	5.33
76	0.077	0.240	0.450	0.697	0.98	1.30	1.64	2.02	2.40	2.83	3.26	3.74	4.23	4.73	5.25
78	0.076	0.234	0.440	0.687	0.96	1.27	1.62	1.98	2.36	2.79	3.21	3.68	4.16	4.65	5.16
80	0.074	0.231	0.431	0.671	0.94	1.25	1.59	1.94	2.32	2.73	3.15	3.61	4.09	4.57	5.06
82	0.071	0.223	0.421	0.658	0.92	1.23	1.55	1.90	2.26	2.67	3.07	3.52	4.00	4.46	4.95
84	0.065	0.213	0.407	0.639	0.90	1.20	1.50	1.84	2.20	2.60	3.00	3.42	3.89	4.34	4.80
86	0.061	0.200	0.397	0.619	0.85	1.16	1.46	1.77	2.13	2.50	2.90	3.30	3.74	4.20	4.64
88	0.058	0.193	0.377	0.593	0.81	1.10	1.40	1.70	2.04	2.39	2.76	3.14	3.59	4.00	4.44
90	0.055	0.183	0.361	0.562	0.77	1.05	1.33	1.61	1.94	2.25	2.60	2.97	3.37	3.76	4.20
92	0.048	0.169	0.334	0.521	0.72	0.97	1.23	1.50	1.80	2.10	2.41	2.75	3.10	3.47	3.87
94	0.039	0.155	0.300	0.470	0.65	0.87	1.11	1.36	1.64	1.90	2.20	2.47	2.80	3.10	3.43
95	0.035	0.141	0.276	0.438	0.61	0.82	1.05	1.28	1.55	1.80	2.05	2.31	2.60	2.90	3.19

TABLE 8 Flume, 2.54-cm (1-in.), Submerged—Flowrate, L/s

Sub-merged, %	$H_a$ , cm																
	2	3	4	5	6	7	8	9	10	11	12	13	14	15	18	21	24
50	0.142	0.263	0.419	0.586	0.767	0.971	1.19	1.44	1.70	1.98	2.27	2.55	...	...	...	...	...
55	0.139	0.261	0.416	0.586	0.762	0.960	1.17	1.43	1.67	1.95	2.24	2.52	...	...	...	...	...
60	0.136	0.258	0.413	0.578	0.748	0.949	1.16	1.40	1.64	1.90	2.18	2.41	...	...	...	...	...
65	0.133	0.249	0.399	0.561	0.725	0.917	1.12	1.37	1.59	1.81	2.10	2.41	...	...	...	...	...
70	0.130	0.241	0.382	0.535	0.694	0.878	1.07	1.29	1.50	1.73	1.98	2.27	...	...	...	...	...
75	0.125	0.229	0.362	0.510	0.665	0.841	1.02	1.21	1.42	1.64	1.87	2.12	2.38	2.66	...	...	...
80	0.116	0.212	0.337	0.473	0.623	0.779	0.934	1.11	1.33	1.53	1.76	1.95	2.18	2.44	...	...	...
85	0.105	0.190	0.303	0.425	0.555	0.697	0.841	1.00	1.16	1.33	1.36	1.73	1.93	2.12	2.78	...	...
90	...	0.160	0.261	0.362	0.467	0.595	0.725	0.858	0.99	1.13	1.27	1.44	1.61	1.78	2.79	...	...
95	...	0.133	0.207	0.289	0.374	0.462	0.555	0.665	0.76	0.91	1.02	1.13	1.22	1.39	1.73	2.10	1.49

hydraulic jump closer to the flume is unavoidable, the adequacy of the entering flow should be demonstrated as in 7.5.2.

7.5.4 The flume should be constructed and installed so that the floor of the converging section is level to within a slope not to exceed 0.01 ft in any dimension, or a re-rating is necessary.

### 7.6 Secondary Instrumentation:

7.6.1 A minimal secondary system for continuous monitoring would contain a depth-sensing device and a depth indicator or recorder from which the user could determine flowrates from the depth-discharge relations. Optionally, the secondary





TABLE 9 Flume, 5.08-cm (2-in.), Submerged—Flowrate, L/s

Submerged, %	$H_a$ , cm																
	2	3	4	5	6	7	8	9	10	11	12	15	18	21	24	27	30
50	0.28	0.52	0.82	1.15	1.53	1.98	2.44	2.86	3.45	4.05	4.59	6.37	8.67	...	...	...	...
55	0.28	0.52	0.82	1.15	1.52	1.95	2.41	2.86	3.43	4.02	4.53	6.34	8.67	10.62	...	...	...
60	0.27	0.51	0.80	1.14	1.50	1.93	2.38	2.83	3.40	3.96	4.47	6.26	8.61	10.48	...	...	...
65	0.27	0.50	0.79	1.12	1.48	1.90	2.35	2.80	3.34	3.91	4.39	6.17	8.47	10.31	...	...	...
70	0.26	0.48	0.77	1.09	1.44	1.87	2.29	2.72	3.26	3.79	4.28	5.97	8.16	10.02	...	...	...
75	0.25	0.45	0.72	1.03	1.38	1.78	2.18	2.61	3.11	3.62	4.11	5.75	7.79	9.54	...	...	...
80	0.23	0.42	0.67	0.95	1.27	1.67	2.04	2.44	2.89	3.40	3.85	5.35	7.22	9.03	10.96	...	...
85	0.20	0.38	0.60	0.85	1.13	1.47	1.84	2.24	2.61	3.03	3.48	4.87	6.48	8.30	9.91	...	...
90	...	0.32	0.50	0.71	0.96	1.22	1.50	1.87	2.21	2.58	2.89	4.16	5.55	7.16	8.72	10.22	...
95	...	0.24	0.37	0.52	0.68	0.88	1.08	1.30	1.61	1.90	2.15	3.06	4.13	5.47	6.88	8.30	9.68

TABLE 10 Flume, 7.62-cm (3-in.), Submerged—Flowrate, L/s

Submerged, %	$H_a$ , cm																	
	4	6	8	10	12	14	16	18	20	22	24	27	30	33	36	39	42	45
50	1.19	2.27	3.57	5.04	6.65	8.38	10.36	12.46	14.53	16.76	19.31	23.25	27.04	31.7	36.4	...	...	...
55	1.19	2.27	3.57	5.01	6.63	8.35	10.31	12.40	14.47	16.74	19.20	23.11	26.96	31.4	36.3	...	...	...
60	1.19	2.27	3.54	4.98	6.57	8.33	10.25	12.26	14.39	16.62	18.94	22.82	26.73	31.1	35.7	...	...	...
65	1.19	2.27	3.51	4.96	6.54	8.24	10.11	12.06	14.27	16.54	18.80	22.60	26.48	30.9	35.1	...	...	...
70	1.19	2.21	3.45	4.84	6.37	8.10	9.91	11.78	13.93	16.17	18.38	22.12	25.85	30.3	34.5	...	...	...
75	1.16	2.12	3.31	4.67	6.12	7.73	9.51	11.30	13.34	15.49	17.73	21.12	24.86	29.3	32.8	37.1	41.3	...
80	1.10	2.01	3.09	4.42	5.72	7.22	8.95	10.62	12.52	14.55	16.68	19.74	23.22	27.2	30.9	35.1	39.1	...
85	0.99	1.84	2.80	3.96	5.21	6.51	8.10	9.71	11.33	13.08	15.04	18.01	20.98	24.4	27.8	31.4	35.4	...
90	...	1.59	2.46	3.43	4.53	5.61	6.91	8.41	9.80	11.27	12.86	15.52	18.07	20.8	23.6	26.9	30.0	33.4
95	...	1.25	1.90	2.58	3.45	4.33	5.27	6.31	7.45	8.61	9.83	11.69	13.82	15.9	17.9	20.2	22.6	24.9

TABLE 11 Flume, 15.24-cm (6-in.), Submerged—Flowrate, L/s

Submerged, %	$H_a$ , cm														
	4	6	9	12	15	18	21	24	27	30	33	36	39	42	45
60	2.41	4.50	8.30	12.80	18.12	24.1	30.9	38.5	47.0	55.2	64.6	74.2	83.8	93.4	104.2
62	2.38	4.45	8.21	12.69	18.01	24.0	30.9	38.2	46.4	54.7	64.0	73.3	83.0	92.9	103.4
64	2.36	4.39	8.04	12.60	17.87	23.8	30.6	37.9	45.9	54.1	63.1	72.8	82.1	92.0	102.5
66	2.35	4.33	7.93	12.52	17.67	23.6	30.3	37.7	45.3	53.5	62.6	71.9	81.3	91.2	101.4
68	2.32	4.28	7.87	12.32	17.50	23.5	30.0	37.4	45.0	53.2	62.0	70.8	80.1	90.0	100.5
70	2.31	4.22	7.82	12.20	17.25	23.2	29.4	36.8	44.2	52.4	60.9	69.9	79.0	88.9	99.4
72	2.29	4.16	7.70	11.98	17.05	22.9	29.2	36.5	43.6	51.2	59.7	68.8	77.6	87.5	97.7
74	2.27	4.08	7.59	11.75	16.76	22.6	28.9	36.0	42.8	50.4	58.9	67.4	76.2	85.8	95.7
76	2.24	3.99	7.48	11.47	16.40	22.2	28.3	34.8	41.9	49.8	57.8	66.0	74.8	84.1	98.7
78	2.21	3.91	7.28	11.16	16.03	21.6	27.8	34.0	40.8	48.4	56.4	64.3	73.1	82.1	91.7
80	2.15	3.79	6.97	10.79	15.57	21.1	26.9	33.1	39.9	47.0	54.4	62.3	70.8	79.9	88.9
82	2.04	3.62	6.71	10.45	14.92	20.5	26.1	32.0	38.8	45.6	52.7	60.3	68.5	77.3	85.8
84	1.93	3.48	6.48	9.88	14.36	19.6	24.9	30.9	37.1	43.7	50.7	58.5	66.0	74.2	82.7
86	1.84	3.37	6.20	9.49	13.76	18.6	24.1	29.4	35.7	41.9	48.4	55.8	63.4	70.8	78.7
88	1.76	3.20	5.83	8.92	13.00	17.6	22.7	28.0	34.0	39.9	46.2	53.0	60.0	67.4	75.0
90	1.61	2.94	5.41	8.33	12.09	16.4	21.0	26.3	31.7	37.7	42.3	49.8	56.4	63.4	70.5
92	1.47	2.78	4.84	7.70	11.10	15.0	19.3	24.4	29.4	34.8	40.5	46.2	52.7	59.2	65.7
94	1.33	2.44	4.30	6.91	9.91	13.4	17.6	22.1	26.9	31.7	37.4	42.5	48.1	53.8	60.0
95	1.22	2.29	4.02	6.37	9.12	12.5	16.4	20.7	23.8	28.3	33.4	39.6	45.3	51.0	56.9

system could convert the measured depth to an indicated or recorded flowrate, or both, and totalized flow, and further could transmit the information electrically or pneumatically to a central location.

7.6.2 Continuous depth measurements can be made with several types of sensors including, but not restricted to, the following:

7.6.2.1 Floats, such as, cylindrical (3) and scow types;

7.6.2.2 Pressure sensors, such as, bubble types (3) and (4), diaphragm gages;

7.6.2.3 Acoustic sensors;

7.6.2.4 Electrical sensors, such as, resistance, capacitance, and oscillating probes.

## 8. Sampling

8.1 Sampling as defined in Terminology D 1129 is not applicable in this test method.

## 9. Calibration

9.1 An in-place calibration of the entire flume system is recommended for highest accuracy. However, calibration of the secondary instrument alone can sometimes be a sufficient



TABLE 12 Flume, 22.86-cm (9-in.), Submerged—Flowrate, L/s

Submerged, %	$H_a$ , cm														
	3	6	9	12	15	18	21	24	27	30	33	36	39	42	45
60	2.52	7.67	13.6	20.8	29.2	37.9	48.4	60.0	71.1	83.5	97.4	112	127	141	156
62	2.52	7.67	13.5	20.7	29.0	37.9	48.4	59.7	70.8	83.3	96.8	112	126	140	155
64	2.45	7.56	13.3	20.6	28.7	37.7	48.1	59.5	70.5	83.0	96.3	111	125	139	154
66	2.45	7.48	13.2	20.5	28.7	37.4	47.9	58.9	69.9	82.1	95.4	110	124	138	153
68	2.42	7.28	13.1	20.3	28.6	37.1	47.6	58.6	69.7	81.6	94.9	109	123	137	152
70	2.38	7.19	13.0	20.1	28.3	36.8	47.0	58.0	69.1	81.0	94.0	108	122	136	151
72	2.29	6.99	12.9	19.9	28.0	36.5	46.4	57.2	68.2	80.1	92.6	106	120	134	149
74	2.21	6.85	12.7	19.6	27.8	36.2	45.9	56.9	67.4	79.3	91.7	105	119	132	147
76	2.10	6.65	12.5	19.3	27.2	36.0	45.3	55.8	66.5	78.2	90.3	103	117	131	145
78	2.07	6.48	12.2	19.0	26.6	35.1	44.7	54.7	65.4	77.3	88.9	102	115	129	143
80	2.01	6.40	11.9	18.6	26.1	34.5	43.9	53.5	64.3	75.4	87.2	100	113	126	140
82	1.93	6.17	11.6	18.2	25.5	34.0	42.8	52.4	62.6	73.6	85.0	97	110	123	137
84	1.76	5.92	11.2	17.7	24.9	33.1	41.6	51.0	60.9	71.9	83.0	95	107	120	133
86	1.64	5.55	11.0	17.2	23.5	32.0	40.5	49.0	58.9	69.1	80.1	91	103	116	129
88	1.56	5.35	10.4	16.4	22.4	30.3	38.8	47.0	56.4	66.0	76.5	87	99	111	123
90	1.47	5.07	10.0	15.6	21.2	28.9	36.8	44.5	53.5	62.3	71.9	82	93	104	116
92	1.30	4.67	9.2	14.4	19.8	26.9	34.0	41.3	49.8	58.0	66.8	76	86	96	107
94	1.05	4.30	8.3	13.0	18.1	24.1	30.6	37.7	45.3	52.7	60.9	68	77	86	95
95	0.93	3.91	7.6	12.1	17.0	22.7	28.9	35.4	42.8	49.8	56.9	64	72	80	88

TABLE 13 Flume, 1-ft (30.48-cm), Submerged—Flowrate Correction, ft<sup>3</sup>/s, To Be Subtracted from Free-Flow Discharge

Submerged, %	$H_a$ , ft															
	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.3	1.5	1.7	1.9	2.1	2.3	2.5
60	0.067	0.071	0.075	0.082	0.090	0.100	0.113	0.130	0.149	0.193	0.250	0.32	0.40	0.49	0.59	0.69
72	0.072	0.076	0.083	0.092	0.104	0.117	0.135	0.154	0.178	0.237	0.31	0.40	0.49	0.60	0.71	0.83
74	0.077	0.082	0.093	0.165	0.120	0.139	0.162	0.189	0.220	0.292	0.38	0.44	0.60	0.74	0.90	1.07
76	0.083	0.092	0.105	0.121	0.143	0.168	0.197	0.234	0.270	0.36	0.47	0.60	0.74	0.90	1.10	1.30
78	0.089	0.102	0.121	0.143	0.172	0.204	0.242	0.284	0.33	0.44	0.57	0.72	0.90	1.12	1.34	1.59
80	0.097	0.116	0.140	0.172	0.209	0.250	0.298	0.35	0.41	0.55	0.71	0.90	1.12	1.37	1.63	1.92
82	0.109	0.132	0.165	0.203	0.252	0.31	0.37	0.44	0.52	0.68	0.87	1.12	1.38	1.66	1.98	2.33
84	0.123	0.155	0.198	0.250	0.31	0.38	0.45	0.54	0.64	0.83	1.09	1.36	1.67	2.01	2.38	2.78
86	0.142	0.185	0.240	0.300	0.38	0.47	0.56	0.67	0.79	1.04	1.33	1.66	2.03	2.43	2.87	3.34
88	0.166	0.221	0.292	0.37	0.47	0.58	0.70	0.83	0.97	1.28	1.64	2.03	2.46	2.94	3.45	4.00
90	0.200	0.274	0.367	0.47	0.60	0.73	0.88	1.03	1.20	1.58	2.00	2.47	2.98	3.53	4.12	4.75
92	0.245	0.340	0.46	0.59	0.74	0.91	1.09	1.29	1.49	1.95	2.46	3.01	3.61	4.26	4.95	5.68
94	0.300	0.430	0.59	0.75	0.93	1.14	1.36	1.61	1.87	2.42	3.03	3.69	4.41	5.17	5.97	6.83
95	0.338	0.482	0.66	0.84	1.05	1.28	1.53	1.80	2.10	2.71	3.38	4.10	4.88	5.71	6.58	7.50

TABLE 14 Multiplying Factors for Larger Flumes

Throat width		Multiply amount in Table 13 or Table 17 by
cm	ft	
45.7	1.5	1.4
61.0	2	1.8
91.4	3	2.4
121.9	4	3.1
152.4	5	3.7
182.9	6	4.3
213.4	7	4.9
243.8	8	5.4

procedure provided the flume itself meets all the fabrication and installation requirements of 7.2 and 7.5 and provided further that the basic error associated with such a standard flume (see 11.1) is acceptable for the specific measurement purpose.

9.2 *Calibrating the Secondary System:*

9.2.1 To check the secondary instrument, it is necessary to make independent reference depth measurements with a scale or preferably a point gage. This measurement is most accurately made in the stilling well or in an auxiliary well as needed. The zero of the scale or point gage must be carefully referenced to the crest elevation.

9.2.2 The depth indicated by the secondary instrument is compared with the reference depth (9.2.1). If the secondary readout is in terms of flowrate, the indicated flowrate is compared with the flowrate computed from the reference depth, Eq 1 and Table 1. Repetition of this process over a range of depths will indicate whether zero or span adjustment is needed. Repetition of individual points will provide data on the precision of the system.

9.3 *Calibrating the Complete System:*

9.3.1 Methods for in-place flume calibration include:

- 9.3.1.1 Velocity-area traverse (Test Method D 3858);
- 9.3.1.2 Dye dilution (ISO 555);
- 9.3.1.3 Salt velocity;
- 9.3.1.4 Volumetric;
- 9.3.1.5 Comparison with reference flowrate meter.

9.3.2 There is no single method that is applicable to all field situations, and in many cases only the methods in 9.3.1.1 and 9.3.1.2 can even be considered. For example, suitable basins and connecting conduits for direct volumetric calibration of large flows are seldom available and a reference flowmeter, such as, Venturi meter, weir, for which published standards exist, can be used only where there is adequate approach length

TABLE 15 Flume, 10-ft (304.8-cm), Submerged—Flowrate Correction, ft<sup>3</sup>/s, To Be Subtracted from Free-Flow Discharge

Submerged, %	$H_a$ , ft																					
	0.5	0.6	0.7	0.8	0.9	1.0	1.2	1.4	1.6	1.8	2.0	2.2	2.4	2.6	2.8	3.0	3.5	4.0	4.5	5.0	5.5	6.0
80	...	...	...	...	...	...	...	...	0.60	0.76	0.94	1.15	1.37	1.59	1.84	2.15	2.92	3.82	4.84	5.90	7.25	8.50
81	...	...	...	...	...	...	...	0.64	0.84	1.08	1.35	1.60	1.92	2.25	2.64	3.00	4.12	5.36	6.85	8.36	10.34	12.3
82	...	...	...	...	...	...	0.64	0.88	1.17	1.45	1.81	2.18	2.62	3.00	3.52	4.06	5.56	7.24	9.24	11.6	14.0	16.5
83	...	...	...	...	...	0.60	0.86	1.19	1.50	1.94	2.43	2.88	3.46	4.00	4.65	5.41	7.34	9.60	12.5	15.0	18.4	21.8
84	...	...	...	0.50	0.63	0.78	1.13	1.50	1.99	2.57	3.11	3.79	4.45	5.24	6.06	7.00	9.67	12.8	16.2	19.8	24.7	28.6
86	...	...	0.61	0.81	1.03	1.30	1.83	2.50	3.21	4.08	5.00	6.09	7.28	8.48	9.90	11.7	15.7	20.5	26.6	32.1	39.2	46.4
88	0.50	0.69	0.94	1.27	1.58	1.95	2.78	3.79	4.91	6.27	7.69	9.29	11.2	13.2	15.0	17.7	24.5	31.6	39.8	49.1	60.0	70.4
90	0.71	0.99	1.35	1.76	2.25	2.78	3.92	5.32	6.97	8.84	11.1	13.4	15.8	18.6	21.6	25.6	34.4	44.7	57.4	69.4	85.6	101
92	0.99	1.39	1.87	2.48	3.10	3.85	5.50	7.45	9.81	12.7	15.2	18.6	22.4	26.3	30.0	35.2	48.1	63.0	80.0	99.1	120	140
94	1.35	1.86	2.55	3.33	4.21	5.21	7.38	10.0	13.4	16.8	20.7	25.5	30.0	35.0	40.2	47.4	64.8	84.8	108	132	160	190
95	1.52	2.42	2.89	3.82	4.80	5.95	8.44	11.8	15.0	19.3	24.1	28.8	34.5	39.8	46.6	54.4	73.7	97.3	122	150	184	218

TABLE 16 Multiplying Factors for Larger Flumes

Throat width		Multiply amount in Table 15 or Table 18 by
cm	ft	
365.8	12	1.2
457.2	15	1.5
604.6	20	2.0
762.0	25	2.5
914.4	30	3.0
1219.2	40	4.0
1524.0	50	5.0

for the standard to be applicable. On the other hand, velocity-area traverses may involve using intrusive current meters in difficult liquids such as raw sewage. Whatever method is used, the calibration tests should be conducted at enough flowrates with enough repetitions to determine the depth-discharge relation. A scale or point gage should be used to measure depths during these tests. The secondary should be calibrated separately from the primary, so that future routine performance checks need only involve the secondary provided that conditions related to the primary remain unchanged.

## 10. Procedure

10.1 After initial calibration according to 9.2 or 9.3, the secondary measurement should be compared daily with a reference measurement until a suitable frequency of monitoring can be determined from the accumulated data.

10.2 Some aspects of routine maintenance depend upon the nature of the flowing liquid. There are numerous equipment checks that should be made frequently at first—in some cases, daily—until a more suitable frequency can be derived from the performance history. These include, but are not limited to, purge flows, sediment accumulations, depth-sensor condition, flume sliming or surface deterioration, etc. In addition, maintenance should be performed on secondary instrumentation as recommended by manufacturers' instructions.

## 11. Precision and Bias

11.1 Determination of the precision and bias for this test method is not possible, both at the multiple and single operator level, due to the high degree of instability of open-channel flow. Both temporal and spatial variability of the boundary and flow conditions do not allow for a consent standard to be used for representative sampling. A minimum bias, measured under ideal conditions, is directly related to the bias of the equipment used and is listed in the remainder of this section. A maximum

precision and bias cannot be estimated due to the variability of the sources of potential errors listed in this section and the temporal and spatial variability of open-channel flow. Any estimate of these errors could be very misleading to the user.

11.2 In accordance with 1.6 of Practice D 2777, an exemption to the precision and bias statement required by Practice D 2777 was recommended by the Results Advisor and concurred with by the Technical Operations Section of the executive Subcommittee on June 15, 1990.

11.3 The accuracy of the free-flow discharge relations (Eq 1 and Table 1) can be considered to be within  $\pm 5\%$ , for flumes that meet the standard fabrication and installation requirements. The submerged-flow data are considerably less accurate and the uncertainty depends on the conditions at each installation. For flumes that are calibrated in-place, an uncertainty for the resulting depth-discharge relation should be estimated based on the method of calibration and the manner in which the tests were performed. This uncertainty should be combined with an estimated uncertainty for the secondary instrumentation.

### 11.4 Error Sources:

11.4.1 *The Flume*—There is an insufficient experimental or analytical base to evaluate errors due to non-standard flume construction or installation. However, for smaller flumes such as 1 to 3 in. (2.54 to 7.62 cm), if the throat deviates from the prescribed width by a small amount (no more than a few percent), it appears reasonable to estimate a corrected flow by applying the actual-to-standard width ratio to the standard discharge. Measurement tolerances should not exceed  $1/64$  in. (0.4 mm) for width and  $1/32$  in. (0.8 mm) for all other dimensions. The flume must be installed and maintained so that the converging section is level, both laterally and longitudinally, to obtain accurate readings. If a Parshall flume is used with shallow depth, excessive errors will result from the influence of fluid-flow properties and boundary conditions. A practical lower  $H_a$  limit of 0.1 ft (30 mm) is recommended. The approach section must be kept clear of moss or other accumulation of debris.

### 11.4.2 Secondary Instruments:

11.4.2.1 Some potential error sources are associated with specific types of secondary instruments. Examples include, but are not limited to, the following:

(a) Acoustic depth-measuring devices may incorrectly sense foamy surfaces;





TABLE 17 Flume, 1-ft (30.48-cm), Submerged—Flowrate Correction, L/s, To Be Subtracted from Free-Flow Discharge

Submerged, %	$H_a$ , cm													
	10	15	20	25	30	35	40	45	50	55	60	65	70	75
70	1.93	2.12	2.44	2.92	3.60	4.53	5.55	6.9	8.5	10.2	12.2	14.5	16.8	19.0
72	2.07	2.32	2.80	3.43	4.28	5.44	6.8	8.5	10.5	12.7	15.0	17.6	20.1	22.9
74	2.21	2.61	3.20	4.08	5.24	6.71	8.5	10.5	13.0	15.6	18.4	21.8	25.6	29.4
76	2.44	2.94	3.77	4.93	6.46	8.21	10.5	13.0	15.9	19.0	22.7	26.3	31.3	35.7
78	2.63	3.37	4.50	6.00	7.84	10.2	12.7	15.6	19.2	22.9	27.8	32.8	37.9	43.6
80	2.89	3.91	5.47	7.36	9.63	12.5	15.9	19.5	23.8	28.6	34.3	39.9	46.4	52.7
82	3.26	4.62	6.51	9.1	12.2	15.9	19.5	24.1	29.4	35.7	41.9	48.4	56.1	64.0
84	3.74	5.52	7.93	11.0	15.0	19.5	24.1	30.0	36.2	43.0	50.8	58.6	67.1	76.5
86	4.36	6.68	9.63	13.9	18.4	24.1	30.0	36.8	44.2	52.4	61.6	70.8	81.0	92.0
88	5.13	8.10	12.2	17.0	22.9	29.4	36.8	45.3	54.1	63.7	74.5	85.5	97.4	110.2
90	6.26	10.2	15.3	21.5	28.6	36.5	45.6	55.2	65.7	77.6	89.8	102.8	116.4	131.1
92	7.70	12.7	19.0	26.9	35.7	45.3	56.1	68.0	80.4	94.0	108.5	123.7	139.9	156.9
94	9.51	16.4	24.1	33.4	44.5	56.6	69.7	83.8	98.8	115.0	132.2	150.1	168.8	188.6
95	10.70	18.1	27.2	37.7	49.8	63.7	77.9	93.4	109.9	127.7	146.4	165.7	186.0	207.3

TABLE 18 Flume, 304.8-cm (10-ft), Submerged—Flowrate Correction, m<sup>3</sup>/s, To Be Subtracted from Free-Flow Discharge

Submerged, %	$H_a$ , cm																
	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8
80	...	...	...	0.0178	0.0258	0.0357	0.0459	0.0589	0.0731	0.0883	0.105	0.123	0.143	0.162	0.186	0.211	0.234
81	...	...	...	0.0252	0.0371	0.0498	0.0651	0.0827	0.103	0.124	0.147	0.174	0.202	0.230	0.265	0.300	0.340
82	...	...	0.0218	0.0348	0.0496	0.0677	0.0867	0.111	0.139	0.168	0.199	0.235	0.275	0.320	0.362	0.408	0.453
83	...	...	0.0294	0.0450	0.0665	0.0895	0.116	0.148	0.184	0.222	0.264	0.314	0.368	0.413	0.473	0.535	0.600
84	...	0.0215	0.0379	0.0597	0.0858	0.116	0.151	0.192	0.241	0.292	0.351	0.413	0.479	0.544	0.629	0.716	0.790
86	...	0.0357	0.0626	0.0957	0.138	0.189	0.245	0.320	0.394	0.473	0.564	0.671	0.782	0.883	1.008	1.141	1.274
88	0.0235	0.0535	0.0949	0.147	0.212	0.289	0.379	0.484	0.609	0.736	0.869	1.017	1.175	1.348	1.543	1.744	1.937
90	0.0337	0.0765	0.133	0.208	0.306	0.413	0.538	0.699	0.864	1.036	1.229	1.455	1.688	1.911	2.195	2.49	2.78
92	0.0470	0.106	0.187	0.294	0.421	0.578	0.759	0.963	1.201	1.453	1.730	2.039	2.367	2.721	3.09	3.48	3.85
94	0.0637	0.143	0.250	0.399	0.569	0.784	1.008	1.294	1.620	1.960	2.330	2.75	3.17	3.62	4.13	4.67	5.21
95	0.0722	0.163	0.292	0.450	0.663	0.895	1.150	1.489	1.846	2.231	2.670	3.14	3.60	4.13	4.73	5.35	6.00

(b) Bubbler-tube tips placed in a flowing liquid may be subject to errors due to dynamic pressures, unless properly shaped;

(c) Grease coatings may affect some types of wire probes;

(d) Float systems are subject to a lag error if a measurable change in water level is needed to overcome the internal friction of the movement.

Except for the last example, these errors cannot be quantified and only cautionary statements can be made. Each situation must be individually evaluated based on experience, manufacturers' information, and the technical literature. In the case of float systems, the potential lag error can be estimated from a

measurement of the force needed to overcome friction and application of physical principles.

11.4.2.2 Regardless of the type of secondary device employed, any error in referencing the zero depth to the flume crest will introduce an error in depth that is constant in magnitude and therefore relatively more important at low flows.

11.4.2.3 Humidity effects on recorder chart paper can introduce errors of about 1 %.

## 12. Keywords

12.1 flumes; streamflow; water discharge flow measurement

## APPENDIX

### (Nonmandatory Information)

#### X1. RELATED PUBLICATIONS

X1.1 For additional information relating to the subject of this test method, refer to the following publications:

Schuster, J. C., Ed., "Water Measurement Procedures Irrigation Operations' Workshop," (REC-OCE-38, Bureau of Reclamation), U.S. Government Printing Office, 1970.

*Fluid Meters—Their Theory and Application*, Sixth Edition, American Society of Mechanical Engineers, 1971.



REFERENCES

- (1) Kilpatrick, F. A., and Schneider, V. R., "Use of Flumes in Measuring Discharge," *Techniques of Water Resources Investigation of the U.S. Geological Survey*, Book 3, Chapter A-14, U.S. Government Printing Office, 1983.
- (2) U.S. Bureau of Reclamation, "Water Measurement Manual," Second Edition, Revised Reprint, U.S. Government Printing Office, 1984.
- (3) Buchanan, T. J., and Somers, W. P., "Stage Measurement at Gaging Stations," *Techniques of Water Resources Investigations of the U.S. Geological Survey*, Book 3, Chapter A-7, U.S. Government Printing Office, 1968.
- (4) Craig, J. D., "Installation and Service Manual for U.S. Geological Survey Manometers," *Techniques of Water Resources Investigations of the U.S. Geological Survey*, U.S. Government Printing Office, 1983.

*ASTM International takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.*

*This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM International Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, at the address shown below.*

*This standard is copyrighted by ASTM International, 100 Barr Harbor Drive, PO Box C700, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (www.astm.org).*