



Designation: E 853 – 87 (Reapproved 1995)^{ε1}

Standard Practice for Analysis and Interpretation of Light-Water Reactor Surveillance Results, E706(IA)¹

This standard is issued under the fixed designation E 853; the number immediately following the designation indicates the year of original adoption or, in the case of revision, the year of last revision. A number in parentheses indicates the year of last reapproval. A superscript epsilon (ϵ) indicates an editorial change since the last revision or reapproval.

^{ε1} NOTE—Keywords were added editorially in April 1996.

1. Scope

1.1 This practice covers the methodology, summarized in Annex A1, to be used in the analysis and interpretation of neutron exposure data obtained from LWR pressure vessel surveillance programs; and, based on the results of that analysis, establishes a formalism to be used to evaluate present and future condition of the pressure vessel and its support structures² (1-70).³

1.2 This practice relies on, and ties together, the application of several supporting ASTM standard practices, guides, and methods that are in various stages of completion (see Fig. 1 and Master Matrix E 706) (1, 5, 13, 48, 49).² In order to make this practice at least partially self-contained, a moderate amount of discussion is provided in areas relating to ASTM and other documents. Support subject areas that are discussed include reactor physics calculations, dosimeter selection and analysis, and exposure units.

1.3 Since several of the standards shown in Fig. 1 are not currently in place, some of the requirements listed in Annex A1 should, at this time, be treated as recommendations. Appropriate caution should be exercised until each of the standards has been put into use.

1.4 This practice is restricted to direct applications related to surveillance programs that are established in support of the operation, licensing, and regulation of LWR nuclear power plants. Procedures and data related to the analysis, interpretation, and application of test reactor results are addressed in Matrix E 706 (IE), Practice E 560, Matrix E 706 (IC), E706 (II), Guide E 900, and E 706(IG).

1.5 *This standard does not purport to address all of the safety concerns, if any, associated with its use. It is the responsibility of the user of this standard to establish appropriate safety and health practices and determine the applica-*

bility of regulatory limitations prior to use.

2. Referenced Documents

2.1 ASTM Standards:

- E 170 Terminology Relating to Radiation Measurements and Dosimetry⁴
- E 184 Practice for Effects of High-Energy Neutron Radiation on the Mechanical Properties of Metallic Materials, E706 (IB)⁵
- E 185 Practice for Conducting Surveillance Tests for Light Water Cooled Nuclear Power Reactor Vessels, E706 (IF)⁵
- E 482 Guide for Application of Neutron Transport Methods for Reactor Vessel Surveillance, E706 (IID)⁵
- E 560 Practice for Extrapolating Reactor Vessel Surveillance Dosimetry Results, E706 (IC)⁵
- E 636 Guide for Conducting Supplemental Surveillance Tests for Nuclear Power Reactor Vessels, E706 (IH)⁵
- E 693 Practice for Characterizing Neutron Exposures in Iron and Low Alloy Steels in Terms of Displacements Per Atom (DPA), E706 (ID)⁵
- E 706 Master Matrix for Light Water Reactor Pressure Vessel Surveillance Standards⁴
- IE Damage Correlation for Reactor Vessel Surveillance⁶
- IIE Benchmark Testing of Reactor Vessel Dosimetry⁶
- IIID Application and Analysis of Damage Monitors for Reactor Vessel Surveillance⁶
- IIIE Application and Analysis of Temperature Monitors⁶
- E 844 Guide for Sensor Set Design and Irradiation for Reactor Surveillance, E706 (IIC)⁵
- E 854 Test Method for Application and Analysis of Solid State Track Recorder (SSTR) Monitors for Reactor Surveillance, E706 (IIIB)⁵
- E 900 Guide for Predicting Neutron Radiation Damage to Reactor Vessel Materials, E706 (IIF)⁵
- E 910 Specification for Application and Analysis of Helium Accumulation Fluence Monitors for Reactor Vessel Surveillance, E706 (IIIC)⁵

¹ This practice is under the jurisdiction of ASTM Committee E-10 on Nuclear Technology and Applications and is the direct responsibility of Subcommittee E10.05 on Nuclear Radiation Metrology.

Current edition approved Oct. 30, 1987. Published December 1987. Originally published as E 853 – 81. Last previous edition E 853 – 84^{ε1}.

² ASTM Practice E 185 gives reference to other standards and references that address the variables and uncertainties associated with property change measurements. The reference standards are A370, E8, E21, E23, and E208.

³ The boldface numbers in parentheses refer to the list of references appended to this practice. For an updated set of references, see the E706 Master Matrix.

⁴ *Annual Book of ASTM Standards*, Vol 12.02.

⁵ *Annual Book of ASTM Standards*, Vol 12.02. The reference in parentheses refers to Section 5 and Figs. 1 and 2 of Matrix E 706.

⁶ For standards that are in the draft stage and have not received an ASTM designation, see Section 5 and Figs. 1 and 2 of Matrix E 706.

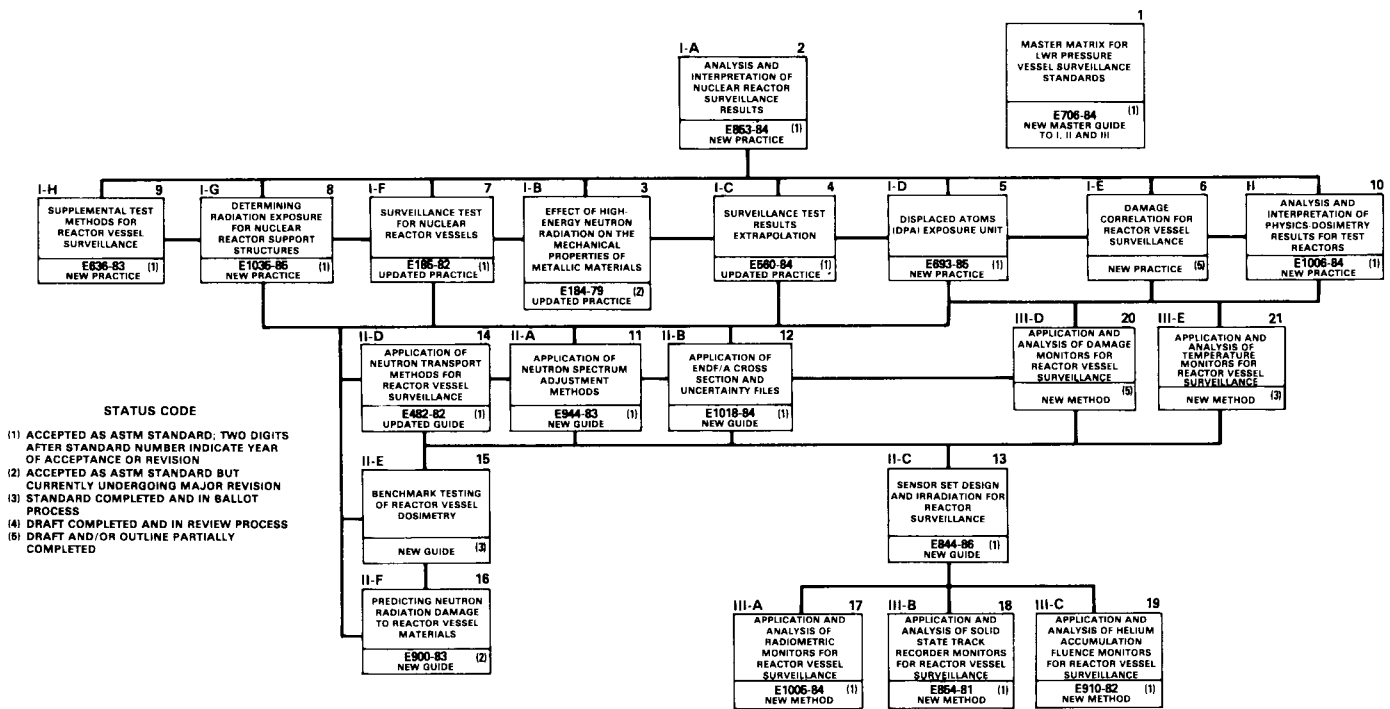


FIG. 1 ASTM Standards for Surveillance of LWR Nuclear Reactor Pressure Vessels and Support Structures

- E 944 Guide for Application of Neutron Spectrum Adjustment Methods in Reactor Surveillance, (IIA)⁵
- E 1005 Test Method for Application and Analysis of Radiometric Monitors for Reactor Vessel Surveillance, E706 (IIIA)⁵
- E 1006 Practice for Analysis and Interpretation of Physics Dosimetry Results for Test Reactors, E706 (II)⁵
- E 1018 Guide for Application of ASTM Evaluated Cross Section Data File (ENDF/A)—Cross Section and Uncertainty File, E706 (IIB)⁵
- E 1035 Practice for Determining Radiation Exposures for Nuclear Reactor Vessel Support Structures, (IG)⁵

2.2 Other Documents:

- NUREG/CR-1861 HEDL-TME 80-87 LWR Pressure Vessel Surveillance Dosimetry Improvement Program: PCA Experiments and Blind Test⁷
- ASME Boiler and Pressure Vessel Code, Sections III and IX⁸
- Code of Federal Regulations, Title 10, Part 50, Appendixes G and H⁹

3. Significance and Use

3.1 The objectives of a reactor vessel surveillance program are twofold. The first requirement of the program is to monitor changes in the fracture toughness properties of ferritic materials in the reactor vessel beltline region resulting from exposure

to neutron irradiation and the thermal environment. The second requirement is to make use of the data obtained from the surveillance program to determine the conditions under which the vessel can be operated throughout its service life.

3.1.1 To satisfy the first requirement of 3.1, the tasks to be carried out are straightforward. Each of the irradiation capsules that comprise the surveillance program may be treated as a separate experiment. The goal is to define and carry to completion a dosimetry program that will, a posteriori, describe the neutron field to which the materials test specimens were exposed. The resultant information will then become part of a data base applicable in a stricter sense to the specific plant from which the capsule was removed, but also in a broader sense to the industry as a whole.

3.1.2 To satisfy the second requirement of 3.1, the tasks to be carried out are somewhat complex. The objective is to describe accurately the neutron field to which the pressure vessel itself will be exposed over its service life. This description of the neutron field must include spatial gradients within the vessel wall. Therefore, heavy emphasis must be placed on the use of neutron transport techniques as well as on the choice of a design basis for the computations. Since a given surveillance capsule measurement, particularly one obtained early in plant life, is not necessarily representative of long-term reactor operation, a simple normalization of neutron transport calculations to dosimetry data from a given capsule may not be appropriate (1-67).²

3.2 The objectives and requirements of a reactor vessel's support structure's surveillance program are much less stringent, and at present, are limited to physics-dosimetry measurements through ex-vessel cavity monitoring coupled with the use of available test reactor metallurgical data to determine the condition of any support structure steels that might be subject

⁷ Available from NRC Public Document Room, 1717 H St. NW, Washington, DC 20555.

⁸ Available from American Society of Mechanical Engineers, 345 E. 47th St., New York, NY 10017.

⁹ Available from Superintendent of Documents, U. S. Government Printing Office, Washington, DC 20402.

to neutron induced property changes (1, 29, 44-58, 65-70).

4. Establishment of the Surveillance Program

4.1 Practice E 185 describes the criteria that should be considered in planning and implementing surveillance test programs and points out precautions that should be taken to ensure that: (1) capsule exposures can be related to beltline exposures, (2) materials selected for the surveillance program are samples of those materials most likely to limit the operation of the reactor vessel, and (3) the tests yield results useful for the evaluation of radiation effects on the reactor vessel.

4.1.1 From the viewpoint of the radiation analyst, the criteria explicated in Practice E 185 are met by the completion of the following tasks: (1) Determine the locations within the reactor that provide suitable lead factors (see Practice E 185) for each irradiation capsule relative to the pressure vessel; (2) Select neutron sensor sets that provide adequate coverage over the energy range and fluence range of interest; (3) Specify sensor set locations within each irradiation capsule to define neutron field gradients within the metallurgical specimen array. For reactors in which the end of life shift in RT_{NDT} of the pressure vessel beltline material is predicted to be less than 100°F, gradient measurements are not required. In that case sensor set locations may be chosen to provide a representative measurement for the entire surveillance capsule; and (4) Establish and adequately benchmark neutron transport methodology to be used both in the analysis of individual sensor sets and in the projection of materials properties changes to the vessel itself.

4.1.2 The first three items listed in the preceding paragraph are carried out during the design of the surveillance program. However, the fourth item, which directly addresses the analysis and interpretation of surveillance results, is performed following withdrawal of the surveillance capsules from the reactor. To provide continuity between the designer and the analyst, it is recommended that the documentation describing the surveillance programs of individual reactors provide details of irradiation capsule construction, locations of the capsules relative to the reactor core and internals, and sensor set design that are adequate to allow accurate evaluations of the surveillance measurement by the analyst. Well documented (1) metallurgical and (2) physics-dosimetry data bases now exist for use by the analyst based on both power reactor surveillance capsule and test reactor results (1, 12, 19-38, 58-64).

4.1.3 Information regarding the choice of neutron sensor sets for LWR surveillance applications is provided in Matrix E 706: IIC, Sensor Set Design; IIIA, Radiometric Monitors; IIIB, Solid State Track Recorder Monitors; IIIC, Helium Accumulation Fluence Monitors; and Damage Monitors. Dosimeter materials currently in common usage and acceptable for use in surveillance programs include Cu, Ti, Fe, Ni, U^{238} , Np^{237} , U^{235} , and Co-Al. All radionuclide analysis of dosimeters should be calibrated to known sources such as those supplied by the National Bureau of Standards (NBS) or The International Atomic Energy Agency (IAEA). All quality assurance information pertinent to the sensor sets must be documented with the description of the surveillance program (1, 40-43, 48, 51-58).

4.1.4 As indicated in 4.1.1, neutron transport methods are

used both in the design of the surveillance program and in the analysis and interpretation of capsule measurements. During the design phase, neutron transport calculations are used to define the neutron field within the pressure vessel wall and, in conjunction with damage trend curves, to predict the degree of embrittlement of the reactor vessel over its service life. Embrittlement gradients are in turn used to determine pressure-temperature limitations for normal plant operation as well as to evaluate the effect of various heat-up/cool-down transients on vessel condition.

4.1.5 The neutron transport methodology used for these computations must be well benchmarked and qualified for application to LWR configurations. The PCA (Experiment and Blind Test) data documented in Ref 47 provide one configuration for benchmarking basic transport methodology as well as some of the input data used in power reactor calculations. Other suitably defined and documented benchmark experiments, such as those for VENUS (1, 43, 45) and for NESDIP (1, 46, 50), may also be used to provide method verification. However, further analytical/experimental comparisons are required to qualify a method for application to LWRs that have a more complex geometry and that require a more complex treatment of some input parameters, particularly of reactor core power distributions (1, 65-67). This additional qualification may be achieved by comparison with measurements taken in the reactor cavity external to the pressure vessel of selected operating reactors (1, 51-57).

4.1.6 All experimental/analytical comparisons that comprise the qualification program for a neutron transport methodology must be documented. At a minimum, this documentation should provide an assessment of the uncertainty or error inherent in applying the methodology to the evaluation of surveillance capsule dosimetry and to the determination of damage gradients within the beltline region of the pressure vessel (1, 12, 19-21, 23-29, 36, 38, 43-48, 50-57).

4.1.7 In the application of neutron transport methodology to the evaluation of surveillance dosimetry as well as to the prediction of damage within the pressure vessel, several options are available regarding the choice of design basis power distributions, the necessary detail in the geometric mockup, and the normalization of the analytical results. The methodology chosen by any analyst should be documented with sufficient detail to permit a critical evaluation of the overall approach. Further discussions of the application of neutron transport methods to LWRs are provided in Practice E 560, IC, and Guide E 482, IID.

4.1.8 To ensure that metallurgical results obtained from surveillance capsule measurements may be applied to the determination of the pressure vessel fracture toughness, the irradiation temperature of the surveillance test specimens must be documented (see Matrix E 706 (IIIE)).

4.2 As stated in 3.2, the requirements for the establishment of a surveillance program for reactor vessel support structures are much less stringent than for the reactor vessel, and the analyst is referred to Practice E 1035, IG for more information.

5. Analysis of Individual Surveillance Capsules

5.1 It is recognized that for many operating power reactors, the documentation of baseline neutron transport calculations

and sensor set design information may not be available. In that event, to whatever extent possible the required information should be provided by the service laboratory in the respective surveillance report (1, 29, 58).

5.2 Radiometric analysis of capsule sensor sets should follow procedures outlined in Test Method E 1005, IIIA. For sensors such as the fission monitors which may be gamma-ray-sensitive, photo reaction corrections should be derived from the results of gamma-ray transport calculations performed for the explicit capsule configuration under examination. Photo reaction corrections in LWR environments have been shown to be extremely configuration dependent (1, 29, 58).

5.3 In calculating spectrum averaged reaction cross sections from neutron transport calculations, care should be taken to model the explicit capsule configuration and location under examination (see Guide E 482, IID.) It will be necessary to determine uncertainties associated with the determination of damage exposure parameters. The procedures outlined in Guide E 944, IIA can, in many cases, be useful for accomplishing this. To achieve satisfactory uncertainty bounds for the damage parameters a sufficiently large set of foils should be used as stipulated in 4.1.3 (1, 29, 36).

5.4 The report of the capsule analysis should contain the following information. Uncertainties should be included in all data (1, 29, 36).

5.4.1 Damage exposure parameters at the position of the metallurgical specimens. These values will be used for correlation with metallurgical data to develop damage trend curves. Neutron fluence ($E > 1.0$ MeV) is presently required. However, dpa (displacements per atom) and neutron fluence ($E > 0.1$ MeV) should also be included for future reference. These exposure values are derived from a combination of measurements and calculations and must include estimates of uncertainty bounds,

5.4.2 The neutron spectra, reaction rates, reaction cross sections, and all other nuclear constants used in the derivation of exposure values for the capsule,

5.4.3 The gamma-ray energy spectra and reaction cross sections used to make photoreaction corrections for the neutron sensor sets,

5.4.4 The power-time history of the reactor during the irradiation period of the subject capsule, and

5.4.5 Spatial gradients of neutron flux ($E > 1.0$ MeV), neutron fluence ($E > 1.0$ MeV), and dpa throughout the metallurgical specimen array.

5.4.6 In addition, the documentation supporting the benchmarking/qualification of sensor sets and reactor physics methodology should be either referenced or included as an appendix to the dosimetry report.

6. Projection of Vessel and Support Structure Condition for Future Plant Operation

6.1 *Reactor Vessel:*

6.1.1 This practice requires the use of a fully benchmarked and qualified neutron transport methodology in both the design of the surveillance program and the analysis of individual surveillance capsules. The neutron field information obtained from these computations should also be used to project damage gradients within the pressure vessel wall. Currently, all such

projections are based on neutron fluence ($E > 1.0$ MeV). However, it is recommended that supplementary projections based on dpa maps throughout the pressure vessel beltline region/surveillance capsule geometry be included in the surveillance report (1, 12, 19, 20, 21, 23-29, 33, 36, 38-48, 51-67).

6.1.2 It is recommended that all surveillance results for a generic reactor type (similar reactor geometry and fuel loading) be used as a data base to qualify the reactor physics methodology as to its applicability to a particular reactor system. This approach should, in the long term, provide a statistically significant validation of the calculations.

6.1.3 Capsules removed from symmetric positions in generic reactor geometries represent a series of repeat measurements. As such, the measured data will reflect the variability in important parameters such as water temperature, reactor dimensions, fuel loading, sensor set design, sensor set analysis, and reactor operating characteristics. By taking advantage of a large data base obtained from these repeat measurements, the uncertainties introduced by these various parameters may be better understood and possibly reduced.

6.1.4 When evaluating the results of a given surveillance capsule analysis, the measured capsule exposure should be compared directly with neutron transport analysis and with all available experimental data obtained from similar capsules removed from reactors having the same design. If the agreement between measurement and calculation is within the range indicated by the benchmark documentation for the specified methodology, the analytically derived neutron field parameters should be used for all damage determinations for the pressure vessel (29).

6.1.5 If the measurements differ from the calculations by more than the margins indicated by the benchmark documentation, further investigation of the measurement approach and the mode of operation of the reactor in question should be undertaken. Any adjustments made to vessel embrittlement projections based on the results of these investigations should be justified and fully documented in the surveillance report.

6.2 *Reactor Vessel Support Structures*—The analyst is referred to Practice E 1035.

7. Uncertainties

7.1 Analysis and measurement accuracies (uncertainties and errors) in the areas of concern for this practice may be difficult to determine. However, they should be properly addressed (1, 12, 19-22, 23-29, 36, 38, 39, 43, 44, 47, 48, 51, 58-64). When uncertainties and errors are well defined, as in integral reaction rate measurements, they should be estimated and summarized in an accuracy table. For more difficult uncertainty situations, such as for damage exposure parameters, the procedure for determining uncertainties must be well documented. A statement must be included that indicates what the uncertainty estimates do and do not cover. It will be necessary to accept incomplete or nonrigorous uncertainty and error estimates when there is no readily available alternative.

8. Keywords

8.1 damage exposure parameter; dpa; embrittlement; LWR; pressure vessel; reactor surveillance; surveillance capsule

ANNEX

(Mandatory Information)

A1. PROCEDURES FOR ANALYSIS AND INTERPRETATION OF NUCLEAR REACTOR SURVEILLANCE RESULTS

A1.1 Procedures

A1.1.1 Establish the basic surveillance test program for each operating power plant. Currently, Practice E 185 is available and is used. However, updated versions of this standard should include the following:

A1.1.1.1 Determination of surveillance capsule spatial flux-fluence-spectral and DPA maps for improved correlation and application of measured property change data (upper shelf, NDTT, etc.). Measured surveillance capsule fission and non-fission monitor reaction and reaction rate data should be combined with reactor physics computations to make necessary adjustments for capsule perturbation effects.

A1.1.1.2 As appropriate, use of measured/calculated DPA damage for normalization of Charpy to Charpy (and other metallurgical specimen) variations in neutron flux, fluence, and spectra. Here, an increased use of a larger number of metallurgical specimen iron drillings may be appropriate for dosimetry.

A1.1.2 Establish a reactor physics computational method applicable to the surveillance program. Currently, Guide E 482 and Practice E 560 provide general guidance in this area. However, updated versions of these standards should include the following:

A1.1.2.1 Determination of core power distributions applicable to long-term (30- to 60-year) irradiation. Associated with this is the need for the use of updated FSAR (Final Safety Analysis Report) reactor physics information at startup.

A1.1.2.2 Determination of potential cycle-to-cycle variations in the core power distributions. This will establish bounds

on expected differences between surveillance measurements and design calculations. Ex-vessel dosimetry measurements should be used for verification of this and the previous step.

A1.1.2.3 Determination of the effect of surveillance capsule perturbations and photofission on the evaluation of capsule dosimetry. Adjustment codes should be used, as appropriate, to combine reactor physics computations with dosimetry measurements.

A1.1.2.4 Benchmark validation of the analytical method.

A1.1.3 Establish methods for relating dosimetry, metallurgy, and temperature data from the surveillance program to current and future reactor vessel and support structure conditions. Currently, Practice E 560 provides general guidance in this area. An updated version of this standard should include the following considerations.

A1.1.3.1 Differences in core power distributions that may be expected during long-term operation and that may impact the extrapolation of surveillance results into the future. As previously stated, ex-vessel dosimetry should be used for verification.

A1.1.3.2 Establish methods to verify A1.1.2 and A1.1.3 and to determine uncertainty and error bounds for the interpretation of the combined results of dosimetry, metallurgical and temperature measurements. Currently, Practice E 185 provides general guidance in this area. An updated version of this standard should more completely address the separate and combined accuracy requirements of dosimetry, metallurgy, and temperature-measurement techniques.

REFERENCES

- (1) McElroy, W. N., et al, "LWR Pressure Vessel Surveillance Dosimetry Improvement Program," 1982 Annual Report, NUREG/CR-2805, Vol 3, HEDL-TME 82-20, January 1983, and *Proceedings of the NRC Tenth Water Reactor Safety Research Information Meeting*, NUREG/CP-0041, Vol 4, Materials Engineering Branch, January 1983.
- (2) Steele, L., "Review of the IAEA Specialists' Meeting on Irradiation Embrittlement, Thermal Annealing and Surveillance of Reactor Pressure Vessels," *Proceedings of the 3rd ASTM-Euratom International Symposium on Reactor Dosimetry*, Ispra, Italy, Oct. 1-5, 1979, EUR 6813 EN-FR, Vol 1, 1980, p. 334; and *Proceedings of the IAEA Specialists' Meeting*, Vienna, Austria, Feb. 26-March 1, 1979, IWG-RRPC-79/3, December 1979.
- (3) Schneider, W. (Editor), "Accuracies in Correlation Between Property Change and Exposure Data from Reactor Pressure Vessel Steel Irradiations," *Proceedings of an IAEA Specialists' Meeting at Jülich*, West Germany, Sept. 24-27, 1979, JUL-CONF-37, ISSN 0344-5798, May 1980.
- (4) Till, H., "Neutron Radiometric and Calculation Benchmarking for LWR Pressure Vessel Radiation Effects," *Proceedings of the 3rd ASTM-Euratom International Symposium on Reactor Dosimetry*, Ispra, Italy, Oct. 1-5, 1979, EUR 6813 EN-FR, Vol 1, 1980, p. 334.
- (5) Fabry, A., and Kam, F. B. K., "Towards Adequate Evaluation of LWR Pressure Vessel Steel Irradiation Exposures," *Proceedings of an IAEA Specialists' Meeting on "Accuracies in Correlation Between Property Change and Exposure Data from Reactor Pressure Vessel Steel Irradiations,"* Jülich, West Germany, Sept. 24-27, 1979, JUL-CONF-37, ISSN 0344-5789, May 1980.
- (6) ASME Boiler and Pressure Vessel Code, Section III, Nuclear Power Plant Components, Subsection NF, July 1, 1974, Summer 1975 Addenda and Hopkins, W. C., "Suggested Approach for Fracture-Safe RPV Support Design in Neutron Environments," *ANS Transactions*, Vol 30, November 1978, p. 187.
- (7) Wagner, S. R., "The Treatment of Systematic Errors Which Cannot Be Quantitatively Assessed with the Aim to Characterize the Accuracy of a Measurement," in *Proceedings of the Symposium on "Measurement Theory-Measurement Error Analysis,"* Enschede, The Netherlands, Dec. 11-13, 1975, International Measurement Confederation, IMEDO Secretariat, Budapest, Hungary.
- (8) McElroy, W. N., et al, "Development and Testing of Standardized

- Procedures and Reference Data for LWR Surveillance,” HEDL-SA-1719 and *Proceedings of the IAEA Specialists’ Meeting on “Irradiation Embrittlement, Thermal Annealing and Surveillance of Reactor Pressure Vessels,”* Vienna, Austria, Feb. 26–March 1, 1979, IWG-RRPC-79/3, December 1979.
- (9) Stahlkopf, K. E., and Marston, T. U., “A Comprehensive Approach to Radiation Embrittlement Analysis,” in *Proceedings of an IAEA Specialists’ Meeting on “Irradiation Embrittlement, Thermal Annealing and Surveillance of Reactor Pressure Vessels,”* Vienna, Austria, Feb. 26–March 1, 1979, IWG-RRPC-79/3, December 1979.
 - (10) Odette, G. R., Server, W. L., Oldfield, W., Ritchie, R. O., and Wullaert, R. A., “Analysis of Radiation Embrittlement Reference Toughness Curves,” FCC 78-11, Fracture Control Corporation, Nov. 14, 1978.
 - (11) Odette, G. R., “Neutron Exposure Dependence of the Embrittlement Reactor Pressure Vessel Steels: Correlation Models and Parameters,” in *Proceedings of an IAEA Specialists’ Meeting on “Accuracies in Correlation Between Property Change and Exposure Data from Reactor Pressure Vessel Steel Irradiations,”* Jülich, West Germany, Sept. 24–27, 1979, JUL-CONF-37, ISSN 0344-5789, May 1980.
 - (12) Randall, P. N., “Status of Regulatory Demands in the U.S. on the Application of Pressure Vessel Dosimetry,” *Proceedings on the Fourth ASTM-Euratom Symposium on Reactor Dosimetry*, Washington, DC, July 1982, NUREG/CP-0029, Nuclear Regulatory Commission, p. 1011.
 - (13) Serpan, C. Z., “Standardization of Dosimetry Related Procedures for the Prediction and Verification of Changes in LWR-PV Steel Fracture Toughness During a Reactor’s Service Life: Status and Recommendations,” *Proceedings of the 3rd ASTM-Euratom International Symposium on Reactor Dosimetry*, Ispra, Italy, Oct. 1–5, 1979, EUR 6813 EN-FR, Vol 2, 1980, p. 1266.
 - (14) Magurno, B. A., “Status of Data Testing of ENDF/B-V Reactor Dosimetry File,” *Proceedings of the 3rd ASTM-Euratom International Symposium on Reactor Dosimetry*, Ispra, Italy, Oct. 1–5, 1979, EUR 6813 EN-FR, Vol 2, 1980, p. 903.
 - (15) MPC Subcommittee 6 on Nuclear Materials, “Prediction of the Shift in the Brittle-Ductile Transition Temperature of LWR Pressure Vessel Materials,” Final Report to ASTM Subcommittee E10.02, June 30, 1979.
 - (16) Adams, F., and Dams, R., *Applied Gamma-Ray Spectrometry*, Pergamon Press, New York, NY, 1970.
 - (17) Gold, R., Armani, R. J., and Roberts, J. H., “Absolute Fission Rate Measurements with Solid State Track Recorders,” *Nuclear Science and Engineering*, Vol 34, 1968, pp. 13–32.
 - (18) Farrar IV, H., and Lippincott, E. P., “Helium Production Measurements for Neutron Dosimetry and Damage Correlations,” NUREG/CP-0004, Vol 2, October 1977, p. 725.
 - (19) Randall, P. N., “NRC Perspective of Safety and Licensing Issues Regarding Reactor Vessel Steel Embrittlement,” ANS Special Session on “Correlations and Implications of Neutron Irradiation Embrittlement of Pressure Vessel Steels,” ANS Transactions, Detroit Michigan Meeting, June 12–16 1983, Vol 44, p. 220.
 - (20) Dircks, W. J., “Pressurized Thermal Shock (PTS),” NRC Report, SECY-82-465, Nov. 23, 1982 and Enclosure A, NRC Staff Evaluation of PTS, November 1982.
 - (21) Tagart, S. W., et al., “Structural Mechanics Program: Progress in 1981,” Special Report, NP-2705-SR, Electric Power Research Institute, Palo Alto, CA, October 1982.
 - (22) Mager, T. R., et al., “Feasibility of and Methodology for Thermal Annealing of Embrittled Reactor Vessel: Detailed Technical Description of the Work,” Final Report, EPRI-NP 2712, Vol 2, Project 1021-1, Electric Power Research Institute, Palo Alto, CA, November 1982.
 - (23) Strosnider, J., and Monseprate, G., with Appendix prepared by Kenworthy, L. D., and Tether, G. D., “MATSURV—Computerized Reactor Pressure Vessel Materials Information System,” NUREG-0688, Nuclear Regulatory Commission, Washington, DC, October 1980.
 - (24) McConnel, P., et al, *Irradiated Nuclear Pressure Vessel Steel Data Base*, NP-2428, Electric Power Research Institute, Palo Alto, CA, June 1982.
 - (25) Varsiks, J. D., “Evaluation of Irradiation Response of Reactor Pressure Vessel Materials,” Final Report, EPRI NP-2720, Project 1553-1, Electric Power Research Institute, Palo Alto, CA, November 1982.
 - (26) Guthrie, G. L., “Development of Trend Curve Formulas Using Surveillance Data,” *LWR-PV-SDIP Quarterly Progress Report*, January–March 1982, NUREG/CR-2805, Vol 1, HEDL-TME 82-18, HEDL-3, Hanford Engineering Development Laboratory, Richland, WA, December 1982.
 - (27) Guthrie, G. L., “Development of Trend Curve Formulas Using Surveillance Data,” *LWR-PV-SDIP Quarterly Progress Report*, April–June 1982, NUREG/CR-2805, Vol 2, HEDL-TME 82-19, HEDL-3, Hanford Engineering Development Laboratory, Richland, WA, December 1982.
 - (28) Simons, R. L., et al, “Re-Evaluation of the Dosimetry for Reactor Pressure Vessel Surveillance Capsules,” *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 903.
 - (29) McElroy, W. N., editor, “LWR Power Reactor Surveillance Physics Dosimetry Data Base Compendium,” NUREG/CR-3319, HEDL-TME-84-2, January 1983.
 - (30) Hawthorne, J. R., (MEA), “Irradiation and Annealing Sensitivity Studies,” *Proceedings of the NRC Tenth WRSR Information Meeting*, MEA-2009, National Bureau of Standards, Washington, DC, Oct. 12–15, 1982.
 - (31) Fabry, A., et al, “Results and Implications of the Initial Neutronic Characterization of Two HSST Irradiation Capsules and the PSF Simulated LWR Pressure Vessel Irradiation Facility,” *Presented at the NRC Eighth WRSR Information Meeting*, National Bureau of Standards, Washington, DC, Oct. 27–31, 1980.
 - (32) Kam, F. B. K., editor, *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Vols 1 and 2, Nuclear Regulatory Commission, Washington, DC, July 1982.
 - (33) Zijp, W. L., et al, “Status Report of the Real-80 Exercise,” *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 1089.
 - (34) Kam, F. B. K., “Characterization of the Fourth HSST Series of Neutron Spectral Metallurgical Irradiation Capsules,” *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 1023.
 - (35) Kam, F. B. K., et al, “Neutron Exposure Parameters for the Fourth HSST Series of Metallurgical Irradiation Capsules,” *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 1023.
 - (36) Stallmann, F. W., “Uncertainties in the Estimation of Radiation Damage Parameters,” *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 1155.
 - (37) Stallmann, F. W., Pressure Vessel Benchmark Facility to Study Fracture Toughness of Irradiated Pressure Vessel Materials (BSR-HSST), *LWR-PV-SDIP Quarterly Progress Report*, April–June 1982, NUREG/CR-2805, Vol 2, HEDL-TME 82-19, ORNL-17, Hanford Engineering Development Laboratory, Richland, WA, December 1982.
 - (38) Stallmann, F. W., “Evaluation and Uncertainty Estimates of Charpy Impact Data,” *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 855.

- (39) Cheverton, R. D., "A Brief Account of the Effect of Overcooling Accidents on the Integrity of PWR Pressure Vessels," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 1061.
- (40) Tourwé, H., and Minsart, G., "Surveillance Capsule Perturbations Studies in the PSF 4/12 Configuration," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 471.
- (41) Kellogg, L. S., and Lippincott, E. P., "PSF Interlaboratory Comparison," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 929.
- (42) Tourwé, H., et al., "Interlaboratory Comparison of Fluence Neutron Dosimeters in the Frame of the PSF Start-Up Measurement Programme," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 159.
- (43) Fabry, A., et al., "Improvement of LWR Pressure Vessel Steel Embrittlement Surveillance: Progress Report on Belgian Activities on Cooperation with the USNRC and other R and D Programs," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 45.
- (44) Maerker, R. E., Wagshal, J. J., and Broadhead, B. L., *Development and Demonstration of an Advanced Methodology for LWR Dosimetry Applications*, EPRI-NP 2188, Interim Report, Electric Power Research Institute, Palo Alto, CA, 1981.
- (45) Fabry, A., et al., "VENUS Dosimetry Program," *Proceedings of the NRC Tenth WRSR Information Meeting*, National Bureau of Standards, Washington, DC, Oct. 12–15, 1982.
- (46) Austin, M., "Description and Status of the NESTOR Dosimetry Improvement Programme (NESDIP)," *Proceedings of the NRC Tenth WRSR Information Meeting*, National Bureau of Standards, Washington, DC, Oct. 12–15, 1982.
- (47) McElroy, W. N., editor, *LWR Pressure Vessel Surveillance Dosimetry Improvement Program: PCA Experiments and Blind Test*, NUREG/CR-1861, HEDL-TME 80-87, Hanford Engineering Development Laboratory, Richland, WA, July 1981.
- (48) McElroy, W. N., et al., "Surveillance Dosimetry of Operating Power Plants," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 3, and in *LWR-PV SDIP 1981 Annual Report*, HEDL-SA-2546, Nuclear Regulatory Commission, Washington, DC, 1982.
- (49) Hedgecock, P. D., and Perrin, J. S., "Standards for Materials Behavior Under Neutron Irradiation," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 829.
- (50) Austin, M., "Sense of Direction: An Observation of Trends in Materials Dosimetry in the United Kingdom," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 461.
- (51) Grundl, J. A., et al., "NRC-EPRI Studies of Pressure-Vessel-Cavity Neutron Fields," *Presented at the NRC Ninth WRSR Information Meeting*, Oct. 26–30, 1981, National Bureau of Standards, Washington, DC, 1981.
- (52) Shaw, R. A., "Brown's Ferry and Arkansas Nuclear One Pressure Vessel Neutron Fluence Benchmarks," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 513.
- (53) Martin, G. C., "Brown's Ferry Unit-3 Cavity Neutron Spectral Analysis," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 555, and EPRI NP-1997, Electric Power Research Institute, Palo Alto, CA, August 1981.
- (54) Brandon, W. E., et al., "Neutron Dosimetry in the Pressure Vessel Cavity of Two Pressurized Water Reactors," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 533.
- (55) Tsoulfanidis, N., et al., "Calculation of Neutron Spectra at the Pressure Vessel and Cavity of a PWR," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 519.
- (56) Petilli, M., "A New Analysis of the Experiment for Measurement of $\phi \geq 1$ MeV in Pressure Vessel Cavity of U.S. Light Water Power Reactor Arkansas," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 545.
- (57) Selph, W. E., and MacKenzie, J., *Passive Neutron Dosimetry for Measurements at the McGuire Reactor*, EPRI NP-2570, Electric Power Research Institute, Palo Alto, CA, September 1982.
- (58) Steele, L., editor, *Status of USA Nuclear Reactor Pressure Vessel Surveillance for Radiation Effects*, ASTM STP 784, January 1983.
- (59) Davies, L. M., et al., "Analysis of the Behavior of Advanced Reactor Pressure Vessel Steels Under Neutron Irradiation-The UK Programme," *Report from the UK for the IAEA Coordinated Research Programme on the Analysis of the Behavior of Advanced Reactor Pressure Vessel Steels Under Neutron Irradiations*. April 1983.
- (60) Marston, T., "A Brief on the Assessment of Relative Uncertainties," *ANS Special Session on Correlations and Implications of Neutron Irradiation Embrittlement of Pressure Vessel Steels*, ANS Transactions, Vol 44, p. 221.
- (61) Guthrie, G. L., "Pressure Vessel Steel Irradiation Embrittlement Formulas Derived from PWR Surveillance Data," *ANS Special Session on Correlations and Implications of Neutron Irradiation Embrittlement of Pressure Vessel Steels*, ANS Transactions, Vol 44, p. 222.
- (62) Varsils, J. D., "An Empirical Evaluation of a Transition Temperature Shift in LWR-PV Steels," *ANS Special Session on Correlations and Implications of Neutron Irradiation Embrittlement of Pressure Vessel Steels*, ANS Transactions, Vol 44, p. 223.
- (63) Odette, G. R., and Lombrozo, P., "A Physically Statistically Based Correlation for Transition Temperature Shifts in Pressurized Steel Surveillance Welds," *ANS Special Session on Correlations and Implications of Neutron Irradiation Embrittlement of Pressure Vessel Steels*, ANS Transactions, Vol 44, p. 224.
- (64) Berggren, R. G., and Stallmann, F. W., "Statistical Analysis of Pressure Vessel Steel Embrittlement Data," *ANS Special Session on Correlations and Implications of Neutron Irradiation Embrittlement of Pressure Vessel Steels*, ANS Transactions, Vol 44, p. 225.
- (65) Guthrie, G. L., McElroy, W. N., and Anderson, S. L., "Investigation of Effects of Reactor Core Loadings on PV Neutron Exposure," *LWR-PV-SDIP Quarterly Progress Report*, October–December 1981, NUREG/CR-2345, Vol 4 and HEDL-TME 81-36, Section E Appendix, Hanford Engineering Development Laboratory, Richland, WA, September 1982.
- (66) Guthrie, G. L., McElroy, W. N., and Anderson, S. L., "A Preliminary Study of the Use of Fuel Management Techniques for Slowing Pressure Vessel Embrittlement," *Proceedings of the Fourth ASTM-EURATOM Symposium on Reactor Dosimetry*, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 111.
- (67) Aronson, A. L., et al., "Evaluation of Methods for Reducing Pressure Vessel Fluence," BNL-NUREG-32876, March 1983.
- (68) Hopkins, W. C., "Suggested Approach for Fracture-Safe RPV Support Structure Design in Neutron Environments," *ANS Transactions*, Vol 30, p. 187, November 1978.
- (69) Hawthorne, J. R., and Sprague, J. A., *Radiation Effects to Reactor Vessel Support Structures*, Report by Task C of Interagency Agreement NRC-03-79-148, Nuclear Regulatory Commission, Washington, DC, Oct. 22, 1979.

(70) Alberman, A., et al, "Influence des Neutrons Thermiques sur la Fragilisation de l'Acier de Peau d'Étancheité des Reacteurs à Haute Temperature (H.T.R.)," *Proceedings of the Fourth ASTM-EURATOM*

Symposium on Reactor Dosimetry, NUREG/CP-0029, Nuclear Regulatory Commission, Washington, DC, July 1982, p. 839.

The American Society for Testing and Materials takes no position respecting the validity of any patent rights asserted in connection with any item mentioned in this standard. Users of this standard are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, are entirely their own responsibility.

This standard is subject to revision at any time by the responsible technical committee and must be reviewed every five years and if not revised, either reapproved or withdrawn. Your comments are invited either for revision of this standard or for additional standards and should be addressed to ASTM Headquarters. Your comments will receive careful consideration at a meeting of the responsible technical committee, which you may attend. If you feel that your comments have not received a fair hearing you should make your views known to the ASTM Committee on Standards, 100 Barr Harbor Drive, West Conshohocken, PA 19428.

This standard is copyrighted by ASTM, 100 Barr Harbor Drive, West Conshohocken, PA 19428-2959, United States. Individual reprints (single or multiple copies) of this standard may be obtained by contacting ASTM at the above address or at 610-832-9585 (phone), 610-832-9555 (fax), or service@astm.org (e-mail); or through the ASTM website (<http://www.astm.org>).